






CLAUSE NO.	TECHNICAL REQUIREMENTS		
2	Accuracy	<p>± 0.060 % of calibrated range (minimum) for calibrated range greater than 400 mmwc.</p> <p>+0.065% of calibrated range (minimum) for calibrated range greater than 250 kg/cm².</p> <p>± 0.10 % of calibrated range (minimum) for calibrated range less than 400 mmwc.</p>	
3.	Stability	<p>0.25 % of calibrated range for 10 years for calibrated range greater than equal to 400 mmwc on standard conditions of manufacturer.</p> <p>0.2 % of calibrated range for 1 years for calibrated range less than 400 mmwc on standard conditions of manufacturer.</p> <p>0.15% of calibrated range for 5 years for DPT with static pressure greater than 250 kg/cm².</p>	
4	Turn down	<p>50:1 for greater than or equal to span of 400mmwcl.</p> <p>20:1 for span below 400mmwcl.</p> <p>10:1 for span greater than 250 kg/cm²</p> <p>(Above mentioned (2,3,4) parameters/features of offered models shall be strictly as defined in standard published catalogue of the manufacturer only).</p>	
5	Housing	Weather proof as per IP-67, metallic housing with durable corrosion resistant coating	
6.	Electrical connection	½" NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible	
7.	Process connection	½" NPT (F)	
8.	Operating Ambient temperature	85 deg C without display. 70 deg C with display.	
	Overpressure	150% of max operating pressure	
9	Accessories	<p>-Diaphragm seal, pulsation dampeners, syphon etc. as required by service and operating condition.</p> <p>-2 valve manifold for absolute & gauge pressure transmitters, -3-valve for DP and 5 valve manifold for level/flow applications.</p> <p>-The valve manifold shall be non-integral type.</p> <p>-For hazardous area, enclosure as described in NEC article 5.</p>	
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2	PART-B SUB-SECTION-III-C2 MEASURING INSTRUMENTS
		PAGE 6 OF 8	

CLAUSE NO.	TECHNICAL REQUIREMENTS																						
16.02.00	<p>10. Mounting 2 inch pipe mounting with Enclosure/Rack/Canopy.</p> <p>11. Diagnostics & display Self-Indicating feature and digital display on transmitter</p> <p>Notes</p> <ul style="list-style-type: none"> - For primary air/ secondary air/flue gas/ furnace pressure applications, DP type transmitters shall be provided for pressure measurement below 2000 mmwc. - LVDT type is not acceptable. - Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application. <p>Temperature Transmitter</p>																						
16.02.01	<p>Single Input /Dual Input Temperature transmitter</p> <p>Temperature transmitter shall be provided which shall be fully compatible with thermocouples and RTDs being provided by the contractor. Temperature compensation for thermocouples shall be performed in the temperature transmitter itself. Transmitters shall be capable of withstanding ambient temperature up to 85 deg C.</p> <p>Following specifications are applicable for dual input/single input temperature transmitter.</p> <table border="1" data-bbox="423 1255 1406 1766"> <thead> <tr> <th>S No.</th> <th>Features</th> <th>Essential/Minimum Requirements</th> </tr> </thead> <tbody> <tr> <td>1.</td> <td>Output</td> <td>FOUNDATION fieldbus /PROFIBUS PA</td> </tr> <tr> <td>2.</td> <td>Input</td> <td>Same transmitter shall be capable to handle Pt-100 RTD, Thermocouples –K, R & ,S types</td> </tr> <tr> <td>3.</td> <td>Housing</td> <td>Weather proof as per IP-67, metallic housing with durable corrosion resistant coating</td> </tr> <tr> <td>4.</td> <td>Electrical connection</td> <td>½” NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible</td> </tr> <tr> <td>5.</td> <td>Diagnostics display</td> <td>& Self-Indicating feature and digital display on transmitter</td> </tr> <tr> <td>6.</td> <td>Operating Ambient temperature</td> <td>85 deg C without display. 70 deg C with display.</td> </tr> </tbody> </table>	S No.	Features	Essential/Minimum Requirements	1.	Output	FOUNDATION fieldbus /PROFIBUS PA	2.	Input	Same transmitter shall be capable to handle Pt-100 RTD, Thermocouples –K, R & ,S types	3.	Housing	Weather proof as per IP-67, metallic housing with durable corrosion resistant coating	4.	Electrical connection	½” NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible	5.	Diagnostics display	& Self-Indicating feature and digital display on transmitter	6.	Operating Ambient temperature	85 deg C without display. 70 deg C with display.	
S No.	Features	Essential/Minimum Requirements																					
1.	Output	FOUNDATION fieldbus /PROFIBUS PA																					
2.	Input	Same transmitter shall be capable to handle Pt-100 RTD, Thermocouples –K, R & ,S types																					
3.	Housing	Weather proof as per IP-67, metallic housing with durable corrosion resistant coating																					
4.	Electrical connection	½” NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible																					
5.	Diagnostics display	& Self-Indicating feature and digital display on transmitter																					
6.	Operating Ambient temperature	85 deg C without display. 70 deg C with display.																					
<p align="center">LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2</p>	<p align="center">PART-B SUB-SECTION-III-C2 MEASURING INSTRUMENTS</p>	<p align="center">PAGE 7 OF 8</p>																				

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	7. Mounting 8. Accessories 9. Composite Accuracy	2 inch pipe mounting with Canopy. As required by service and operating condition. (Refer note 2) RTD =<0.25% of 0-250 deg C span T/C-K type =<0.2% of 0-600 deg C span CJC accuracy (for thermocouples) shall be =< 1 deg C Notes: 1. In case of failure (open or burn-out) of RTD/thermocouple, transmitter shall provide low temperature output. 2. Dual input temperature transmitter shall have bump less changeover facility to second sensor in case first sensor fails. This changeover is to be alarmed. 3. Composite accuracy is to be calculated as summation of all applicable accuracies of temperature transmitter for converting sensor input to output (e.g., basic accuracy, digital accuracy, etc.) and temperature effect on these accuracies at ambient temperature of 50 deg C, based on the figure/ formula given in the standard product catalogue for span as specified above for various types of temperature elements specified. All such accuracy/ temperature effect figures in catalogue shall be first converted to deg C, and then percentage of this converted accuracy in specified span shall be calculated to compare with the specified composite accuracy figures. All temperature transmitters shall be interchangeable (i.e. can be used for either RTD or thermocouple) and composite accuracy shall be met for each type of input as specified above. 3. Above mentioned parameters/features of offered models shall be strictly as defined in standard published catalogue of the manufacturer only. 4. Dual input temperature transmitters can also be accepted in place of single input TT.	
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2	PART-B SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 8 OF 8

CLAUSE NO.	TECHNICAL REQUIREMENTS																									
3.02.00	<p>Resistance Temperature Detector (RTD)</p> <table border="1"> <thead> <tr> <th data-bbox="393 260 451 323">Sr. No.</th> <th data-bbox="483 260 786 289">Features</th> <th data-bbox="863 260 1263 289">Essential/Minimum Requirements</th> </tr> </thead> <tbody> <tr> <td data-bbox="393 357 412 386">1</td> <td data-bbox="483 357 786 386">Type of RTD.</td> <td data-bbox="863 357 1263 420">Four wire, Pt-100 (100 Ohms resistance at zero degree Centigrade).</td> </tr> <tr> <td data-bbox="393 453 412 483">2</td> <td data-bbox="483 453 786 483">No. of element</td> <td data-bbox="863 453 1263 483">Duplex</td> </tr> <tr> <td data-bbox="393 516 412 546">3</td> <td data-bbox="483 516 786 546">Housing/Head</td> <td data-bbox="863 516 1263 739">IP-65/Diecast Aluminium. Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable). Plug in connectors are to be provided for external signal cable connection. TE terminal head shall be spring loaded for positive contacts with the thermo well</td> </tr> <tr> <td data-bbox="393 772 412 802">4</td> <td data-bbox="483 772 786 835">Insulation and sheathing of RTD</td> <td data-bbox="863 772 1263 835">Mineral (magnesium oxide) insulation and SS316 sheath,</td> </tr> <tr> <td data-bbox="393 869 412 898">5</td> <td data-bbox="483 869 786 898">Calibration and accuracy</td> <td data-bbox="863 869 1263 932">As per IEC-751/ DIN-43760 Class-A for RTD</td> </tr> <tr> <td data-bbox="393 966 412 995">6</td> <td data-bbox="483 966 786 995">Accessories</td> <td data-bbox="863 966 1263 995">Thermo well and associated fittings</td> </tr> <tr> <td data-bbox="393 1029 412 1058">7</td> <td data-bbox="483 1029 786 1058">Standard</td> <td data-bbox="863 1029 1263 1092">IEC-751/ DIN-43760 for RTD and ASME PTC-19.3 for Thermo-well.</td> </tr> </tbody> </table> <p>NOTES :</p> <ol style="list-style-type: none"> <li data-bbox="393 1188 1364 1306">1) The specifications for RTDs of winding/ bearings of motor/pump, can be as per their manufacturer standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. However the type of RTD shall be Pt100. <li data-bbox="393 1318 1364 1436">2) The specifications of temp elements for air conditioning & ventilation system / process can be as per system manufacturer's standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. 	Sr. No.	Features	Essential/Minimum Requirements	1	Type of RTD.	Four wire, Pt-100 (100 Ohms resistance at zero degree Centigrade).	2	No. of element	Duplex	3	Housing/Head	IP-65/Diecast Aluminium. Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable). Plug in connectors are to be provided for external signal cable connection. TE terminal head shall be spring loaded for positive contacts with the thermo well	4	Insulation and sheathing of RTD	Mineral (magnesium oxide) insulation and SS316 sheath,	5	Calibration and accuracy	As per IEC-751/ DIN-43760 Class-A for RTD	6	Accessories	Thermo well and associated fittings	7	Standard	IEC-751/ DIN-43760 for RTD and ASME PTC-19.3 for Thermo-well.	
Sr. No.	Features	Essential/Minimum Requirements																								
1	Type of RTD.	Four wire, Pt-100 (100 Ohms resistance at zero degree Centigrade).																								
2	No. of element	Duplex																								
3	Housing/Head	IP-65/Diecast Aluminium. Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable). Plug in connectors are to be provided for external signal cable connection. TE terminal head shall be spring loaded for positive contacts with the thermo well																								
4	Insulation and sheathing of RTD	Mineral (magnesium oxide) insulation and SS316 sheath,																								
5	Calibration and accuracy	As per IEC-751/ DIN-43760 Class-A for RTD																								
6	Accessories	Thermo well and associated fittings																								
7	Standard	IEC-751/ DIN-43760 for RTD and ASME PTC-19.3 for Thermo-well.																								
3.03.00	<p>Metal Temperature Thermocouples</p> <table border="1"> <tbody> <tr> <td data-bbox="393 1549 721 1579">Measuring Medium</td> <td data-bbox="737 1549 954 1579">Metal Temperature</td> </tr> <tr> <td data-bbox="393 1612 688 1642">Material of Thermocouple.</td> <td data-bbox="737 1612 1013 1642">Chromel Alumel Type K</td> </tr> <tr> <td data-bbox="393 1675 656 1705">Type of Thermocouple</td> <td data-bbox="737 1675 1263 1705">Duplex with ungrounded separate hot junctions</td> </tr> <tr> <td data-bbox="393 1738 509 1768">Insulation</td> <td data-bbox="737 1738 1175 1768">Mineral Insulation (Magnesium Oxide).</td> </tr> </tbody> </table>	Measuring Medium	Metal Temperature	Material of Thermocouple.	Chromel Alumel Type K	Type of Thermocouple	Duplex with ungrounded separate hot junctions	Insulation	Mineral Insulation (Magnesium Oxide).																	
Measuring Medium	Metal Temperature																									
Material of Thermocouple.	Chromel Alumel Type K																									
Type of Thermocouple	Duplex with ungrounded separate hot junctions																									
Insulation	Mineral Insulation (Magnesium Oxide).																									
<p align="center">LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2</p>	<p align="center">SUB-SECTION-III-C2 MEASURING INSTRUMENTS</p>	<p align="center">PAGE 9 OF 34</p>																							

CLAUSE NO.	TECHNICAL REQUIREMENTS		
3.04.00	<p>Thermocouple wire gauge 16 AWG</p> <p>Protective sheath SS 321</p> <p>Protective sheath dia 8 mm OD</p> <p>Calibration & accuracy As per IEC-584/ ANSI-MC-96.1 (special limits of error) for T/C</p> <p>Mounting accessories 1/2" BSP SS sliding end connector, weld pad, clamps of heat resistant steel SS310. Adjustable gland fitting for connection at the junction box end as per manufacturer's standard.</p> <p>Cold end sealing SS pot seal with colour coded PTFE Insulated flexible tails. Sealing compound- Epoxy resin. Length of PTFE insulated flying leads shall be minimum 750 mm.</p> <p>Minimum bending radius 30 mm</p> <p>Length of T/C On as required basis considering location of measurement point and the JB/TTJB location.</p> <p>Notes :</p> <p>1) The specification for thermocouples of bearings metal temp measurements can be as per their manufacturer standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. However type of thermocouples shall be K-type.</p> <p>Thermo well (for all process temp. elements)</p> <p>(a) Shall be one piece solid bored type of 316 SS of step-less tapered design. (As per ASME PTC 19.3, 1974)</p> <p>(b) For Mill classifier outlet long life solid sintered tungsten carbide material of high abrasion resistance shall be provided.</p> <p>(c) For Air & Flue gas 316 SS protecting tube with welded cap. (However contractor shall provide better material for Flue gas service if required based on the specified boiler design parameters).</p> <p>(d) For furnace zone, impervious ceramic protecting tube of suitable material along with Incoloy supporting tubes and adjustable flanges.</p>		
<p align="center">LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2</p>	<p align="center">SUB-SECTION-III-C2 MEASURING INSTRUMENTS</p>	<p align="center">PAGE 10 OF 34</p>

CLAUSE NO.

TECHNICAL REQUIREMENTS



4.00.00

SPECIFICATIONS FOR PR. GAUGE, D.P. GAUGE, TEMP. GAUGE AND LEVEL GAUGE.


SI. No	FEATURES	ESSENTIAL/MINIMUM REQUIREMENTS		
		Pr. Gauge/ DP Gauge/ Draught gauges	Temperature Gauge	Level Gauge
1	Sensing Element	Bourdon for high pressure, Diaphragm/ Bellow for low pr.	Inert gas actuated/ Liquid other than mercury	Tempered * toughened Borosilicate gauge glass steel armoured reflex or transparent type.
2	Material of sensing element	SS 316	SS 316	
3	Material of movement	SS 304	SS 304	
4	Body material	Die-cast aluminium	Die-cast aluminium	Forged carbon steel/304 SS
5	Dial size	150mm	150 mm	Tubular covering entire range
6	End connection	1/2 inch NPT (M)	1/2 inch or 3/4 inch NPT (M).	Process connection as per ASME PTC and drain/vent 15 NB


LOT-IA PROJECTS
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE


TECHNICAL SPECIFICATION
SECTION-VI, PART-B
BID DOCUMENT NO.: CS-0011-109(1)-2

SUB-SECTION-III-C2
MEASURING
INSTRUMENTS

PAGE 12 OF 34

CLAUSE NO.	TECHNICAL REQUIREMENTS				
7	Accuracy	±1% of span	± 1% of span	± 2%	
8	Scale	Linear, 270° arc graduated in metric units	Linear, 270° arc graduated in °C	Linear vertical	
9	Range selection	Shall cover 125% of max. operating press	Shall cover 125% of max. operating temp	Shall cover max. Operating level.	
10	Over range	125% of FSD	125% of FSD	-	
11	Housing	Weather and dust proof as per IP-55	Weather and dust proof as per IP-55	CS/304 SS leak proof	
12	Zero/span adjustment	Provided	Provided	--	
13	Identification	Engraved with service legend or laminated phenolic name plate			
14	Accessories	Blow out disc, siphon, snubber, pulsation dampener, chemical seal (if required by process) gauge isolation valve	SS Thermowell	Gasket for all KEL-F shield for transparent type vent and drain valves of Steel/SS as per CS/Alloy process Requirement.	
Notes:-					
*Bicolour type level gauges will be provided for applications involving steam and water except for condensate and feed water services.					
Length of gauge glass shall not be more than 1400 mm. If the vessel is higher, multiple gauge glasses with 50 mm overlapping shall be provided.					
Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application.					
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 13 OF 34	

CLAUSE NO.	TECHNICAL REQUIREMENTS				
5.00.00	PROCESS ACTUATED SWITCHES				
	FEATURES	ESSENTIAL / MINIMUM REQUIREMENTS			
		Pressure/ Draft Switches/ DP Switches	Temperature switches	Level switches	
	Sensing Element	Piston actuated for high pressure and diaphragm or bellows for low pr/ vacuum	Vapor pressure sensing, liquid filled bellow type with SS bulb and capillary (5 m minimum, to suit application)	Capacitance types, float type, conductivity type, RF type, Ultrasonic type as per suitability to the application. .	
	Material	316 SS	Bulb 316 SS/ capillary 304 SS	316 SS	
	End connection	½ inch NPT (F)	½ inch NPT (F)	Manufacturer standard	
	Over range/ proof pressure	150% of maximum operating pr.	-	150% of maximum operating pr.	
	Repeatability	+/- 0.5% of full range			
	No. of contacts	2 No.+2NC. SPDT snap action dry contact			
	Rating of contacts	60 V DC, 6 VA (or more if required by DDCMIS)			
	Elect. Connection	Plug in socket.			
	Set point adjustment	Provided over full range.			
	Dead band adjustment	Adjustable/ fixed as per requirement of application.			
	Enclosure	Weather and dust proof as per IP-55, metallic housing.			
	Accessories	Siphon, snubber, chemical seal, pulsation dampeners as required by process	Thermo well of 316 SS and packing glands	All mounting accessories	
	Mounting	Suitable for enclosure/ rack mounting or direct mounting	Suitable for rack mounting or direct mounting	-	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 14 OF 34		

CLAUSE NO.	TECHNICAL REQUIREMENTS					
	<table border="1"> <tr> <td data-bbox="380 197 581 310">Power Supply (wherever required)</td> <td data-bbox="586 197 1247 310">As per Contractor's Standard practice.</td> </tr> <tr> <td colspan="2" data-bbox="380 317 1247 821"> <p>Notes :-</p> <ol style="list-style-type: none"> 1) Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application. 2) Pressure/ Diff pressure switches for very low press/ DP measurements can have sensor material other than SS316 in case of any technical limitation and the offered product is standard product of the manufacture for very low pressure applications. 3) Repeatability can be upto +/-1% of full range in case of switches with diaphragm seals or very low pressure/DP range. 4) The specifications of switches for air conditioning & ventilation system / process can be as per system manufacturer's standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. </td> </tr> </table>	Power Supply (wherever required)	As per Contractor's Standard practice.	<p>Notes :-</p> <ol style="list-style-type: none"> 1) Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application. 2) Pressure/ Diff pressure switches for very low press/ DP measurements can have sensor material other than SS316 in case of any technical limitation and the offered product is standard product of the manufacture for very low pressure applications. 3) Repeatability can be upto +/-1% of full range in case of switches with diaphragm seals or very low pressure/DP range. 4) The specifications of switches for air conditioning & ventilation system / process can be as per system manufacturer's standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. 		
Power Supply (wherever required)	As per Contractor's Standard practice.					
<p>Notes :-</p> <ol style="list-style-type: none"> 1) Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application. 2) Pressure/ Diff pressure switches for very low press/ DP measurements can have sensor material other than SS316 in case of any technical limitation and the offered product is standard product of the manufacture for very low pressure applications. 3) Repeatability can be upto +/-1% of full range in case of switches with diaphragm seals or very low pressure/DP range. 4) The specifications of switches for air conditioning & ventilation system / process can be as per system manufacturer's standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. 						
6.00.00	<p>SOLENOID VALVES</p> <p>Solenoid valves shall fulfill the following requirements: -</p> <ol style="list-style-type: none"> a) Type 2/3/4 way SS 316/ forged brass (depending on the application subject to Employer's approval during detailed engg.) b) Power supply 24V DC. c) Plug in connector connection. d) Insulation : Class "H" 					
7.00.00	<p>Limit switches</p> <ol style="list-style-type: none"> e) Limit switches shall be silver plated with high conductivity and non-corrosive type. Contact rating shall be sufficient to meet the requirement of Fire alarm Control System subject to a minimum of 60V, 6VA rating. Protection class shall be IP-55. 					
<p>LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2</p>	<p>SUB-SECTION-III-C2 MEASURING INSTRUMENTS</p>	<p>PAGE 15 OF 34</p>			

HUMIDITY SENSOR

Sensor : Capacitance type

Accuracy : +/-3% R.H

Range : 0-100% R.H

Output : 4-20 ma

Time constant : 2 mins.

Output from the sensor is to be connected to respective control system. Contractor can also provide combined instrument for measurement of humidity and temperature subject to Employer's approval during detailed engineering. In all such cases, 4-20 ma outputs, each for temperature and humidity measurements are to be provided.

TEMPERATURE / HUMIDITY INDICATOR

Sensor : RTD for(Pt 100) for temperature

: Capacitance Type for Humidity (specs for humidity and temperature shall be as mentioned above)

Display : Combined enclosure with two three digit seven segments LED display with decimal point after two digits. LED height shall be 4 inches, clearly legible from a distance of at least 10 meters.

Range : 0-60 Deg C for temperature.

: 0-95.0 % for Relative Humidity.

Accuracy : Better than +/-0.5 % for Temperature


: Better than +/-2.5 % for Relative Humidity


Mounting : Table Top/ wall mounting.

Power supply : 240 V AC, 50 Hz.

Output : 4-20 mA signal each for temperature.

One Set of output signal is to be connected to respective control system. Apart from displaying the temperature/humidity values on indicator.

CLAUSE NO.	TECHNICAL REQUIREMENTS		
<p>1.00.00</p> <p>1.01.00</p> <p>1.02.00</p> <p>1.02.01</p> <p>1.02.02</p>	<p>GENERAL:</p> <p>Actuators shall be designed for valve operation to ensure proper function in accordance with specifications given below and complying to EN15714-2 or equivalent. All standards, specifications and codes of practice referred to herein shall be the latest editions including all applicable official amendments and revisions.</p> <p>This sub-section of specification is applicable for following types of electric actuators:</p> <p>Modulating duty electric actuators:</p> <p>These shall be provided as per standard practice of OEM of equipment, meeting other requirements of specifications. For specifications of Blade pitch actuators, refer clause no. 5.00.00 of this chapter.</p> <p>Electric actuators for valves/ dampers/ gates (other than covered in 1.02.01):</p> <p>These actuators shall be Non-Intrusive type electric actuators. The interface of these actuators with DDCMIS shall be of two types viz. with Hardwired interface and with Fieldbus interface. The common requirements of both these type of actuators are specified at clause 2.00.00, specific requirements of Non-Intrusive hardwired actuators are specified at clause 3.00.00 and specific requirements of Non-Intrusive fieldbus actuators are specified at clause 4.00.00. The applications where these two types of actuators are to be provided is specified in Part-A of Technical Specifications.</p>		
<p>2.00.00</p> <p>2.01.00</p> <p>2.01.01</p> <p>2.01.02</p> <p>2.02.00</p> <p>2.03.00</p>	<p>COMMON REQUIREMENTS FOR NON INTRUSIVE ELECTRIC ACTUATORS</p> <p>TYPE:</p> <p>The actuators shall have integral starters with built in SPP (Single Phasing Preventer). 415 V, 3 phase 3 wire power supply shall be given to the actuator from switch board as applicable through a switch fuse unit. Control voltage of the motor starter shall be 110 V AC / 24 V DC, derived suitably from 415V power supply.</p> <p>The actuators shall be Non- Intrusive electric actuator. All actuator settings including torque, limit shall be possible without opening the actuator cover and LCD indication shall be available integral to actuator body.</p> <p>RATING:</p> <p>(a) Supply Voltage & frequency: 415V +/- 10%, 3 Phase, 3 Wire & 50HZ +/-5%.</p> <p>(b) Sizing:</p> <p>Open/Close at rated speed against designed differential pressure at 90% of rated voltage.</p> <p>For ON/OFF type: Three successive open-close operations or 15 minutes, whichever is higher.</p> <p>For inching type: 150 starts per hour or required cycles, whichever is higher.</p> <p>CONSTRUCTION:</p> <p>(a) Enclosure:</p> <p>Totally enclosed weatherproof, minimum IP-68 degree of protection.</p> <p>(b) Manual Wheel:</p> <p>Shall disengage automatically during motor operation.</p>		
<p>LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-IIIC-8 ELECTRIC ACTUATORS</p>	<p>PAGE 1 OF 4</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS			
2.04.00	<p>MOTOR:</p> <p>(a) Type : Squirrel cage induction motor suitable for Direct On Line (DOL)starting.</p> <p>(b) Enclosure: Totally enclosed, self-ventilated.</p> <p>(c) Insulation Class F. Temperature rise 70 Deg C. over 50 Deg C ambient.</p> <p>(d) Bearings: Double shielded, grease lubricated antifricition.</p> <p>(e) Earth Terminals: Two</p> <p>(f) Protection: Single Phasing Protection, Over heating protection through Thermostat (as applicable) and wrong phase sequence protection shall be provided over and above other protection features standard to bidder's design. Suitable means shall be provided to diagnose the type of fault locally.</p>			
2.05.00	<p>POSITION/TORQUE TRANSMITTER:</p> <p>The Position/ Limit measurement shall be done using absolute encoders which will give information of position/ limit in both the directions. Electronic measurement of torque shall be provided.</p>			
2.06.00	<p>LOCAL OPERATION:</p> <p>It shall be possible to operate the actuator locally also. Lockable local/remote selection shall be provided on the actuator.</p>			
2.07.00	<p>LCD DISPLAY:</p> <p>A local LCD display shall be provided to give information regarding actuator alarms, status and valve position indications as a minimum in local.</p>			
2.08.00	<p>WIRING:</p> <p>Suitable voltage grade copper wire.</p>			
2.09.00	<p>TERMINAL BLOCK:</p> <p>For power cables, the grade of TBs shall be minimum 650V.</p>			
2.10.00	<p>ACCESSORIES:</p> <p>All required accessories (if applicable) for calibration / settings/ configuration of various parameters of actuator shall be provided. For quantities, please refer Part A of technical specifications.</p>			
<p>LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-IIIC-8 ELECTRIC ACTUATORS</p>	<p>PAGE 2 OF 4</p>	

TECHNICAL REQUIREMENTS



2.11.00	<p>SIL CERTIFICATION: All actuators shall be certified for SIL 2 or better.</p>		
3.00.00	<p>SPECIFIC REQUIREMENTS FOR NON INTRUSIVE HARDWIRED ACTUATORS</p>		
3.01.00	<p>INTERFACES: For ON-OFF and INCHING type actuators interface with the control system shall be through hardwired signal only.</p> <ul style="list-style-type: none"> (a) Open/Close command, open/ close status and disturbance monitoring signal (common contact for Overload, Thermostat, control supply failure, L/R selector switch at local & other protections operated) shall be provided hardwired. (b) The actuator shall be able to accept open/close command at 24V DC with max. 2.5VA load from control system. Accordingly suitable isolated interface in the actuator shall be provided. (c) Open/close command termination logic shall be suitably built inside actuator. (d) For typical wiring diagram Refer Tender Drawing No. 0000-999-POI-A-063 (Except plug & socket connector, if not applicable) 		
3.02.00	<p>TERMINAL BOX: Suitable terminals/ connectors, integral to actuator, for terminating instrumentation & power cables shall be provided. Necessary glands for power cables and instrumentation cables shall be provided.</p>		
4.00.00	<p>SPECIFIC REQUIREMENTS FOR NON INTRUSIVE FIELDBUS ACTUATORS</p>		
4.01.00	<p>INTERFACES: For ON-OFF and INCHING type actuators interface with the control system shall be through fieldbus network.</p> <ul style="list-style-type: none"> (a) Open/ close commands, open/ close feedback status, disturbance signal etc. shall be available to the Control System through the fieldbus network along with diagnostics. The detailed diagnostics including the actuator operating data shall be available to the DDCMIS through the fieldbus network. (b) All actuators shall be Foundation Fieldbus/ Profibus compatible. However the exact protocol shall be based on finalized protocol of DDCMIS. If Profibus DP protocol is envisaged then actuator shall have two (redundant) Profibus DP ports for connecting the redundant Profibus DP cables. That is if one profibus cable is cut or not working/ not available, then complete actuator functionality shall be available through the second redundant cable without any manual intervention. (c) Open/close command termination logic shall be suitably built inside actuator. 		
<p>LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-IIIC-8 ELECTRIC ACTUATORS</p>	<p>PAGE 3 OF 4</p>

TECHNICAL REQUIREMENTS



4.02.00

TERMINAL BOX:

Suitable terminals/ connectors, integral to actuator, for terminating fieldbus cables and power cables shall be provided. Necessary glands for power cables and armored fieldbus cables shall be provided.



VFD

VARIABLE FREQUENCY DRIVES

Electrical Annexure-2

Variable Frequency Drive (VFD)

1.00.00

GENERAL

The Design, manufacture, erection, testing and performance of items and services provided under this specification shall comply with the latest edition including all applicable official amendments and revisions as on date of award of the following standards. In case of conflict between this specification and code (IS Code, standards, etc.) referred herein, the former shall prevail. All work shall be carried out as per the following codes and standards.

2.00.00

CODES AND STANDARDS

HT breaker	IEC:60056
DC reactor	IEC 60289
Transformers	IS:2026, IEC: 60076 IEC 61378
Bushing	IS: 2099, IEC 60137
Adjustable Speed Electrical Power Drive Systems	IEC 61800
Semiconductor converters–General requirements	IEC 60146
IEEE Recommended practices and requirements for harmonic control in electrical power systems	IEEE 519
Degrees of protection provided by enclosures (IP Code)	IEC 60529
Electrostatic immunity test	IEC1000-4-2
Fast transient immunity test	IEC1000-4-4
Surge immunity test	IEC1000-4-5
High-voltage switchgear and controlgear; Pt.102: Alternating current disconnectors and earthing switches	IEC 62271-102
High-voltage switchgear and controlgear; Pt.200: AC metal-enclosed switchgear and controlgear for rated voltages above 1 kV and up to and including 52 KV	IS/IEC: 62271-200
AC electricity meters	IS: 722
Metal oxide surge arrestor without gap for AC system	IEC: 60099-4
Terminal blocks for copper conductors	IEC: 60947-7-1
Dry transformer	IS: 11171
Motor	IEC 60034-18-41 &42, IEC60034 / NEMA 30 & 31,
Contactors/Switches/Fuses etc.	IEC:60947, IS: 13947
Harmonics & EM compatibility	IEEE:519/IEC: 61000
VFD	IEC:60034/ IEC: 61800

Equipment complying with other internationally accepted standards will also be considered if they ensure performance and constructional features equivalent or superior to standards listed above. In such a case, the Bidder shall clearly indicate

VARIABLE FREQUENCY DRIVES

the standard(s) adopted, furnish a copy in English of the latest revision amendments and revision in force as on date of opening of bid and shall clearly bring out the salient features for comparison.

3.00.00

OPERATING CONDITIONS

3.01.00

For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and also relative humidity of 95% at 40 deg. Celsius shall be considered.

3.02.00

All equipment shall be suitable for rated frequency of 50 Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.

3.03.00

The auxiliary AC voltage supply arrangement shall have 11/6.6/3.3kV and 415V systems (as applicable). It shall be designed to limit voltage variations as given below under worst operating condition:

1. 11kV/ 3.3 kV/ 6.6 KV : +/- 6%
2. 415V : +/- 10%

Note: The Voltage level mentioned above is the Nominal Voltage available at the input of the VFD System from the MCC/ Switchgear/transformer, based on the system requirement/Availability.

The voltage level for the VFD output to be fed to motor shall be as follows:-

1. Upto 400 kW : 415V/690V, Low Voltage, Three Phase AC
2. Above 400kW and upto 700 KW : 690V, Low Voltage, Three Phase AC
3. Above 700KW : Medium Voltage

From here onwards in the specifications all the VFD Systems consisting of either 415 V or 690 V may be termed as LV VFD while the higher rated VFD System shall be termed as MV VFD. If nothing is mentioned than the Clause is applicable for both the LV and the MV VFD until deliberated otherwise.

4.00.00

SYSTEM DESCRIPTION

Type of drive : 3-Phase Diode / Thyristor / Multi Stage IGBT / IGCT / SGCT/ IEGT

5.00.00

Type of Cooling of VFD : Naturally air cooled/forced air cooled/Liquid cooled

Converter Type : Full wave diode rectifier/active front end type

Inverter Type : Thyristor/IGBT/IGCT/SGCT/IEGT

GENERAL REQUIREMENTS

5.01.00

Medium Voltage VFD: The Variable frequency drive (VFD) system shall be of a modern proven design for similar applications in power plants/industry. The system

VARIABLE FREQUENCY DRIVES

	<p>shall be either Current Source Inverter (CSI) or Voltage Source Inverter (VSI) type with minimum eighteen (18) pulse design.</p>
5.02.00	<p>415 V/690 V LV VFD: The Variable frequency drive (VFD) system shall be of a modern proven design for similar applications in power plants/industry. The system shall be either Current Source Inverter (CSI) or Voltage Source Inverter (VSI) type with minimum Twelve (12) pulse design. For drives less than 100 KW Six (6) pulse can be offered meeting all other requirements.</p>
5.03.00	<p>The system shall be fully digital, PLC/Microprocessor based, energy efficient, and shall provide very high reliability, high power factor, low harmonic distortion and low vibration and wear and noise. It shall be easy to install in minimum time and expense and no special tools shall be required for routine maintenance.</p>
5.04.00	<p>The offered equipment shall be with state of art technology and proven field track record. No prototype equipment shall be offered.</p>
5.05.00	<p>The VFD manufacturer shall ensure the proper coordination of their VFD with the Driven Motor and the supply system. All the Motors which are to be driven by VFDs will be of Inverter duty type. Also these motors shall comply the requirements stipulated in IEC: 60034-18-41 and IEC: 60034-18-42 as applicable. The VFD operation shall have no inherent detrimental impact on the Motors/ cables & supply system.</p>
6.00.00	<p>TECHNICAL AND OPERATIONAL REQUIREMENTS</p>
6.01.00	<p>The system shall be designed to deliver the motor input current and torque for the complete speed torque characteristics of the driven equipment, with worst input supply voltage and frequency variation. The system shall be suitable for the load characteristics and the operational duty of the driven equipment.</p>
6.02.00	<p>The overload capacity of the controller shall be 150% of the rated current of the motor for one minute for constant torque applications and 110% of rated current for one minute for variable torque applications at rated voltage. If the motor load exceeds the limit, the drive shall automatically reduce the frequency and voltage to the motor to guard against overload.</p>
6.03.00	<p>The drive system shall be designed to operate in one or more of the following operating modes as to suit characteristics of the driven equipment or specified by the load:</p> <ul style="list-style-type: none"> a. Variable torque changing as a function of speed. b. Constant torque over a specific speed range. c. Constant power over a specific speed range. d. Any other as specified in data-sheet
6.04.00	<p>VFDs shall comply with the latest edition of IEEE 519 & IEC 61000 for both individual as well as total harmonic voltage and current distortion limits. The Voltage and Current limits shall be applicable at the Point of Common Coupling (PCC), which shall be the MCC/ Switchgear/ from which the VFD system is fed.</p>

VARIABLE FREQUENCY DRIVES

6.05.00	The above compliance shall be verified by the field measurements of harmonics at the PCC with and without VFDs operation.
6.06.00	VFD shall be capable of withstanding the thermal and dynamic stresses and the transient mechanical torque, resulting from short circuit. Any damage resulting from such a short circuit or internal fault shall be limited to the component concerned.
6.07.00	The system shall be suitable to maintain speed variation within range 10-110% or as per the requirement of driven equipment with speed set accuracy of +1% of rated maximum speed and steady state regulation of +0.5% of rated speed as per system requirement.
6.08.00	The VFD System shall maintain a power factor of 0.95 (minimum) (for LV VFD system) and 0.9 (minimum) (for MV VFD system) in the entire operating range.
6.09.00	Maximum allowable audible noise from the VFD system will be 85 dB (A) at a distance of one meter under rated loaded with all cooling fan operating conditions.
6.10.00	All the circuit components shall be suitably protected against over voltages, surges, lightning etc.
6.11.00	The panels shall be designed to provide easy access to hardware, to facilitate replacement of cards in case of any failure.
6.12.00	All the VFDs for particular application shall be of same design so as to ensure 100 % interchangeability of components.
6.13.00	For each programmed warning and fault protection function, the VFD shall display a message in complete English words or Standard English abbreviations. At least 30 time tagged fault messages shall be stored in the drive's fault history.
6.14.00	The VFD cubicles shall be placed in air conditioned environment. However if VFDs of less than 100 kW are designed to operate in non-air condition environment the same shall also be acceptable.
6.15.00	The 3-Phase Thyristor/IGCT/SGCT/ multistage IGBT/IEGT based VFD system shall have minimum number of components to ensure very high reliability. The input side converter shall have 3-Phase Diode/Thyristor bridge configuration modular type and inverter shall be of 3-Phase Thyristor/IGCT/SGCT/multi stage IGBT/IEGT type, using Pulse Width Modulation or better technique for generating near sine wave output to motor.
6.16.00	Fiber optic cable connection shall be provided preferably to ensure high network reliability.
7.00.00	VFD COMPATIBILITY WITH THE MOTOR
7.01.00	MV VFD output current waveform, as measured at the motor, shall be inherently sinusoidal at nominal loads, with a total harmonic current and voltage distortion within acceptable/standard limits. VFD with transformers on output side are not acceptable.

VARIABLE FREQUENCY DRIVES

7.02.00	The system design shall not have any inherent output harmonic resonance in the operating speed range.
7.03.00	VFD shall provide stable operation of motor from high-voltage dv/dt stress, regardless of cable length to motor. The vendor shall clearly state the limitations in the motor cable distance in his proposal. However, due to system requirements & constraints if the cable length becomes critical, filters/ chokes etc. shall be provided by the VFD manufacturers as an integral part of the VFD to mitigate the reflected wave effect of harmonics.
8.00.00	BYPASS ARRANGEMENT TO BE PROVIDED BY BIDDER IF REQUIRED DURING DETAIL ENGINEERING
8.01.00	The VFD System shall have an optional feature to run the motor under bypass arrangement for operation of Motor with VFD bypassed. During starting (under rated conditions) the motor will be switched on in VFD Mode to limit the starting current and after gaining speed, the load would be switched over to bypass mode.
8.02.00	Comprehensive motor protection scheme for protection and control for operation VFD during bypass mode shall be finalized during detailed engineering.
9.00.00	STANDBY VFD ARRANGEMENT (OPTIONAL, IF SPECIFIED)
9.01.00	A Common standby arrangement with auto/manual switchover shall be provided in case of failure of any VFD in a group of drives. Complete protection, interlocks & control required shall be provided in the changeover module.
10.00.00	EFFICIENCY
10.01.00	Efficiency (Drive only) shall be minimum 98% for both MV VFD and LV VFD. Overall efficiency shall be minimum 96.5% for LV VFD and minimum 94 % for MV VFD at rated load and speed. Overall Efficiency evaluation shall include input transformer, harmonic filters and power factor correction (if applicable), VFD converters, cooling fans and output filter, as applicable in the system. Auxiliary controls, such as internal VFD control boards, cooling fans/pumps.
10.02.00	In absence of valid test report, a factory test shall be performed at the VFD manufacturer's facility verifying the efficiencies. Manufactures who are supplying Drive and transformer from different locations, efficiency test will be conducted separately for Drive and transformer.
11.00.00	COOLING SYSTEM
11.01.00	The VFD shall be designed to operate indoor under temperature range of 0 deg C to 50 deg C and relative humidity of 95 % (at 40 deg C).
11.02.00	VFD manufacturer to primarily offer Air cooled Design. However in case of large ratings, liquid cooled drives may be accepted subject to employer's approval. In case of liquid cooled system, there shall be no necessity of continuous water supply system (Closed Loop System).
11.03.00	In case of Air cooled design, the VFD Cooling system shall be such that it puts minimum heat load inside the room and preferably throw the hot air outside the room with ventilation ducts. The Cooling system shall be designed in such a way that the Air Conditioning & Ventilation Air requirements are kept to minimum. The VFD

VARIABLE FREQUENCY DRIVES

	Manufacturer shall furnish the data regarding heat load, air flow requirements during the detailed engineering.	
11.04.00	Air cooled VFDs shall be provided with cooling fans mounted integral to the VFD/ enclosure. The VFD shall include air-flow pressure switches and temperature detectors to monitor proper operation of the air cooling system. If the fan fails, the system must generate the alarm/trip for the fan failure.	
12.00.00	TRANSFORMER:	
12.01.00	Type: Outdoor Mineral oil filled ONAN type or Indoor natural air-cooled Dry type, Three phase unit, rectifier/converter duty type transformer.	
12.02.00	All other components, technical parameters shall be as per applicable IEC/IS.	
12.03.00	Enclosure for Dry Type Transformer (as applicable)	
	Enclosure shall be of a tested quality sheet steel of minimum thickness 2 mm & shall also accommodate cable terminations. The housing door shall be interlocked such that it should be possible to open the door only when transformer is off. The enclosure shall be provided with lifting lugs and other hardware for floor mounting.	
12.04.00	Core	Shall be High grade non-ageing cold rolled grain oriented silicon steel Laminations.
12.05.00	Winding conductor	Shall be electrolytic grade copper. Windings shall be of class F insulation.
12.06.00	Winding temperature Indicator (WTI)	Shall be Platinum resistance type temperature detector in each limb.
12.07.00	Thermistors	Shall be embedded in each limb with alarm and trip contacts for remote annunciation.
12.08.00	Temperature rise:	Winding temperature rise shall be as per applicable IEC.
13.00.00	POWER CONVERTER:	
13.01.00	The static power converter shall consist of a line side converter for operation as a rectifier and a load side power converter for operation as a fully controller inverter. Power converter shall be fast switching, most efficient and low loss type.	
13.02.00	The converter shall be coordinated with the transformers. The converter shall be able to withstand a three phase short circuit current until interrupted by normal breaker operation.	
13.03.00	Adequate short circuit and over voltage protection shall be provided for the converter and inverter system.	
13.04.00	All power converter devices shall include protective devices, snubber networks and dv/dt networks as required.	
13.05.00	The current rating of the converter's semi-conductor components shall not be less than 120% of the nominal current flowing through the elements at full load of the VFD	

VARIABLE FREQUENCY DRIVES

	through the whole speed range. If the parallel connection of semiconductor is applied, the above current rating shall not be less than 140% of the above values.
13.06.00	All power diodes shall be of silicon type with minimum VBO rating at 2.5 times the rated operating voltage.
13.07.00	The power converter circuit shall be designed so that motor can be powered at its full nameplate rating continuously without exceeding its rated temperature rise nor reducing its service factor due to harmonic currents generated by the inverter operation. The conversion devices and associated heat sinks shall be assembled such that individual devices can be replaced without requiring the use of any special precautions / tools.
13.08.00	The cooling system of the electronic components, if provided, shall be monitored and necessary alarms shall be provided to prevent any consequential damage to the power control devices.
14.00.00	OUTPUT FILTER (AS APPLICABLE):
14.01.00	Output/ dv/dt filter shall be provided, if required. It shall be an integral part of the VFD system and included within the VFD enclosure. It shall inherently protect motor from high voltage dv/dt stress.
15.00.00	DC LINK CAPACITOR (AS APPLICABLE):
15.01.00	Capacitor shall be of self-healing film or electrolytic type having high life time. The capacitor shall be an integral part of VFD system. DC link Capacitors shall have discharge resistors which shall be capable of reducing the residual charges to zero just after the capacitor is disconnected from the supply source. The capacitor shall be suitable for high ripple currents.
16.00.00	AC/DC Reactor (As applicable)
	<ol style="list-style-type: none"> 1) Type: Dry type, air cored, self cooled, indoor type. Suitable for withstanding earth fault continuously. 2) Insulation: Thermal Class 155(F), temperature rise is limited to thermal class 130 (B). 3) Noise level shall not exceed value specified in NEMA TR-1.
17.00.00	VFD PANEL REQUIREMENTS
17.01.00	Enclosure frames and load bearing members shall be fabricated using suitable mild steel structural sections or pressed and shaped cold-rolled sheet steel of thickness 2.0 mm. Frames shall be enclosed in cold-rolled sheet steel of thickness 1.6 mm. Doors and covers shall also be of cold rolled sheet steel of thickness 1.6 mm. Stiffeners shall be provided wherever necessary. The gland plate thickness shall be 3.0 mm for hot / cold-rolled sheet steel and 4.0 mm for non-magnetic material. In case dry type transformer is provided inside VFD panels, the enclosure and in its frame thickness shall be same as indicated in this para.
17.02.00	The cable entry shall be from the bottom of the panel and a removable bolted un-drilled gland plate.
17.03.00	All Panels shall be of dust-proof and vermin-proof construction and shall be provided with a degree of protection of IP: 3X or better for MV VFD and IP: 4X or better for LV VFD as per IS/IEC 60947

VARIABLE FREQUENCY DRIVES

17.04.00	Enclosures must be designed to avoid harmonic and inductive heating effects and to shield any outside equipment from interference, enclosing and shielding the complete to eliminate any radio frequency interference. The construction of the panel shall provide effective protection against electromagnetic emissions.
17.05.00	Each panel shall be provided with illuminating lamp, space heater with switch fuse and variable setting thermostat.
17.06.00	Proper ventilation using air filters and fans/pumps shall be provided in the panels to ensure that maximum temperature inside the cubicle is within permissible limits for reliable and continuous operation of the system.
18.00.00	<p>PAINTING</p> <p>Paint shade shall be as follows</p> <ul style="list-style-type: none"> a) VFD transformer : RAL 5012 (Blue), legend in black letter reactor enclosure b) Motors : RAL 5012 (Blue) c) VFD Panels : Front and rear panels in Grey (RAL9002). End panel sides in blue (RAL 5012)
19.00.00	HT SWITCHGEAR
19.01.00	The technical requirements of HT switchgear shall be as per chapter of HT switchgear in Part-B of Technical specifications.
20.00.00	MOTORS
20.01.00	VFD shall be used to drive three (3) phase squirrel cage inverter duty Induction motor with VPI insulation (Resin poor) suitable for VFD application. These motors shall be provided with insulated bearing on at least one side.
20.02.00	Motors shall also meet the requirements mentioned in subsection for motors and relevant IS/IEC.
20.03.00	Motor shall be suitable for operation with a solid state power supply consisting of an adjustable frequency inverter for speed control & shall be suitable for the current waveforms produced by the power supply including the harmonics generated by the drive.
20.04.00	Motor insulation shall be designed to accept the applied voltage waveform, within the Vpeak and dv/dt limits as per IEC-61800.
20.05.00	Drive manufacturer shall coordinate with the motor manufacturer for proper selection of the motor for the given load application and the output characteristics of the drive.
20.06.00	Other requirements of motor shall be as stipulated in technical chapter of Motors in Part-B of technical specifications.
21.00.00	LT & HT CABLES
21.01.00	Contractor's scope shall also include LT and HT cables suitable for VFD system and Motors.
22.00.00	CONTROL AND PERFORMANCE REQUIREMENTS

VARIABLE FREQUENCY DRIVES

22.01.00	The VFD to provide an automatic current limiting feature to control motor currents during startup and provide a "soft start" torque profile for the motor load combination. Current and torque limit adjustments shall be provided to limit the maximum VFD output current and the maximum torque produced by the motor.
22.02.00	It shall be possible to vary the speed of the drive and control it in either Local or Remote mode. Local / Remote selection shall be done from VFD panel unless otherwise specified.
22.03.00	<p>Provision shall be kept for exchange of information between different VFD control system parameters thru PLC/DDCMIS.</p> <p>Man machine interface for (MV) VFD shall have one flat TFT monitor with keyboard (password protected) in the VFD room and a color laser printer for system alarm and monitoring located in control room.</p> <p>Parameter Monitoring:</p> <ul style="list-style-type: none"> - Input and output voltage of Drive - Input and output current of Drive - Motor speed - Input and output power frequency of Drive - Torque - Input and Output power of Drive system (covering transformer if applicable) - Output kWhr of Drive - Transformer (if applicable) temperature for alarm & trip. - Ambient temperature - Run/stop and local/remote status displayed
22.04.00	Drive shall be equipped with a front mounted operator console panel consisting of a backlit alphanumeric display and a keypad with keys for parameterization and adjusting parameter. Control panel shall be operable with password for changing the protection setting, safety interlock etc.
22.05.00	Operator console/Main Control Card shall have facility / port to connect external hardware such as Lap-Top etc. Console shall have facility for upload and download of all parameter settings from one drive to another drive for start up and operation.
22.06.00	User-friendly licensed software for operation and fault diagnostic shall be loaded in the drive system panel before commissioning.
23.00.00	PROTECTION FEATURES
23.01.00	<p>The system offered shall incorporate adequate protection features as per IEC 61800-4: 2002 Table-8, properly coordinated for the drive control and for motor including following:</p> <ul style="list-style-type: none"> i) Converter transformer: short circuit, over current, earth fault & winding temperature high protection. ii) Incoming and outgoing line surge protection. iii) Under / over voltage protection iv) Phase loss, phase reversal, overload, negative phase sequence, locked rotor protection.

VARIABLE FREQUENCY DRIVES

	<ul style="list-style-type: none"> v) Instantaneous Over current & Earth fault protection vi) Converter/Inverter module failure indication. vii) Over frequency/speed protection. viii) Ventilation failure indication & alarm. ix) Over temperature of VFD x) Bearing temperature protection. xi) System earth fault protection. xii) Speed reference loss protection.
23.02.00	Under VFD Bypass Mode (if applicable) all the electrical protections related to the Motor shall remain applicable.
24.00.00	CONTROL FEATURES
24.01.00	<p>Following controls shall be provided as a part of the Operator Control Panel or through separate switches on the front panel door.</p> <ul style="list-style-type: none"> i) Start / stop (in local/remote mode) ii) Speed control (Raise / lower) iii) Acknowledge/Accept/ Test Push Button for annunciation iv) Auto / Manual / Test Mode select v) Emergency stop vi) Trip-Remote Breaker
25.00.00	DIAGNOSTIC FEATURES
25.01.00	The VFD shall include a microprocessor/PLC based digital diagnostic system which monitors its own control functions and displays faults and operating conditions.
25.02.00	Fault diagnostic shall be built into the system to supervise the operation and failure of the system. The information regarding failure of any of the system including shut down of the system shall be available. It shall be possible to retrieve the record of events prior to tripping of the system or de-energization. Auxiliary supply to the system components or to the electronics (firmware) for the diagnostics / display shall be taken care of by the manufacturer for this purpose.
26.00.00	SERVICEABILITY / MAINTAINABILITY
26.01.00	Power Component Accessibility: All power components in the converter sections shall be designed for rack-out accessibility for ease of maintenance and to minimize repair downtime.

VARIABLE FREQUENCY DRIVES


26.02.00	Marking / Labeling: Sleeve type wire marker tags or other acceptable means of permanent identification shall be applied to power and control wiring. Individual labels shall be provided for all major components of the VFD system.
27.00.00	STORAGE AND PRESERVATION
27.01.00	The Contractor shall be responsible for the storage and preservation of all the equipments to be supplied under the VFD System, till the time of successful installation and commissioning. The equipment should be suitable for storage for long periods before installation. Contractor should take adequate measures to ensure that no damage happens to the VFD System due to storage and preservation.
28.00.00	TESTS
28.01.00	ROUTINE TESTS
	All acceptance and routine tests as envisaged in QA section shall be carried out. Charges for these shall be deemed to be included in the equipment price.
28.02.00	TYPE TESTS
28.02.01	The Contractor shall carry out the type tests as listed in this specification on the equipment to be supplied under this contract. The bidder shall indicate the charges for each of these type tests separately in the relevant schedule and the same shall be considered for the evaluation of the bids. The type tests charges shall be paid only for the test(s) actually conducted successfully under this contract and upon certification by the employer's engineer.
28.02.02	The type tests shall be carried out in presence of the employer's representative, for which minimum 15 days' notice shall be given by the Contractor. The Contractor shall obtain the employer's approval for the type test procedure before conducting the type test. The type test procedure shall clearly specify the test set-up, instruments to be used, procedure, acceptance norms, recording of different parameters, interval of recording, precautions to be taken etc. for the type test(s) to be carried out.
28.02.03	In case the Contractor has conducted such specified type test(s) within last ten years as on the date of bid opening, he may submit during detailed engineering the type test reports to the Employer for waiver of conductance of such test(s). These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. The Employer reserves the right to waive conducting of any or all the specified type test(s) under this contract. In case type tests are waived, the type test charges shall not be payable to the Contractor.
28.02.04	Further the Contractor shall only submit the reports of the type tests as listed in "LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED" and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. However if the Contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contractor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.


28.03.00	<p>LIST OF TYPE TESTS TO BE CONDUCTED</p> <p>The following type tests shall be conducted under this contract for MV VFD</p> <ul style="list-style-type: none"> i) Overall efficiency determination of VFD system including transformer/ Harmonic filters etc at motor full load ii) Temperature rise test iii) Noise level iv) Harmonics of No load current.(Input/Output)
28.04.00	<p>LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED</p> <p>The following type test reports shall be submitted for VFD Panels'</p> <p>1) VFD panels (For LV VFD)</p> <ul style="list-style-type: none"> i. Rated Current/ Output ii. Temperature rise test iii. Noise level test iv. Power Loss Determination Test v. Power factor measurement. vi. Degree of Protection Test vii. EMC Test viii. The Fast transient SWC tests as per ANSI / IEEE C37.901-2002 / IEC 60255-22-04-2008 / IEC 61800 <p>2) VFD panels (For MV VFD)</p> <ul style="list-style-type: none"> i. Rated Current/ Output ii. Current Sharing iii. Voltage Division iv. Power Loss Determination Test v. Power factor measurement. vi. Degree of Protection Test vii. The Fast transient SWC tests as per ANSI / IEEE C37.901-2002 / IEC 60255-22-04-2008 / IEC 61800 <p>3) AC/DC Reactor</p> <ul style="list-style-type: none"> i. Lightning impulse test(If applicable) ii. Heat run test iii. Short time current test(If applicable) iv. Noise level test <p>4) Transformers (In case of non integrated type)</p>

34636/2020/PS-PEM-MAX

VARIABLE FREQUENCY DRIVES

- i. As per requirements mentioned in subsection for Transformer chapter in technical specifications.

CLAUSE NO.	TECHNICAL REQUIREMENTS		
<p>1.00.00</p> <p>1.01.00</p> <p>1.01.01</p> <p>1.01.02</p> <p>1.01.03</p> <p>1.01.04</p> <p>2.00.00</p> <p>2.01.00</p> <p>2.01.01</p> <p>2.01.02</p> <p>2.02.00</p> <p>2.02.01</p>	<p>CONTROL DESK & PANELS</p> <p>GENERAL</p> <p>All control desk, panels, LVS panel etc. shall be furnished fully wired with necessary provision for convenience outlets, internal lighting, grounding, ventilation, space heating, anti-vibration pads, internal piping & accessories as required for completeness of the system.</p> <p>All panels, desks, cabinets shall be free standing type & have bottom / top entry for cables to be finalised application wise during detailed engineering stage. The bottom of desk & cabinets shall be sealed with bottom plate, compression cable glands (double for field and single for inside rooms) and fire proof sealing material to prevent ingress of dust and propagation of fire. Sufficient number of power receptacles with disconnect switches shall be installed within all panels/desk.</p> <p>Exterior steel surface shall be sand blasted, ground smooth, filled, primed, sanded and smooth enamel painted to give a good finish subject to minimum paint thickness of 65-75 microns for sheet thickness of 3 mm and 50 microns for sheet thickness of 2mm. The exact color shall be finalised during detailed engineering.</p> <p>The design shall conform to the EN ISO 11064 (Ergonomical design of control room), Part-1,2 and 3.</p> <p>CONTROL DESK & PANEL</p> <p>GENERAL</p> <p>The exact dimensions, material, construction details, grounding, general arrangement etc. of Control Desk etc. shall be as per the actual requirement and shall be finalised during detailed engineering and subjected to Employer's Approval.</p> <p>For control desk mounted instruments/ devices etc., which are to be powered from UPS, all required conversion of interface equipments / accessories to make such devices compatible with UPS supply shall be provided. All necessary hardware like Input switches/ fuse unit for each feeder as well as switch fuse unit for each instrument/ device on the power supply line shall be provided. From UPS, redundant feeders shall be provided with suitably rated MCB and provision of fast auto changeover of UPS feeders.</p> <p>Control Desk (CD)</p> <p>Control desk shall be Modular, non-welded construction free standing table top type with front & back cover constructed of 1.6 mm thick CRCA steel plates. The tabletop of the control desk shall be arc-shaped for mounting TFT monitors & mice. The work surface of control desk shall be 30mm thick with the top 12mm of Acrylic Solid Surface (ASS) and the remaining 18mm of laminated medium density fiber board. Work surface shall be made of two different colors at same level and seamlessly joined in each section. The structure frame shall consist of extruded aluminum top and bottom horizontal beams and vertical support tensioned together to form an integrated, finished curvilinear shaped frame. Vertical & Horizontal supports, minimum 2.5mm and 2mm thick respectively, have to be provided for the structure frame. Extreme side legs shall be illuminated type and should complete the</p>		
<p>LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-III-C-9 CONTROL DESK & PANELS</p>	<p>PAGE 1 OF 3</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p>overall form and aesthetics of the desk. It shall have concealed cable & wire way management system. Telephone sets shall be mounted on the control desk. Sliding keyboard trays shall be provided on the CD. The exact profile of the desk, dimension and the radius of curvature shall be finalised during detailed engineering stage.</p> <p>2.02.02 All operator monitors & mice shall be mounted on this CD.</p> <p>2.02.03 The cabling / wiring between OWS & CPU's, power supply cables etc. shall be aesthetically routed and concealed from view.</p> <p>2.03.00 Internal Panel/Desk Items</p> <p>Equipment and devices mounted within the panels/desk shall be mounted on suitable racks/brackets and shall be arranged for convenient access for adjustment and maintenance work.</p>		
<p>LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-III-C-9 CONTROL DESK & PANELS</p>	<p>PAGE 2 OF 3</p>



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 1 OF 6

1.0 SCOPE

This specification covers the Design, Manufacture, Inspection and Testing at the manufacturer's works, proper packing for transportation and delivery to site, **supervision, erection, and commissioning at site** of Local Panels required for control and monitoring of the Auxiliary Plant & Equipment.

2.0 CODES AND STANDARDS

2.1 All the equipments specified herein shall comply with the requirements of the latest issue of the relevant National and International standards.

2.2 As a minimum requirement, the following standards shall be complied with:

- a) IS-6005 : 1998 : Code of practice for phosphating of iron and steel.
- b) IS-5 : 2007 : Colors for ready mixed paints and enamels.
- c) IS-1248:2003 : Direct Acting Indicating Analog Elec Measuring Instruments.
- d) IS/IEC 60947:Part 1:2004 : Low Voltage switchgear & control gear: Part-I (General Rules)
- e) IS-8828:1996 : Circuit breaker for household and similar installations.
- f) IS-13947 (Part-I):1993 : Low Voltage switchgear & control gear : Part-I (General Rules)
- g) ISA-18.1:1979 : Annunciator Sequences and Specification
- h) NFPA-496:2003 : Purged & Pressurised Enclosure for Electrical Equipment in Hazardous Locations.

3.0 TECHNICAL REQUIREMENTS

3.1 Panel Construction

3.1.1 The local panels shall house the secondary instruments, annunciation system, Single loop controller, Control switches / push buttons, indicating lamps/**LED cluster**, relays, timers and other devices required for operation and monitoring of the equipment locally.

3.1.2 The panels shall be of free standing type either welded construction on angle iron (minimum section of 50 x 50 x 4 mm) structure or folded construction by sheet metal formation depending upon the equipments to be mounted on it. The panels shall be robustly built and **stiffeners** as necessary shall be provided.

3.1.3 The panel shall be suitably reinforced to ensure adequate support for all instruments mounted thereon. All welds on exposed panel surfaces shall be ground smooth.

3.1.4 The salient features of construction shall be:

Sheet material: Cold rolled sheet steel

Frame thickness: Not less than 3.0mm

Enclosure thickness: Not less than 2.5 mm for load bearing sections (Mounted with instruments)
1.6 mm for doors and Not less than 2.0 mm for others

Panel Height: Not less than 2365 mm (Refer data sheet-A (No. PES-145A-DS1-0)

Gland plate thickness: 3.0mm

Base channel: ISMC 100 with anti-vibration mounting & foundation bolts.

3.1.5 The panel shall be provided with rear doors with integral lockable handle. The door when locked shall be held at minimum three places. The door width shall not be more than 550mm. The doors shall be provided with suitable **stiffeners** to prevent buckling. The handle shall be on the right side of the door. The door shall be removable type with concealed hinges to facilitate maintenance work. Suitable pocket inside the door shall be provided for keeping the drawings / documents. **Double door shall be provided with suitable glass windows, as per the requirement.**

3.1.6 Suitable neoprene gasket shall be provided on all doors and removable covers. Suitable ventilation **system along with louvers** shall be provided at bottom and top of the doors covered with removable wire mesh.



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 2 OF 6

- 3.1.7 The class of protection shall be in accordance with IP-42 unless otherwise specified in the data sheet – A (No. PES-145-54A-DS1-0).
- 3.1.8 All steel surfaces shall be cleaned by sand / pellet blasting, treated for pickling, degreasing and phosphating etc. by seven tank method. The panel shall have a high quality finish and appearance. The panel shall be painted with two coats of primer followed by two coats of epoxy / synthetic enamel based final paint of color shade and finish as given in data sheet-A (No. PES-145A-DS1-0). Minimum thickness of the paint shall be 85 microns for external paint and 70 microns for internal paint.
- 3.1.9 The cable glands of the required size and type as given in data sheet-A (No. PES-145A-DS1-0) shall be supplied alongwith the Panel.
- 3.1.10 All operable and indicating devices shall be mounted on the front of the panel while aux. Relays / timers MCBs etc. required for realization of control logics shall be mounted on a mounting plate inside the panel. Auxiliary relays and timers etc. shall be grouped according to the control function. No operable or indicating devices shall be mounted below 750 mm and above 1800 mm (w.r.t. finished ground level). The devices shall be located in such a way so as to ensure easy access for operation / maintenance.
- 3.1.11 Single / dual control power supply feeders of voltage class as specified in data sheet-A (No. PES-145A-DS1-0) shall be provided by the purchaser. In case redundant power supply feeders are provided then auto changeover unit shall be mounted on the panel are in the panel supplier's scope. Where DC control power supply is specified an additional 240V, 50 Hz AC supply feeder for powering of space heater and lighting shall be provided by the purchaser. Suitable arrangement shall be provided inside the panel to receive and terminate the power supply feeder(s). For this purpose MCBs of suitable current rating shall be provided by the vendor. A supervisory relay along with a pilot lamp to indicate control supply 'ON' shall be provided on the panel. Any other power supply required for the operation of the devices mounted in the panel shall be arranged by the vendor.
- 3.1.12 The internal wiring shall be carried out with 1100 volt grade PVC insulated copper multi strand wire / flexible of 1.5mm² size. AC & DC wires shall be kept separate from each other. Separate coloured wires to be used for AC and DC circuits. All wires shall be properly numbered and identified with ferrules as per the Control scheme / wiring diagram. Wires shall be routed and run through PVC troughs.
- 3.1.13 Terminal blocks shall be clip on type, 1100 volts grade. Separate terminal blocks shall be used for AC & DC circuits. The terminals shall be suitable for terminating 0.5 mm² to 2.5mm² external cables. **The TB points in terminal block shall be cage clamp type / screw type.** The terminal for ammeters shall be provided with removable links for shorting CTs. Each terminal strip shall be provided with identification strip. The terminal shall not be mounted below 250 mm **height from finished floor. The panel shall have ten (20) percent spare terminal.**
- 3.1.14 The interior of each panel shall be suitably illuminated through fluorescent **lamps / tube lights with shrouded cover of minimum 15W** operable on 240V 50 Hz AC power supply through panel door switch. A 15 Amp. 3-pin Power receptacle shall be provided.
- 3.1.15 Suitable space heaters operable on 240 Volts 50 Hz AC power system shall be provided at the panel bottom. These shall be designed to maintain the panel temperature five (5) deg. C above the ambient temperature during maintenance shutdown. Suitable isolating and control devices comprising of MCB, thermostat etc. shall be provided for the space heater.
- 3.1.16 The panel shall be provided with a copper earth bus of 25 x 6 mm size running throughout the width of the panel. It shall be terminated internally with 10 mm bolts at extreme ends for connection to; main station earth. The panel mounted equipments / devices shall be connected to earth bus through green coloured PVC insulated stranded copper conductor of 2.5 mm² size.
- 3.1.17 Local Panel shall be provided with main name plate of 150 mm x 40 mm size having inscription of 20 mm height. The individual devices on the panels shall be as provided with separate name plate with inscription of 3 mm height. The instrument / devices shall be provided with stick on label plates inside the panel. The material of the main and individual labels shall be three (3) ply 3 mm thick Traffolyte



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 3 OF 6

Sheet / 2 mm Anodised Aluminium Plate. The inscription shall be with white letters on black background on traffolyte sheet. The labels shall be fixed by self tapping non-rusting screws.

3.1.18 Vendor shall furnish electric load and heat load list (in case panel is to be placed in ac environment) of each panel.

3.2 Hazardous Area Panel Requirement

3.2.1 The Local Panel located in hazardous area shall be pressurized as per NFPA-496 requirements to render it non-hazardous. Alarms shall be provided for local and remote annunciation when pressurisation falls below 2.5 mm of water column. Protection shall be of type Z of NFPA-496. It shall not be possible to switch ON the power of purged section unless it is purged as per the recommendation of NFPA-496. Vendor must provide a protective device on the panel to protect the panel from over pressurisation.

3.2.2 Vendor shall supply pressurisation kit consisting of valves, restriction orifices, dual filter regulation, pressure gauges, pressure switches, rotameter etc. Pressurisation kit shall be surface mounting on a metal board and located outside the local panel. Pressurisation kit shall further consist of solenoid valve flow switch, timer blow off safety device etc., so as to make purging fully automatic. However final start shall be manual. Panel protection against over pressure to be provided as per NFPA-496.

3.2.3 Pressurised local control panel pressurization kit assembly design shall provide minimum leakage flow through the Local Control Panel. Panel venting shall be as per NFPA-496.

3.2.4 All components in the local panel like indicating instruments, push buttons switches, lamps etc., which are required to be energized without panel pressurization or before completion of purge cycle shall be explosion proof as per NEMA-7 & suitable for area classification.

3.2.5 All push buttons etc. requiring frequent operation during machine running shall have good positive sealing. Weatherproof housing or cover to be provided wherever necessary. Vendor shall provide pressurisation bypass switch outside explosion proof enclosure of pressurized panel with lamp indication. This shall be used only during maintenance. All hinges, screws, other non-painted metallic parts shall be of stainless steel material.

3.2.6 Provision to switch off manually all types of power shall be provided in the panel. In addition, it shall also be possible to switch off power circuits / components which are powered from motor control centre or control room manually in case of pressurization failure. All such cables from MCC and main control room shall be terminated in explosion proof boxes (NEMA-7).

3.3 Control & Monitoring devices

3.3.1 Instruments like Indicators, recorders, single loop controllers etc. as applicable and specified elsewhere for the plant / equipment shall be supplied and mounted on the panel.

3.3.2 Alarm Annunciator System

It shall be solid state discrete facia type having a sequence of ISA-S18.1A or as specified, opaque facia windows of 70 mm x 50 mm size, having two (2) lamps per window, and hooter of 10W, and provision for repeat group alarm at remote. The annunciator shall be provided with ten (10) percent spare windows or minimum two (2) windows along with electronics.

3.3.3 Relays

The relays shall be electromagnetic type suitable for specified control supply. Its contact configuration and rating shall be suitable for the specified control function. However minimum contact rating shall be 5 Amp AC & 2 Amp DC as applicable. There shall be ten (10) percent spare contacts.

3.3.4 Timers

The timers shall be electronic type suitable for specified control supply. Its contact configuration and rating shall be suitable for the specified control function. However, minimum contact rating shall be 5 Amp AC & 2 Amp DC as applicable.



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 4 OF 6

3.3.5 Control / Selector Switches

Switches shall be Rotary Cam type with minimum of 5 Amps AC & 2 Amp DC continuous current rating. Selector switches shall be stay put type while control switches shall be spring-return-to-neutral type. Contact configuration and rating shall be as per the control function requirement. The switches shall be lockable type wherever specified. Each switch shall be provided with engraved plates indicating the switch position / functions.

3.3.6 Push Buttons / Indicating Lights

The push buttons shall be momentary action self-resetting type, however stop P.B. for unidirectional drives shall be provided with manual reset facility. Its contact configuration & rating shall be as required for the control function but minimum 2 NO + 2 NC of 5 Amp. AC rating. It shall have round coloured projecting tab and engraved escutcheon plate / inscription plate. Colour coding of push buttons shall be as under:

RED	Motor OFF / Valve CLOSE	YELLOW	Alarm acknowledge	Left Hand Side
GREEN	Motor ON / Valve OPEN	BLACK	Lamp test	Right Hand Side

Indicating lights shall be suitable for direct connections across specified power supplies. It shall be fitted with built in resistance to prevent circuit tripping on shorting of lamp filament. It shall be fitted with LED cluster type lamp replaceable from front.

GREEN	Motor OFF / Valve CLOSED condition	AMBER	Motor tripped	Left Hand Side
RED	Motor ON / Valve OPEN condition	WHITE	Normal / healthy	Right Hand Side

3.3.7 Ammeters

Ammeter shall be 96 x 96 mm size, 90 deg. deflection, 1.5% accuracy, 1 Amp. CT operated or with 4-20mA input and Flush mounting type as called for in the data sheet-A (No. PES-145-54A-DS1-0). Ammeters for motors shall have six (6) times folded scale at upper end to enable motor starting current indication

3.3.8 Miniature Circuit Breaker (MCB)

These shall be instantaneous magnetic trip type for short circuit in addition to current time inverse delayed thermal trip feature for over current protection. The housing of MCB shall be made of non-ignitable, high impact material. It shall have minimum short circuit rating of 9 KA for AC Voltages and 4 KA for DC Voltages.

3.3.9 Makes of various instruments / devices shall be as given below

1.	Alarm Annunciators	:	Procon / IIC
2.	Ammeters	:	AEP / IMP
3.	Control / Selector Switches	:	Alsthom / Kaycee / Siemens / L&T
4.	Push Buttons / Indicating Lamps	:	Siemens / L&T / Teknic / Alsthom
5.	Auxiliary Relays	:	Jyoti / Siemens / L&T / OEN
6.	Timers	:	L&T / Alsthom / Bhartiya Cutler Hammer
7.	MCBs	:	S&S Power Engg. / Indo Asian / MDS
8.	Terminal Blocks	:	Jyoti / Elmex

4.0 TESTING AND INSPECTION

4.1 The bidder shall adopt suitable quality assurance program to ensure that the equipments offered will meet the specification requirements in full.

4.2 BHEL's standard Quality Plan for LCP is enclosed with the specification. The bidder shall furnish his acceptance to BHEL's QP and submit the signed and stamped copy of QP along with the offer.



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 5 OF 6

4.3 The vendor shall conduct the following tests as a minimum requirement:

4.3.1 Routine Tests

1. High Voltage (H.V.)
2. Insulation Resistance (I.R.)
3. Functional

4.3.2 Type Tests

1. Enclosure Class Test



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A

VOLUME II B

SECTION D

REV. NO. 03

DATE : 16-09-2013

SHEET 6 OF 6

5.0 SPARES AND CONSUMABLES

5.1 Commissioning Spares and consumables

The bidder shall supply all commissioning spares and consumables 'as required' during Start-up, as part of the main equipment supply.

5.2. Mandatory Spares

The bidder shall offer alongwith main offer, the Mandatory Spares as specified elsewhere in the specification. The Mandatory Spares offered shall be of the same make and type as the main equipment.

5.3. Recommended Spares

The bidder shall furnish a list of Recommended Spares indicating the normal service expectancy period and frequency of replacement; quantities recommended for 3 years operation alongwith unit rate against each item to enable BHEL/BHEL's Customer to place a separate order later, if required.

6.0 DRAWINGS AND DOCUMENTS

6.1 The bidder shall furnish the following documents in required number of copies along with the bid :

1. Data Sheet no. PES-145A-DS1-0
2. General Arrangement Drawing.
3. Catalogue and technical information for instruments and devices.
4. Quality Plan.

6.2 The vendor shall furnish the following documents in required number as agreed after the award of contract:

1. Data Shee No. PES-145A-DS2-0
2. GA Drawing indicating layout of instruments, construction details, foundation details, cable gland plate alongwith cable glands and all details mentioned in this specification.
3. Control Schematic Diagram along with grouping of different terminals for various functions.
4. Catalogue and technical information for instruments and devices with selected options clearly marked.
5. O&M Manuals.
6. "As Built" Drawing.
7. CDs.


7.0 MARKING AND PACKING

7.1 Panel with all instruments / devices mounted on it shall be suitably packed & protected for the entire period of despatch, storage and erection against impact, abrasion, corrosion, incidental damage due to vermin, sunlight, high temperature, rain moisture, humidity, dust, sea-water spray (where applicable) as well as rough handling and delays in Transit and storage in open.

8.0 APPLICABLE DATA SHEET FORMS

This document shall be read with one or more of the following data sheet forms :

- Data sheet A&B for Local Panels : Data sheet no. PES-145A-DS1-0
- Data sheet C for Local Panels : Data sheet no. PES-145A-DS2-0

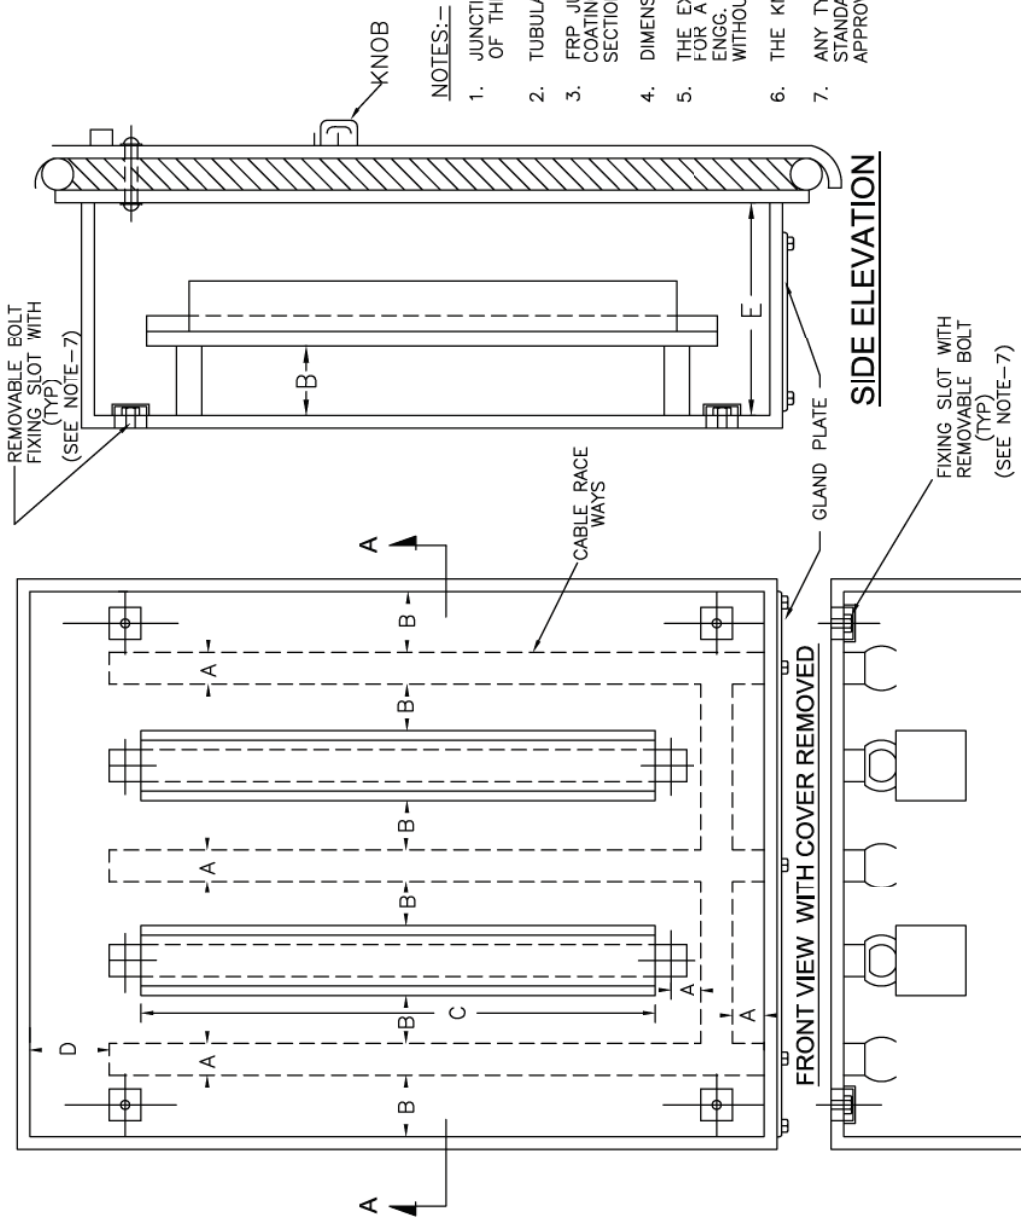

- A - 75 mm
- B - 25 mm
- C - SEE NOTE-4
- D - 100 mm
- E - 150 mm

NOTES:-

1. JUNCTION BOXES SHALL HAVE GLAND PLATES AT THE BOTTOM OF THE BOX ONLY.
2. TUBULAR TYPE GASKETS WILL BE USED.
3. FRP JUNCTION BOXES, SHALL BE PROVIDED WITH POLYETHERENE COATING. ALSO REFER SUB SECTION INST CABLE, PART-B SECTION-VI FOR DETAILS.
4. DIMENSION OF 'C' SHALL BE BASED ON NO. OF TERMINAL BLOCKS.
5. THE EXACT TYPE & DIMENSION OF JUNCTION BOXES TO BE USED FOR A PARTICULAR APPLICATION SHALL BE AS DECIDED DURING DETAIL ENGG. STAGE AND SHALL BE SUBJECT TO EMPLOYER'S APPROVAL WITHOUT ANY PRICE REPERCUSSION.
6. THE KNOB FOR ALL THE JUNCTION BOXES SHALL BE IDENTICAL.
7. ANY TYPE OF SEALED FIXING ARRANGEMENT AS PER MANUFACTURER'S STANDARD CAN ALSO BE PROVIDED SUBJECT TO EMPLOYER'S APPROVAL.

FOR TENDER PURPOSE ONLY

NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION		PROJECT TYPICAL THERMAL POWER PLANT	
TITLE G.A. OF JUNCTION BOX		SCALE N.T.S.	DRG. NO. 0000-999-POI-A-017
REV.NO.	DATE	APPD	REV. NO. D
D GENERALLY REVISED	21.08.12 KS	ARCH.	SIZE A4
C GENERALLY REVISED	04.08.06 KS	C&I	DATE 04.05.05
B GENERALLY REVISED	S.K. A.R	E	DATE 04.05.05
A FIRST ISSUE	S.K. A.R	M	DATE 04.05.05
SECTION-AA		DRAWN DESIGN CHKD.	
HINGE FOR THE DOOR		KNOB	
DESCRIPTION			
CLEARED BY			

34636/2020/PS-PEM-MAX

Cheklist for Serial Communication between DCS System and Foreign Device			
A Device Specific :			
SN	Parameters	Options available	Remarks if any
1	Model No.& Make of Device		
2	Communications Link Options	<input type="checkbox"/> Multidrop <input checked="" type="checkbox"/> Peer to Peer <input type="checkbox"/> N/w topology attached	
3	Protocol Mode (Device is a)	<input type="checkbox"/> Master <input type="checkbox"/> Slave <input type="checkbox"/> Master/Slave	
4	Protocol	<input type="checkbox"/> RTU <input type="checkbox"/> ASCII <input type="checkbox"/> Other -----	
5	Master	<input type="checkbox"/> System maxDNA <input type="checkbox"/> Other -----	
6	Redundancy Requirements	Yes / No	
7	Dist.bet.DCS System & Device*	<input type="checkbox"/> ----- Feet <input type="checkbox"/> ----- Meters	
B Electrical Specific :			
1	Interface Type	<input type="checkbox"/> RS232 <input type="checkbox"/> RS422 <input type="checkbox"/> RS485	
2	Wiring at Device end	<input type="checkbox"/> 2 Wire <input type="checkbox"/> 4 Wire	
3	Transmission Channel	<input type="checkbox"/> Half Duplex <input type="checkbox"/> Full Duplex	
4	Baud Rates (bps)	<input type="checkbox"/> 1200 <input type="checkbox"/> 2400 <input type="checkbox"/> 4800 <input type="checkbox"/> 9600 <input type="checkbox"/> 19200	
5	Databits	<input type="checkbox"/> 8 <input type="checkbox"/> 7	
6	Stopbits	<input type="checkbox"/> 1 <input type="checkbox"/> 2	
7	Parity	<input checked="" type="checkbox"/> None <input type="checkbox"/> Odd <input type="checkbox"/> Even	
8	H/w & Software Handshake	<input type="checkbox"/> Yes <input type="checkbox"/> No	
9	Response Timeout time (Sec)	<input type="checkbox"/> ----- <input type="checkbox"/> Configurable timeout	
10	Data Formats Supported	<input type="checkbox"/> Boolean <input type="checkbox"/> Real <input type="checkbox"/> Char <input type="checkbox"/> Sn.Int <input type="checkbox"/> UnSn.Int	
11	Transmission mode	<input type="checkbox"/> Asynchronous <input type="checkbox"/> Synchronous	
C Application Specific : *			
1	Primary Function*	<input type="checkbox"/> Data Acquisition <input type="checkbox"/> Data Acquisition & Control	
		<input type="checkbox"/> Download parameter sets	
2	Analog Points to read	-----Nos. <input type="checkbox"/> Details attached <input type="checkbox"/> Details not attached	
3	Analog Points to write	-----Nos. <input type="checkbox"/> Details attached <input type="checkbox"/> Details not attached	
4	Digital Points to read	-----Nos. <input type="checkbox"/> Details attached <input type="checkbox"/> Details not attached	
5	Digital Points to write	-----Nos. <input type="checkbox"/> Details attached <input type="checkbox"/> Details not attached	
6	Memory / Flag Points to read	-----Nos. <input type="checkbox"/> Details attached <input type="checkbox"/> Details not attached	
7	Memory / Flag Points to write	-----Nos. <input type="checkbox"/> Details attached <input type="checkbox"/> Details not attached	
D Hardware Specific :			
1	Cable type	<input checked="" type="checkbox"/> Boolean cable <input type="checkbox"/> Twisted pair cable	
2	Cable Details Enclosed	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	
3	Any specific Converter required	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Details enclosed	
E Device Documents :			
1	Manufacturer's Documents*	<input type="checkbox"/> Tech., Spec. <input type="checkbox"/> Operating Manual	

***Notes:**

A6: To identify converter requirement and cable length.

C: Sr.no.1 to 7 are required to be furnished for interface:such as Tagname,Description,point type,modbus(Register) address,EU,range & device address.

C1: What is the primary purpose of the communication link?


E1: Req'd. Contents : This document must provide an overview of the device including its intended use.(a general tech,communication & electrical details)




C&I SPECIFICATION FOR
HVAC SYSTEM


SECTION: C
SUB SECTION: C&I


INSTRUMENTATION CABLE,
CABLE INTERCONNECTION AND
TERMINATION PHILOSOPHY

CLAUSE NO.	TECHNICAL REQUIREMENTS			
1.00.00	INSTRUMENTATION CABLE, CONTROL & POWER SUPPLY CABLE, INTERNAL WIRING AND ELECTRICAL FIELD CONSTRUCTION MATERIAL (CABLE SUB-TRAYS ETC)			
1.01.00	General requirements			
1.01.01	All cables including special cables, internal wiring and electrical field construction material shall conform to this specification, Employer approved detail engineering drawings & documents and the latest edition of the relevant standards & guidelines. The Bidder shall furnish all material and services required for the completeness of the work identified in his scope as per this specification.			
1.01.02	The Contractor shall supply, erect, terminate and test all instrumentation cables for control and instrumentation equipment/devices/systems included under Contractor's scope and ensuring completeness of the control system.			
1.01.03	Any other application where it is felt that instrumentation cables are required due to system/operating condition requirements, are also to be provided by Contractor.			
1.01.04	Other type of cables like fiber optic/co-axial cables for system bus, cables for connection of peripherals etc. (under Contractor's scope) are also to be furnished by the Contractor.			
1.01.05	Contractor shall supply all cable erection and laying hardware from the main trunk routes like branch cable trays/sub-trays, supports, flexible conduits, cable glands, lugs, pull boxes etc. on as required basis for all the systems covered under this specification.			
1.01.06	Wherever the quantity has been defined as on as required basis, the same are to be furnished by contractor on as required basis within his quoted lump sum price without any further cost implication to the Employer.			
2.00.00	SPECIFICATION OF INSTRUMENTATION CABLE			
2.01.00	Common Requirements			
	S. No.	Property	Requirement	
	1	Operating Voltage	225 V (peak value)	
	2.	Codes and standard	All instrumentation cables shall comply with VDE 0815, VDE 0207, Part 4, Part 5, Part 6, VDE 0816, VDE 0472, SEN 4241475, ANSI MC 96.1, IS-8784, IS-10810 (latest editions) and their amendments read along with this specification.	
	3.	Continuous operation suitability	At 205 Deg C for Type-C cables & heat resistant cables, at 70 Deg C for all other type of cables.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 1 OF 13	


CLAUSE NO.	TECHNICAL REQUIREMENTS				
2.02.00	S. No.	Property	Requirement		
	4.	Marking :- a.Progressive automatic on-line sequential marking of length in meters to be provided at every one meter on outer sheath. b.Marking to read 'FRLS' to be provided at every 5 meters on outer sheath except for Type-C cable c.Durable marking at intervals not exceeding 625 mm shall include manufacturer's name, insulation material, conductor's size, number of pairs, voltage rating, type of cable, year of manufacturer to be provided on outer sheath.			
	5.	Allowable Tolerance on overall diameter	+/- 2 mm (maximum) over the declared value in data sheet		
	6.	Variation in diameter	Not more than 1.0 mm throughout the length of cable.		
	7.	Ovality at any cross-section	Not more than 1.0 mm		
	8.	CAGE-CLAMP suitability	To be provided		
	9.	Color	The outer sheath shall be of blue color.		
	10.	Others	Repaired cables shall not be acceptable.		
	Specific Requirements				
	Specification Requirements		Type-A cable	Type-B cable	Type F & G cable
A. CONDUCTORS					
Cross section area		0.5 sq. mm			
Conductor material		ANSI type KX	ANSI type SX	Annealed bare copper	ANSI type KX
Colour code		Yellow-Red	Black-Red	As per VDE-815	Yellow-Red
Conductor Grade		As per ANSI MC 96.1		Electrolytic	As per ANSI MC 96.1
No & dia of strands		7x0.3 mm (nom)			
No. of Pairs		2	2	2/4/8/12/16/24 / 48	2
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2		SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 2 OF 13


CLAUSE NO.	TECHNICAL REQUIREMENTS				
	Specification Requirements	Type-A cable	Type-B cable	Type F & G cable	Type-C cable
	Max. conductor loop resistance per Km (in ohm) at 20 deg. C	As per ANSI MC 96.1		73.4	As per ANSI MC 96.1
	Reference Standard	As per ANSI MC 96.1		VDE : 0815	As per ANSI MC 96.1
	B. INSULATION				
	Material	Extruded PVC type YI 3			Teflon (i.e. extruded FEP)
	Thickness in mm (Min/Max)	0.25/0.35			0.4 / 0.50 (nominal)
	Volume Resistivity (Min) in ohm-cm	1 x 10 ¹⁴ at 20 deg. C & 1x10 ¹¹ at 70 deg. C.			2.8x 10 ¹⁴ at 20 deg. C & 2x10 ¹¹ at 205 deg. C.
	C. PAIRING & TWISTING				
	Max. lay of pairs (mm)	50			
	Single layer of binder tape on each pair provided	Each core printed with number or Numbered binder tape to be provided on each pair	Yes	Each core printed with number or Numbered binder tape to be provided on each pair	
	Bunch (Unit Formation) for more than 4P	N.A.	To be provided	N.A.	
	Conductor /pair identification as per VDE0815	N.A.	To be provided	N.A.	
	D. SHIELDING				
	Type of shielding	Al-Mylar tape			
	Individual pair shielding	No	To be provided for F-type cable	No	
	Minimum thickness of Individual pair shielding	No	0.028mm (28 micron)	No	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 3 OF 13		


CLAUSE NO.	TECHNICAL REQUIREMENTS				
Specification Requirements	Type-A cable	Type-B cable	Type F & G cable	Type-C cable	
Overall cable assembly shielding	To be provided				
Minimum thickness of Overall cable assembly shielding	0.055 mm (55 micron)				
Coverage / Overlapping	100% / 20%				
Drain wire provided for individual shield	N.A.	Yes (for F-type) Size- 0.5 sqmm No of strands-7 Dia of strands- 0.3mm Annealed Tin coated copper	N.A.		
Drain wire provided for overall shield	Yes, Size- 0.5 sqmm, No of strands-7, Dia of strands- 0.3mm, Annealed Tin coated copper				
E. FILLERS (if applicable)					
Non-hygroscopic, flame retardant	To be provided				
F. OUTER SHEATH					
Material	Extruded PVC compound YM1 with FRLS properties		Teflon (i.e. extruded FRP)		
Minimum Thickness at any point	1.8 mm		0.4 mm		
Nominal Thickness at any point	>1.8 mm		0.5 mm		
Resistant to water, fungus, termite & rodent attack	Required				
Minimum Oxygen index as per ASTM D-2863	29 %		N.A.		
Minimum Temperature index as per ASTM D-2863	250 deg.C		N.A.		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2		SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 4 OF 13	


CLAUSE NO.	TECHNICAL REQUIREMENTS				
					
	Specification Requirements	Type-A cable	Type-B cable	Type F & G cable	Type-C cable
	Maximum Acid gas generation by weight as per IEC-60754-1	20%			N.A.
	Maximum Smoke Density Rating as per ASTM-D2843	60% (defined as the average area under the curve when the results of smoke density test plotted on a curve indicating light absorption vs. time as per ASTM-D2843)			N.A.
	Reference standard	VDE207 Part 5,VDE-816			VDE207 Part 6 ASTM D2116
	G. Electrical Parameters				
	Mutual Capacitance Between Conductors At 0.8 KHz (Max.)	200 nF/km	120 nF/km for F type 100 nF/km for G-type		200 nF/km
	Insulation Resistance (Min.)	100 M Ohm/Km			
	Cross Talk Figure (Min.) At 0.8 KHz	60 dB	60 dB	60dB	
	Characteristic Impedance (Max) At 1 KHz	N.A.	320 OHM FOR F-TYPE 340 OHM FOR G-TYPE		N.A.
	Attenuation Figure At 1 KHz (Max)	N.A.	1.2 db/km		N.A.
	H. COMPLETE CABLE				
	Complete Cable assembly	Shall pass Swedish Chimney test as per SEN-SS 4241475 class F3.			N.A.
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2		SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 5 OF 13


CLAUSE NO.	TECHNICAL REQUIREMENTS			
	Specification Requirements	Type-A cable	Type-B cable	Type F & G cable Type-C cable
	Flammability	Shall pass flammability as per IEEE-383 read in conjunction to this specification		As per manufacturer's standard subject to employer's approval
	I. CABLE DRUM			
	Type	Non-returnable wooden drum (wooden drum to be constructed from seasoned wood free from defects with wood preservative applied to entire drum) or steel drum.		
	Length	1000 m \pm 5% for up to & including 12 pairs 500 m \pm 5% for above 12 pairs		
	<p>Note: Heat resistant instrumentation cable shall have same specification as of G/F type instrumentation cable as specified above, except that insulation and outer sheath material shall be Teflon and cable shall be suitable for continuous operation at 205 Deg. C</p>			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 6 OF 13	


CLAUSE NO.	TECHNICAL REQUIREMENTS																																																					
3.07.00	Penetration of water resistance and impact resistance shall be as per IEC standard.																																																					
4.00.00	SPCIFICATION OF CONTROL & POWER SUPPLY CABLES Refer Electrical sub-sections																																																					
5.00.00	INSTRUMENTATION CABLE INTERCONNECTION AND TERMINATION PHILOSOPHY The cable interconnection philosophy to be adopted shall be such that extensive grouping of signals by large scale use of field mounted Group Junction Boxes (JBs) at strategic locations (where large concentration of signals are available, e.g. valves limit & torque switches, switchgear) is done and consequently cable with higher number of pairs are extensively used. The details of termination to be followed are mentioned in the given Table A. TABLE A: CABLE TERMINATION TO BE FOLLOWED <table border="1" data-bbox="407 661 1421 1837"> <thead> <tr> <th colspan="2" data-bbox="407 661 915 720">Application</th> <th colspan="2" data-bbox="919 661 1295 720">Type Of Termination</th> <th data-bbox="1297 661 1421 720" rowspan="2">Type Of Cable</th> </tr> <tr> <th data-bbox="407 724 659 783">FROM (A)</th> <th data-bbox="662 724 915 783">TO (B)</th> <th data-bbox="919 724 1127 783">END A</th> <th data-bbox="1130 724 1295 783">END B</th> </tr> </thead> <tbody> <tr> <td data-bbox="407 787 659 930">Valves/dampers drives (Integral Junction box)</td> <td data-bbox="662 787 915 930">Marshalling / Marshalling – cum Termination Cubicle / local group JB</td> <td data-bbox="919 787 1127 930">Plug in connector</td> <td data-bbox="1130 787 1295 930">Post mount cage clamp type.</td> <td data-bbox="1297 787 1421 930">G</td> </tr> <tr> <td data-bbox="407 934 659 1077">Transmitters, Process Actuated switches mounted in LIE/LIR</td> <td data-bbox="662 934 915 1077">Integral Junction box of LIE/LIR</td> <td data-bbox="919 934 1127 1077">Plug in connector</td> <td data-bbox="1130 934 1295 1077">Cage clamp (Rail mount) type.</td> <td data-bbox="1297 934 1421 1077">F,G</td> </tr> <tr> <td data-bbox="407 1081 659 1190">RTD heads</td> <td data-bbox="662 1081 915 1190">Local junction box</td> <td data-bbox="919 1081 1127 1190">Plug in connector</td> <td data-bbox="1130 1081 1295 1190">Cage clamp (Rail mount) type.</td> <td data-bbox="1297 1081 1421 1190">F</td> </tr> <tr> <td data-bbox="407 1194 659 1304">Thermocouple</td> <td data-bbox="662 1194 915 1304">Local junction box / CJC box (if applicable)</td> <td data-bbox="919 1194 1127 1304">Plug in connector</td> <td data-bbox="1130 1194 1295 1304">Cage clamp (Rail mount) type.</td> <td data-bbox="1297 1194 1421 1304">A, B, C*</td> </tr> <tr> <td data-bbox="407 1308 659 1417">Other Field mounted Instrument</td> <td data-bbox="662 1308 915 1417">Local JB / Group JB</td> <td data-bbox="919 1308 1127 1417">Plug in connector</td> <td data-bbox="1130 1308 1295 1417">Cage clamp (Rail mount) type.</td> <td data-bbox="1297 1308 1421 1417">F,G</td> </tr> <tr> <td data-bbox="407 1421 659 1530">RTD</td> <td data-bbox="662 1421 915 1530">Temperature transmitter</td> <td data-bbox="919 1421 1127 1530">Plug in connector</td> <td data-bbox="1130 1421 1295 1530">Screwed, Cage clamp type</td> <td data-bbox="1297 1421 1421 1530">F</td> </tr> <tr> <td data-bbox="407 1535 659 1644">Thermocouple</td> <td data-bbox="662 1535 915 1644">Temperature transmitter</td> <td data-bbox="919 1535 1127 1644">Plug in connector</td> <td data-bbox="1130 1535 1295 1644">Screwed, Cage clamp type</td> <td data-bbox="1297 1535 1421 1644">A, B, C*</td> </tr> <tr> <td data-bbox="407 1648 659 1837">Local Junction box, Temperature Transmitter, Int. Junction box of LIE/ LIR/ MCC/SWGR</td> <td data-bbox="662 1648 915 1837">Group JB</td> <td data-bbox="919 1648 1127 1837">Cage clamp (Rail mount) type.</td> <td data-bbox="1130 1648 1295 1837">Cage clamp (Rail mount) type.</td> <td data-bbox="1297 1648 1421 1837">F,G</td> </tr> </tbody> </table>				Application		Type Of Termination		Type Of Cable	FROM (A)	TO (B)	END A	END B	Valves/dampers drives (Integral Junction box)	Marshalling / Marshalling – cum Termination Cubicle / local group JB	Plug in connector	Post mount cage clamp type.	G	Transmitters, Process Actuated switches mounted in LIE/LIR	Integral Junction box of LIE/LIR	Plug in connector	Cage clamp (Rail mount) type.	F,G	RTD heads	Local junction box	Plug in connector	Cage clamp (Rail mount) type.	F	Thermocouple	Local junction box / CJC box (if applicable)	Plug in connector	Cage clamp (Rail mount) type.	A, B, C*	Other Field mounted Instrument	Local JB / Group JB	Plug in connector	Cage clamp (Rail mount) type.	F,G	RTD	Temperature transmitter	Plug in connector	Screwed, Cage clamp type	F	Thermocouple	Temperature transmitter	Plug in connector	Screwed, Cage clamp type	A, B, C*	Local Junction box, Temperature Transmitter, Int. Junction box of LIE/ LIR/ MCC/SWGR	Group JB	Cage clamp (Rail mount) type.	Cage clamp (Rail mount) type.	F,G	
Application		Type Of Termination		Type Of Cable																																																		
FROM (A)	TO (B)	END A	END B																																																			
Valves/dampers drives (Integral Junction box)	Marshalling / Marshalling – cum Termination Cubicle / local group JB	Plug in connector	Post mount cage clamp type.	G																																																		
Transmitters, Process Actuated switches mounted in LIE/LIR	Integral Junction box of LIE/LIR	Plug in connector	Cage clamp (Rail mount) type.	F,G																																																		
RTD heads	Local junction box	Plug in connector	Cage clamp (Rail mount) type.	F																																																		
Thermocouple	Local junction box / CJC box (if applicable)	Plug in connector	Cage clamp (Rail mount) type.	A, B, C*																																																		
Other Field mounted Instrument	Local JB / Group JB	Plug in connector	Cage clamp (Rail mount) type.	F,G																																																		
RTD	Temperature transmitter	Plug in connector	Screwed, Cage clamp type	F																																																		
Thermocouple	Temperature transmitter	Plug in connector	Screwed, Cage clamp type	A, B, C*																																																		
Local Junction box, Temperature Transmitter, Int. Junction box of LIE/ LIR/ MCC/SWGR	Group JB	Cage clamp (Rail mount) type.	Cage clamp (Rail mount) type.	F,G																																																		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 7 OF 13																																																			

CLAUSE NO.	TECHNICAL REQUIREMENTS				
6.00.00 6.01.00	Application		Type Of Termination		Type Of Cable
	FROM (A)	TO (B)	END A	END B	
	Local Junction box, Temperature Transmitter, Int. Junction box of LIE/ LIR/ Group JB / MCC/SWGR	Marshalling / Marshalling – cum Termination Cubicle	Cage clamp (Rail mount) type.	Cage clamp (Post mounted) type.	F,G
	Marshalling cubicle/ Termination Cabinet	Electronic system cabinet	Cage clamp (Post mounted) type.	Plug-in connector / other system as per Mfr.'s Standard	Internal wiring
	Marshalling/ Termination System Cabinets	UCD mounted equipments	Cage clamp (Post mounted) type.	Plug in connector / Cage clamp type (rail mounted).	F,G (with plug-in connect or at one end)
	DDCMIS/PLC cabinets	PC, Printers etc.	Plug in connector	Plug in connector	Mfr.'s Standard
	<p>Notes</p> <ol style="list-style-type: none"> 1 Normally 10% spare cores shall be provided when the numbers of pairs of cables are more than four pairs, except for pre-fabricated cables which shall be as per manufacturer's standard. 2 For analog signals, individual pair shielding & overall shielding & for Binary signals, only overall shielding of instrumentation cables shall be provided. 3 * For high temperature applications only. 4 . For connection between field/JB and DDCMIS marshalling cabinet Minimum 4 pair instrumentation cable shall be used. 5 All the spare cores of instrumentation cable have to be terminated in Marshalling cabinets/ DCS panel end. 6 Not used. 				
	6.00.00 TERMINAL BLOCKS				
	<p>6.01.00 All terminal blocks shall be rail mounted/post mounted, cage clamp type with high quality non-flammable insulating material of melamine suitable for working temperature of 105 deg. C. The terminal blocks in field mounted junction boxes, temperature transmitters, instrument enclosures/racks, etc., shall be suitable for cage clamp connections. The terminal blocks in Control Equipment Room logic/termination/marshalling cubicles shall be suitable for post</p>				
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 8 OF 13		

CLAUSE NO.	TECHNICAL REQUIREMENTS											
8.02.00	<p>Cables shall be segregated as per IEEE Std.-422. In vertically stacked trays, the higher voltage cable shall be in higher position and instrumentation cable shall be in bottom tier of the tray stack. The distance between instrumentation cables and those of other system shall be as follows:</p> <table border="0" data-bbox="391 352 1144 506"> <tr> <td>From 11 kV/6.6 kV/3.3 kV tray system</td> <td>-</td> <td>914 mm</td> </tr> <tr> <td>From 415V tray system</td> <td>-</td> <td>610 mm</td> </tr> <tr> <td>From control cable tray system</td> <td>-</td> <td>305 mm</td> </tr> </table>	From 11 kV/6.6 kV/3.3 kV tray system	-	914 mm	From 415V tray system	-	610 mm	From control cable tray system	-	305 mm		
From 11 kV/6.6 kV/3.3 kV tray system	-	914 mm										
From 415V tray system	-	610 mm										
From control cable tray system	-	305 mm										
8.03.00	<p>Cables shall terminate in the enclosure through cable glands. All cable glands shall be properly gasketed. Sealing (to prevent ingress of dust entry and propagation of fire) shall be provided for all floor slots used for cable entrance. Compression cable glands (double for armoured and single for other cables) shall be provided.</p>											
8.04.00	Not in use											
8.05.00	<p>The cables emanating from redundant equipment/devices shall be routed through different paths. The above segregation of cables & wiring for redundant equipments/devices shall be in accordance with IEEE-Std-422.</p>											
9.00.00	CABLE LAYING AND ACCESSORIES											
9.01.00	<p>CABLE LAYING</p> <ol style="list-style-type: none"> 1 Cables shall be laid strictly in line with cable schedule. 2 Identification tags for cables. Indelible tags to be provided at all terminations, on both sides of wall or floor crossing, on each conduit/duct/pipe entry/exit, and at every 20 m in cable trench/tray. 3 Cable tray numbering and marking. To be provided at every 10m and at each end of cable way & branch connection. 4 No jointing is permissible for Instrumentation cables. For other cables Jointing for more than 250 Meters run of cable shall be permitted. 5 Buried cable protection With concrete slabs; Route markers at every 20 Meters along the route & at every bend. 6 Road Crossings Cables to pass through buried high density PE pipes encased in PCC. At least 300 mm clearance shall be provided between <ul style="list-style-type: none"> - HT power & LT power cables, - LT power & LT control/instrumentation cables, 											
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2</p>	<p>SUB-SECTION-III-C4 INSTRUMENTATION CABLES</p>	<p>PAGE 10 OF 13</p>									

CLAUSE NO.	TECHNICAL REQUIREMENTS 		
9.02.00 9.03.00 9.04.00	<p>Spacing between cables of same voltage grade shall be in accordance with the derating criteria adopted for cable sizing.</p> <p>7 Segregation (physical isolation to prevent fire jumping)</p> <p>a All cable associated with the unit shall be segregated from cables of other Units.</p> <p>b Interplant cables of station auxiliaries and unit critical drives shall be segregated in such a way that not more than half of the drives are lost in case of single incident of fire.</p> <p>8 Cable clamping</p> <p>All cables laid on trays shall be neatly dressed up & suitably clamped/tied to the tray. For cables in trefoil formation, trefoil clamps shall be provided.</p> <p>9 Optical fiber cables (OFCs) :</p> <p>Outside Building Area - to be laid necessarily inside GI conduit with support from cable tray/Trestle structure</p> <p>Inside Building Area – to be laid on separate cable sub-trays</p> <p>While buried- in separate burried trench approx.1.0 meter depth, to be laid in 2” rodent proof HDPE conduits covered with sand, brick, laid breadth-wise and soil along the pipe line route by contractor;</p> <p>While crossing roads - to be laid in GI/ rodent proof HDPE conduits with sand filling at bottom and sand, soil filling at top with cement concrete;</p> <p>While crossing canals/river- to be laid in rodent proof HDPE conduits within hume pipe.</p> <p>10 Laying of Network Cable (UTP/STP) :</p> <p>Out side Building Area- to be laid necessarily inside GI conduits with support from cable tray / Trestle structure.</p> <p>Inside Building Area- to be laid necessarily inside GI conduits on separate cable sub-trays.</p> <p>Bidder shall supply and install all cable accessories and fittings like Light Interface Units, Surge suppressors, Opto isolators, Interface Converters, Fibre Optic Card Cage, Fibre Optic Line Driver, Repeater / Modem (for Optical Fibre Cables), cable glands, grommets, lugs, termination kits etc. on as required basis.</p> <p>Cables, which terminate in cabinets of draw out sections shall have sufficient cable coiled in the bottom of the cabinet to permit full withdrawal of draw out sections without disconnecting the cables. When prefabricated cables with factory connectors on both ends are longer than required, the excess cable shall be coiled in the bottom of one or both termination cabinets.</p> <p>The Bidder shall be responsible for proper grounding of all equipment under this package. Further, proper termination of cable shields shall be verified and the grounding of the same shall be coordinated so as to achieve grounding of all instrumentation cable shields at same potential. This shall be completed prior to system tests.</p>		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 11 OF 13

CLAUSE NO.	TECHNICAL REQUIREMENTS			
9.05.00	The Contractor shall take full care while laying / installing cables as recommended by cable manufacturers regarding pulling tensions and cable bends. Cables damaged in any way during installation shall be replaced at the expense of the Contractor.			
10.00.00	<p>FIELD MOUNTED LOCAL JUNCTION BOXES</p> <p>(i) No. of ways 12/24/36/48/64/72/96/128 with 20% spares terminals.</p> <p>(ii) Material and Thickness 4mm thick Fiberglass Reinforced Polyester (FRP).</p> <p>(iii) Type Screwed at all four corners for door. Door gasket shall be of synthetic rubber.</p> <p>(iv) Mounting clamps and accessories Suitable for mounting on walls, columns, structures etc. The brackets, bolts, nuts, screws, glands required for erection shall be of SS, included in Bidders scope of supply.</p> <p>(v) Type of terminal blocks Rail mounted cage-clamp type suitable for conductor size upto 2.5 mm². A M6 earthing stud shall be provided.</p> <p>(vi) Protection Class IP: 55 minimum for indoor & IP-65 minimum for outdoor applications.</p> <p>(vii) Grounding To be provided.</p> <p>(viii) Color RAL 7035</p>			
11.00.00	CONDUITS			
11.01.00	<p>Conduits shall be generally used for interconnecting cables from field instruments to Local JB's. All rigid conduits, couplings and elbows shall be hot dipped galvanised rigid mild steel in accordance with IS: 9537 Part-I (1980) and Part-II (1981). The conduit interior and exterior surfaces shall have continuous zinc coating with an overcoat of transparent enamel lacker or zinc chromate. Flexible conduit shall be heat resistant terne coated steel with , water leak, fire and rust proof protected <i>for the areas of Mills,Drum, Main Steam, RH steam Air Heaters and Furnace, BFPDT's</i> .</p> <p><i>And for remaining applications, water leak, fire and rust proof flexible GI conduits shall be provided.</i> The temperature rating of flexible conduit shall be suitable for actual application.</p>			
11.02.00	All rigid conduit fittings shall conform to the requirements of IS: 2667, 1976. Galvanized steel fitting shall be used with steel conduit. All flexible conduit fittings shall be liquid tight, galvanized steel. The end fittings shall be compatible with the flexible conduit supplied.			
11.03.00	Conduit sealing, explosion proof, dust proof and other types of special fittings shall be provided as required by these specifications and shall be consistent with the area and equipment with which they are installed. Fittings installed outdoors and in damp locations shall be sealed and gasketed. Hazardous area fittings and conduits sealing shall conform with NEC requirements for the area classification.			
11.04.00	Contractor shall provide double locknuts on all conduit terminations not provided with threaded hubs and couplings. Water tight conduit unions and rain tight conduit hubs shall be			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2	SUB-SECTION-III-C4 INSTRUMENTATION CABLES	PAGE 12 OF 13

CLAUSE NO.	TECHNICAL REQUIREMENTS		
11.05.00	<p>utilised for all the application which shall be exposed to weather. Moisture pockets shall be eliminated from conduits.</p> <p>Conduits shall be securely fastened to all boxes and cabinets.</p>		
12.00.00	<p>CABLE SUB-TRAY & SUPPORT</p>		
12.01.00	<p>The cable sub-trays and the supporting system, to be generally used between Local/Group JB's and the main cable trays and the same shall be furnished and installed by the Contractor. It is the assembly of sections and associated fittings forming a rigid structural system used to support the cable from the equipment or instrument enclosure upto the main cable trays (trunk route).</p>		
12.02.00	<p>The covers on the cable sub-trays shall be used for protection of cables in areas where damage may occur from falling objects, welding spark, corrosive environment, etc. & shall be electrically continuous and solidly grounded.</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.:CS-0011-109(1A)-2</p>	<p>SUB-SECTION-III-C4 INSTRUMENTATION CABLES</p>	<p>PAGE 13 OF 13</p>





C&I SPECIFICATION FOR
HVAC SYSTEM


SECTION: C
SUB SECTION: C&I

INSTRUMENT STUB DETAILS

PRESS. MEASUREMENT

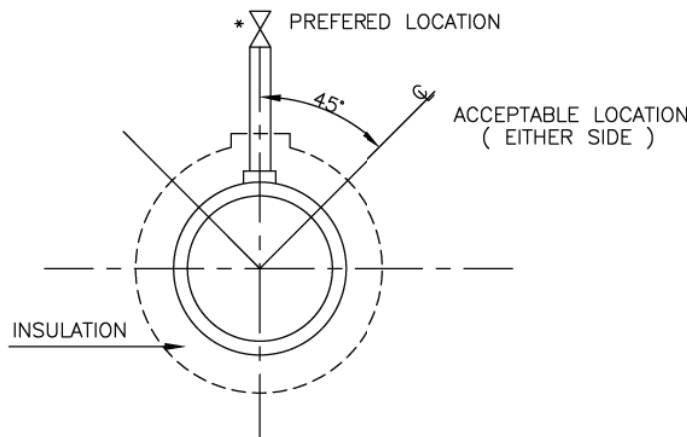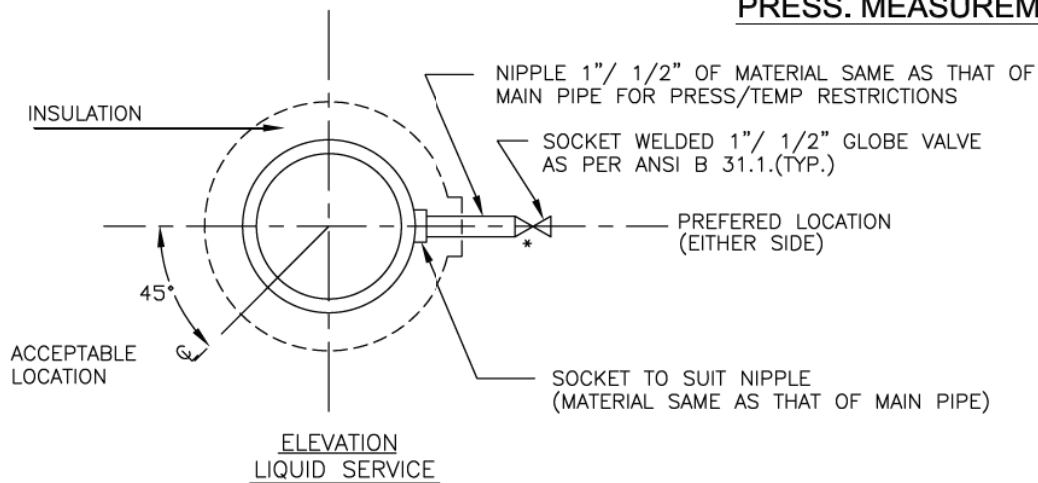

**ELEVATION
STEAM SERVICE**
PRESSURE CONNECTION ON HORIZONTAL PIPE

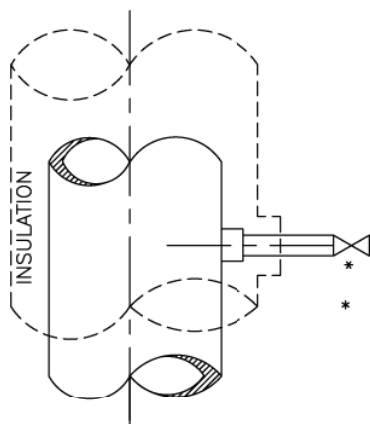

**ELEVATION
LIQUID OR STEAM SERVICE**
PRESSURE CONNECTIONS ON VERTICAL PIPES

* USE DOUBLE ISOLATION VALVES FOR PRESSURE EQUAL TO OR EXCEEDING 40 Kg/Cm2.

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION



PROJECT										TYPICAL THERMAL POWER PROJECT					
TITLE										INSTRUMENT SOURCE CONNECTION DETAILS					
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD.	DATE	SIZE	SCALE	DRG. NO.	REV. NO.
A	FIRST ISSUE										21.08.12	25A4	N.T.S.	0000-999-POI-A-035	A

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

PRESSURE MEASUREMENT



(SYSTEM PR.>40Kg/Sq Cm CL 9000)

(SYSTEM PR.>40Kg/Sq Cm CL 6000)

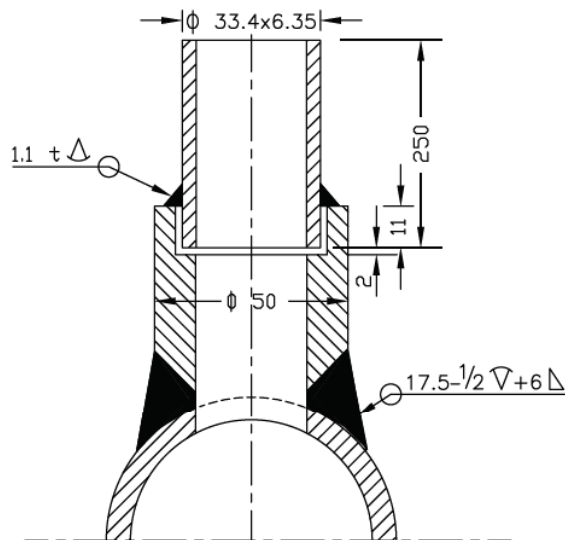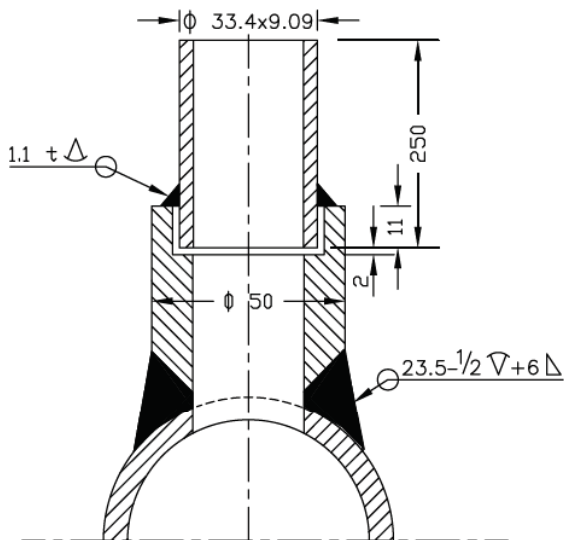

(SYSTEM PR. <40Kg/Sq cm Nb 25 CL 3000)

(SYSTEM PR. <40Kg/Sq cm Nb 15 CL 3000)

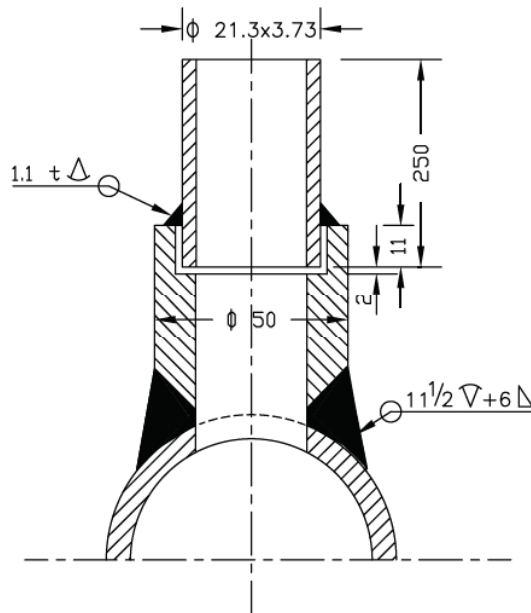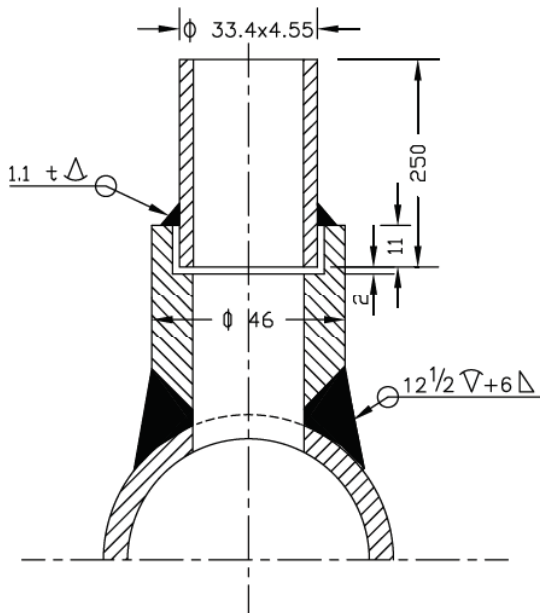


NOTES:-

1. MATERIAL OF THE BOSS AND NIPPLE SHALL BE THE SAME AS THE PIPE INTO WHICH IT IS WELDED AND CONFIRM TO ANSI B 16.11.
2. THE LENGTH OF THE NIPPLE SHOULD BE 250mm.
3. THE OTHER END OF THE NIPPLE SHALL BE SOCKET WELDED WITH 1" GLOBE VALVE OF MATERIAL AS PER ANSI B 16.1.
4. TWO ISOLATED VALVES ARE TO BE USED FOR PRESSURE = >40 Kg/Cm2.
5. EDGE HOLE MUST BE CLEAN AND SQUARE OR ROUNDED SLIGHTLY (1/64" RADIUS) FREE FROM BURRS, WIRE EDGES OR OTHER IRREGULARITIES.
6. ORIENTATION OF TAP WILL BE VARY WITH TYPE OF PROCESS FLUID AND NATURE OF RUN OF THE PIPE.
7. ACTIVITIES TO BE COMPLETED AT THE SHOP, WELD THE COUPLING (OR BOSS) ON THE PIPE AND DRILL PRESSURE CONNECTION HOLE (SAME AS I D OF NIPPLE) IN THE PIPE IN ALLIGNMENT WITH HOLE IN THE COUPLING.
8. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.


FOR TENDER PURPOSE ONLY

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

										 NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION	
PROJECT										TYPICAL THERMAL POWER PROJECT	
TITLE										INSTRUMENT SOURCE CONNECTION DETAILS	
A	FIRST ISSUE								T.G.		
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD.	DATE
											31.08.18
Cleared by										SIZE	SCALE
Page 317 of 325A4										DRG. NO.	REV. NO.
										0000-999-POI-A-035	A
										Sh-2 Of 14	

PRESS. MEASUREMENT

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

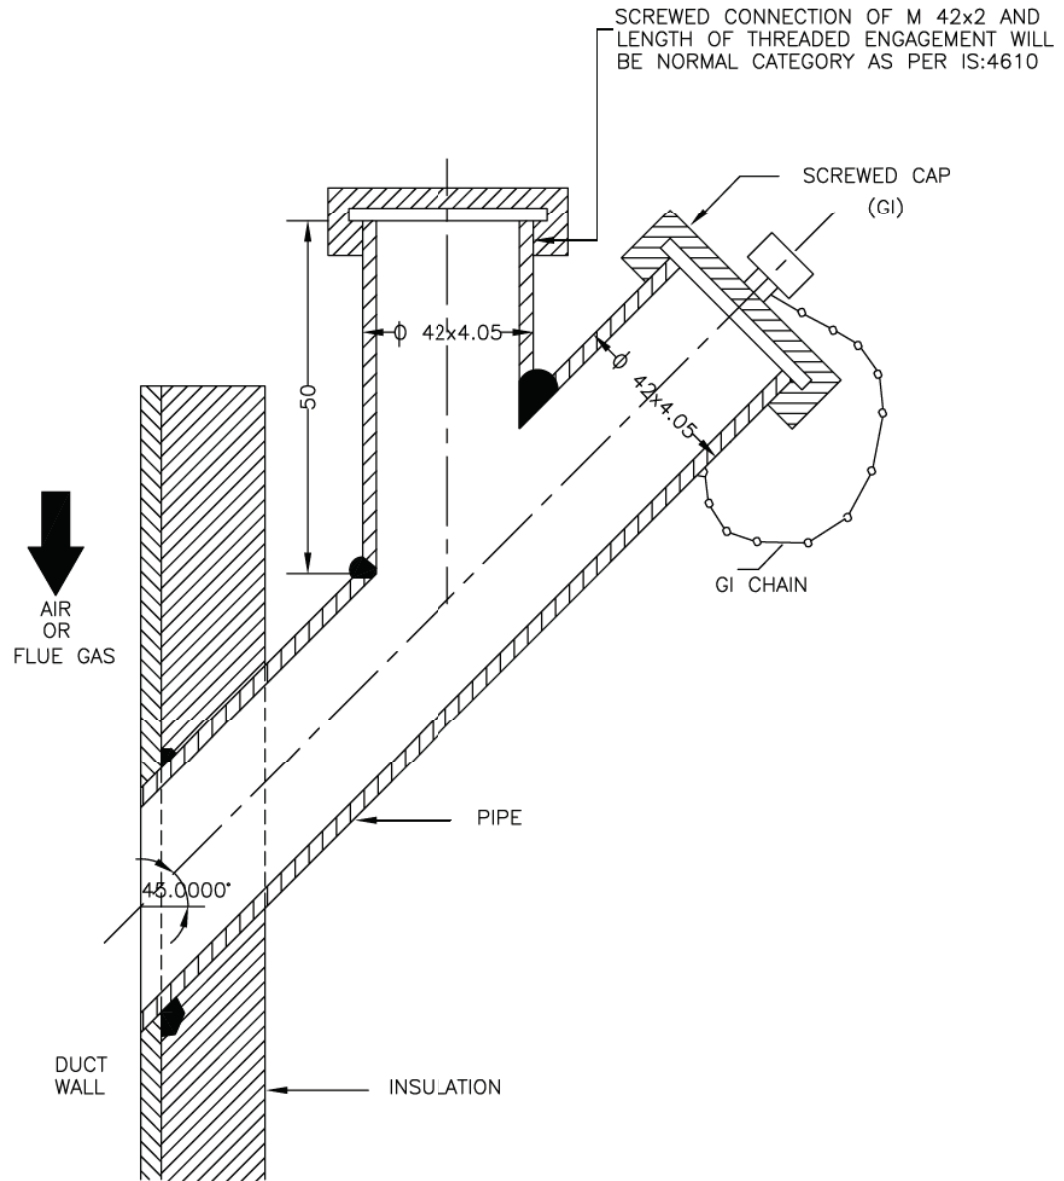

NOTES:-

1. THIS TYPE OF PRESSURE CONNECTOR SHALL BE PROVIDED FOR PRESSURE MEASUREMENTS IN AIR AND FLUE GAS DUCT/FURNACE.
2. DIMENSIONS ARE INDICATIVE ONLY.

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION


PROJECT **TYPICAL THERMAL POWER PROJECT**

TITLE **INSTRUMENT SOURCE CONNECTION DETAILS**

REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD.	DATE	T.G.	31.08.12
A	FIRST ISSUE												

SIZE	SCALE	DRG. NO.	0000-999-POI-A-035	REV. NO.	A
25A4	N.T.S.				


TEMP. MEASUREMENT

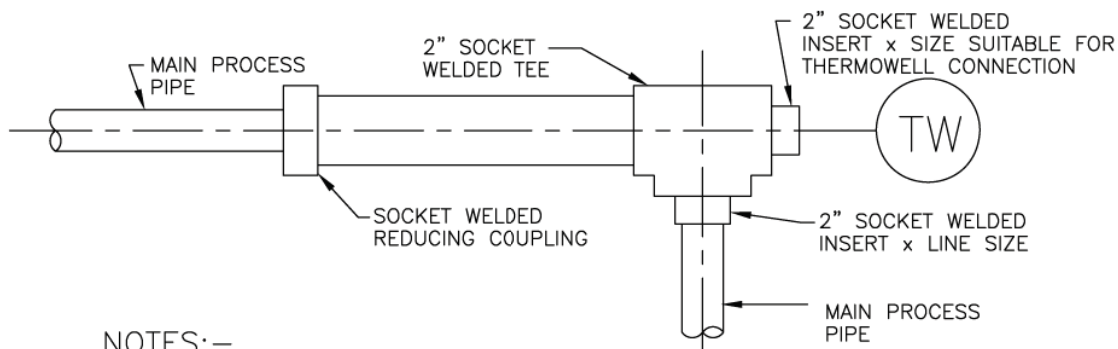

NOTES:-

1. THIS TYPE OF THERMOWELL INSTALLATION IS SUITABLE FOR THE PROCESS PIPE OF 2" NPS AND SMALLER.
2. FOR STEAM SERVICE THIS TYPE OF THERMOWELL INSTALLATION 90° BEND MAY BE USED ONLY IN VERTICAL PLANE.
3. THE LENGTH OF THE LARGER PIPE SECTION SHALL BE MINIMUM 150mm (IT MUST BE GREATER THAN THERMOWELL LENGTH).

THERMOWELL SUITABLE FOR THE BOSS

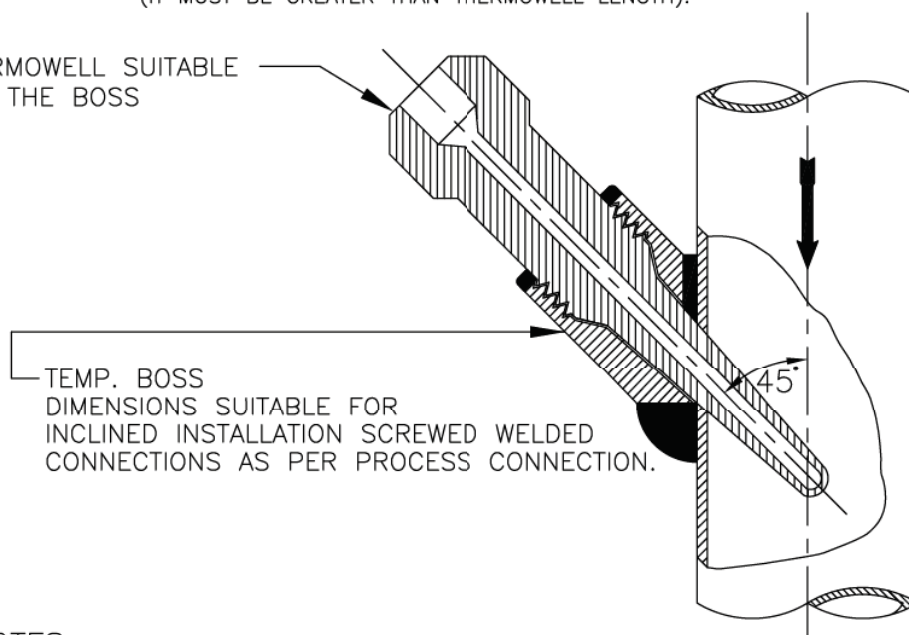

NOTES:-

1. INCLINED INSTALLATION OF THERMOWELL SHALL BE APPLICABLE FOR 4" AND SMALLER LINE SIZE BUT LIMITED TO MIN. 3" LINE SIZE.
2. FOR 2" AND SMALLER LINE SIZE NECESSARY EXPANDER OF MIN. 3" SIZE OF MAIN PIPING SPECIFICATION SHALL BE USED.
3. THIS TYPE OF INSTALLATION IS APPLICABLE FOR HORIZONTAL AND VERTICAL PIPE SECTION.
4. FOR STEAM SERVICES EXPANDER SECTION MAY BE USED ONLY IN VERTICAL RUN.
5. THE EXPANDER SECTION SHALL BE OF ADEQUATE LENGTH (ATLEAST 3-4 TIMES DIA OF THE MAIN PROCESS PIPE AT BOTH SIDE OF THE INSTALLED THERMOWELL).

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION


PROJECT **TYPICAL THERMAL POWER PROJECT (SG PACKAGE)**

TITLE **INSTRUMENT SOURCE CONNECTION DETAILS**

REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD.	DATE	SIZE	SCALE	DRG. NO.	REV. NO.
A	FIRST ISSUE										31.08.19	25A4	N.T.S.	0000-999/102-POI-A-035	A

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

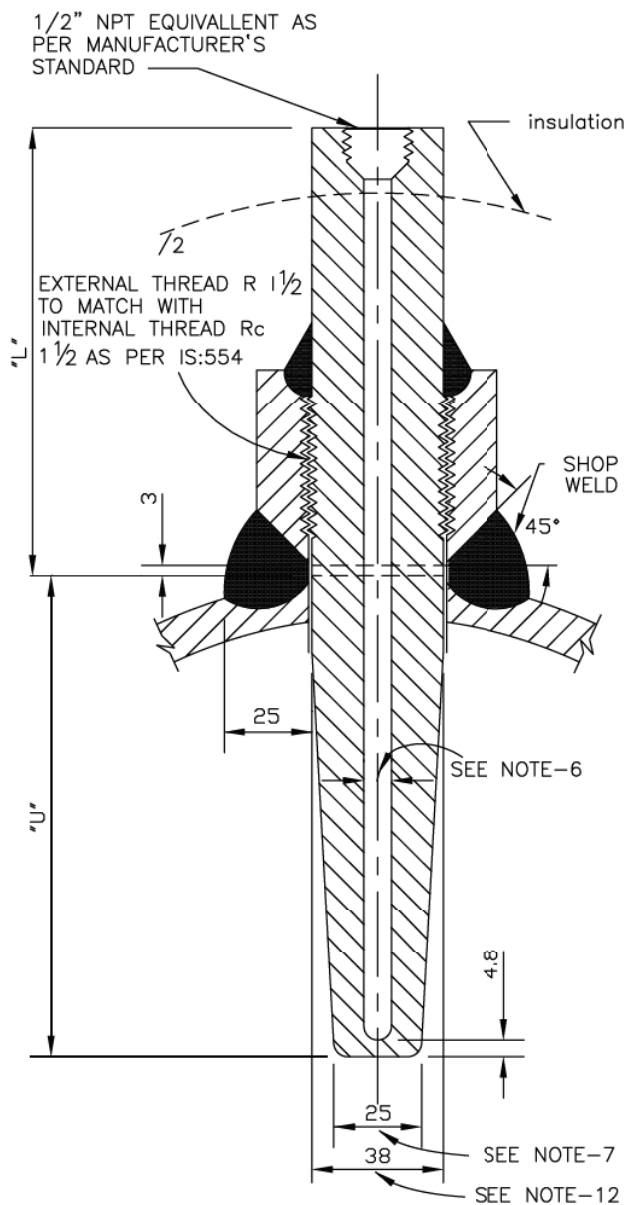

NOTES:-


1. THIS TYPE OF TEMPERATURE BOSS SHALL BE USED FOR THE PROCESS PRESS EQUAL/ABOVE 40 Kg/Cm2(g).
2. THE MATERIAL OF THE BOSS SHOULD BE SIMILAR TO THAT OF PIPING MATERIAL OF SPECIFICATION.
3. ALL WELD TO BE TESTED IN ACCORDANCE WITH APPLICABLE CODES BY MANUFACTURER.
4. MATERIAL OF THE THERMOWELL SHALL BE OF 316SS.
5. THERMOWELL SHALL BE DRILLED BARSTOCK TYPE.
6. INTERNAL BORE OF THE THERMOWELL SHOULD BE SELECTED BASED ON THE NORMAL SIZE OF THE SENSING ELEMENT AS PER ASME,PTC-19.3.
7. THE BOTTOM DIAMETER OF THE THERMOWELL TYPICALLY SHOWN HERE SHALL BE SUBJECT TO VARIATION BASED ON THE INTERNAL BORE OF THERMOWELL AND THICKNESS OF THERMOWELL MATERIAL TO WITHSTAND THE PROCESS PRESS.AND TEMP.,AS PER ASME,PTC-19.3.
8. THE TYPE OF TAPERED THERMOWELL SHALL BE USED FOR LIQUID VELOCITIES UP TO 92M.P.S.(300F.T.P.S.).
9. THERMOWELL WITH THE INSULATION LAG EXTENSIONS SHALL BE USED WHEREVER APPLICABLE.
10. ACTIVITIES TO BE COMPLETED AT THE SHOP. WELD THE BOSS ON THE PIPE AND DRILL THE HOLE IN THE PIPE IN ALIGNMENT WITH HOLE IN THE BOSS. PROVIDE INTERNAL THREAD AS PER IS:554 TO MATCH WITH THE THERMOWELL EXTERNAL THREAD.
11. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE STATED.
12. WILL BE SUITABLE TO MATCH THE STUB DIMENSIONS AS PER RC 1 1/2
13. THE "U" & "L" DIMENSIONS SHALL BE SELECTED BASED ON PARTICULAR APPLICATION AND THE SAME SHALL BE SUBJECT TO OWNER'S APPROVAL DURING DETAILED ENGINEERING.
14. ALL DIMENSIONS ARE INDICATIVE ONLY.

FOR TENDER PURPOSE ONLY

NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT TYPICAL THERMAL POWER PROJECT											
TITLE INSTRUMENT SOURCE CONNECTION DETAILS											
A	FIRST ISSUE								T.G.	01.08.12	
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD.	DATE
SIZE 25A4 SCALE N.T.S. DRG. NO. 0000-999-POI-A-035 REV. NO. A											

TEMP. MEASUREMENT

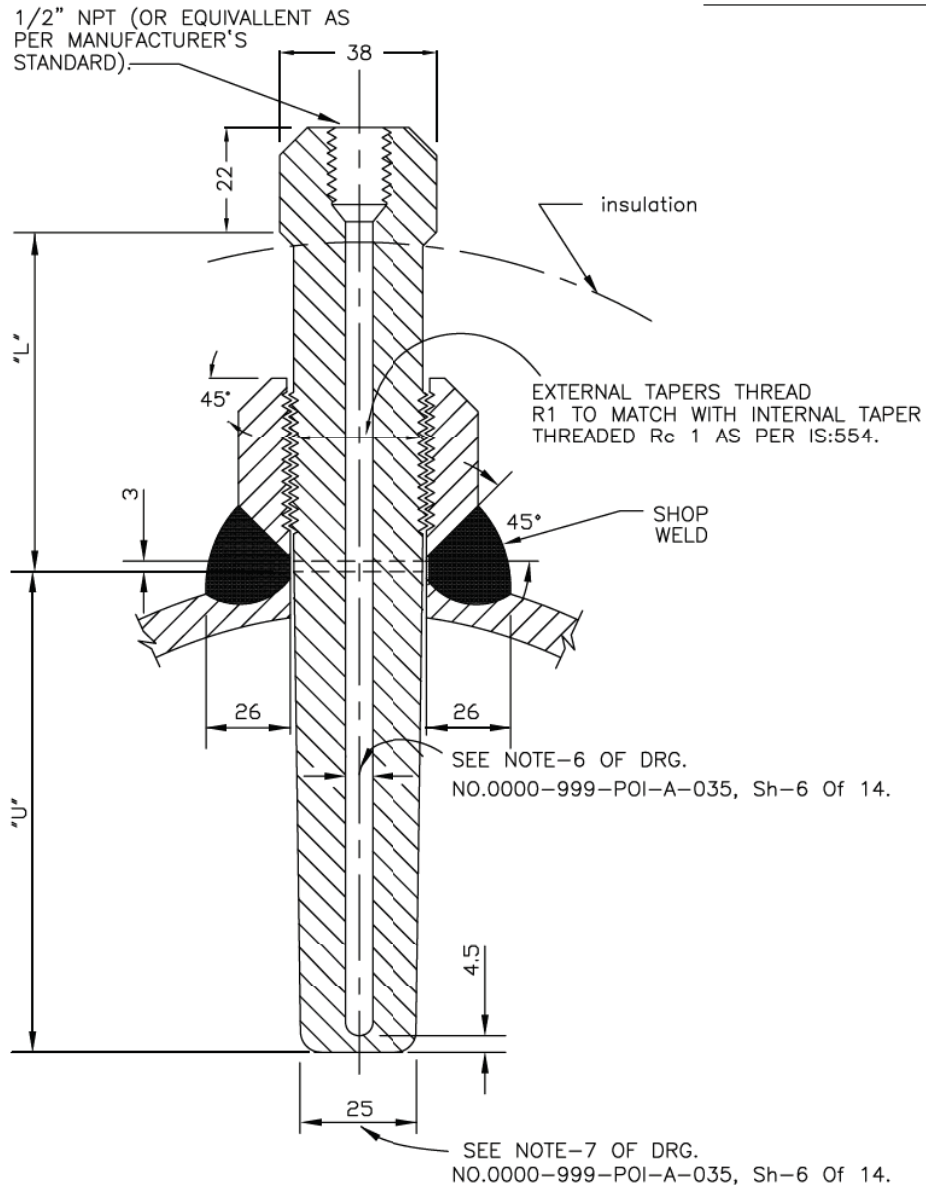

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

NOTES:-

1. THIS TYPE OF TEMPERATURE BOSS IS APPLICABLE FOR THE PROCESS PRESSURE/TEMPERATURE BELOW 40 Kg/Cm2(g)/400°C
2. FOR PRESSURE TIGHT JOINTS THE BOSS SHOULD HAVE INTERNAL TAPERED PIPE THREAD Rc 1 AS PER IS:554. THE LENGTH OF THREAD ENGAGEMENT SHOULD BE AS PER ABOVE STANDARD.
3. PIPES HAVING PROBABILITY OF PROLONGED VIBRATION SEAL WELDING MAY BE DONE ALL AROUND AFTER TIGHTENING THERMOWELL WITHIN THE BOSS.
4. SEE NOTES-2 TO 14 OF DRG. NO. 0000-999-POI-A-035, Sh-6 Of 14.

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION


PROJECT TYPICAL THERMAL POWER PROJECT

TITLE INSTRUMENT SOURCE CONNECTION DETAILS

REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD.	DATE	SIZE	SCALE	DRG. NO.	REV. NO.
A	FIRST ISSUE										21.08.18	25A4	N.T.S.	0000-999-POI-A-035	A

TEMP. MEASUREMENT

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

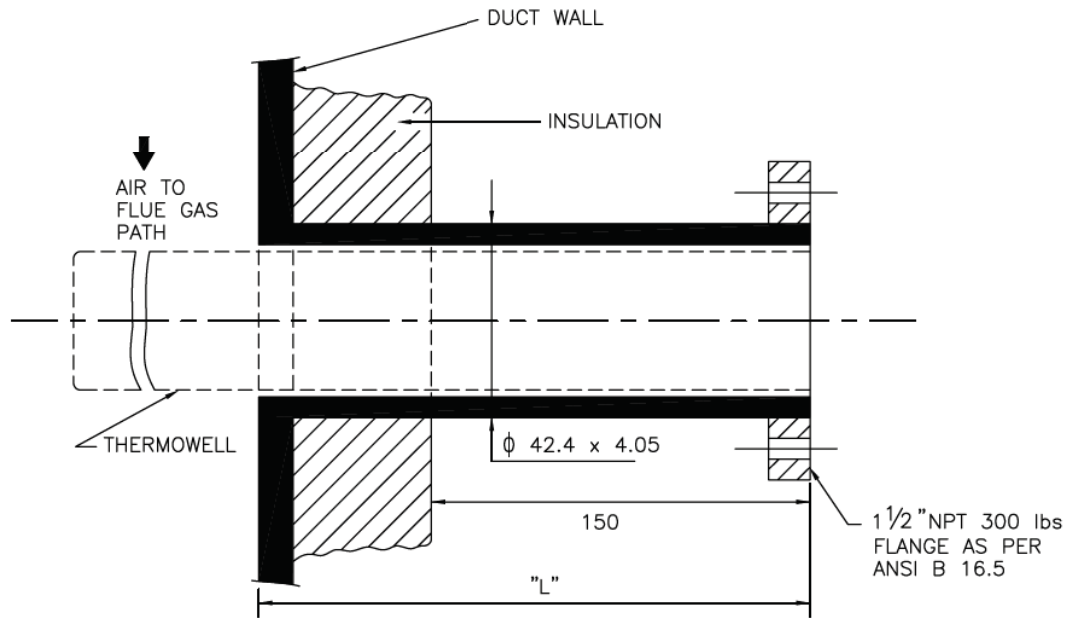

NOTES:-

1. THIS TYPE OF TEMPERATURE CONNECTIONS SHALL BE PROVIDED FOR TEMPERATURE MEASUREMENT IN AIR AND FLUE GAS DUCT.
2. MATERIAL OF THERMOWELL SHALL BE OF 316SS.
3. EXTERNAL CONNECTION SHALL BE OF SLIP ON FLANGED TYPE AND THERMOWELL DESIGN SHALL BE AS PER ASME.PTC-19.3 (REFER NOTES 9&10 OF DRG.NO. 0000-999-POI-A-035, Sh-6 Of 14).
4. BIDDER TO SUPPLY AND INSTALL THE COUNTER FLANGED AND THERMOWELL (ALONG WITH TEMP. ELEMENT).
5. ALL DIMENSIONS ARE INDICATIVE ONLY.


FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION


PROJECT										TYPICAL THERMAL POWER PROJECT					
TITLE										INSTRUMENT SOURCE CONNECTION DETAILS					
A	FIRST ISSUE							T.G.		21.08.12	SIZE	SCALE	DRG. NO.	REV. NO.	
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD.	DATE	25A4	N.T.S.	0000-999-POI-A-035	A
Cleared by										Page 323 of 525		Sh-8 Of 14			

LEVEL MEASUREMENT

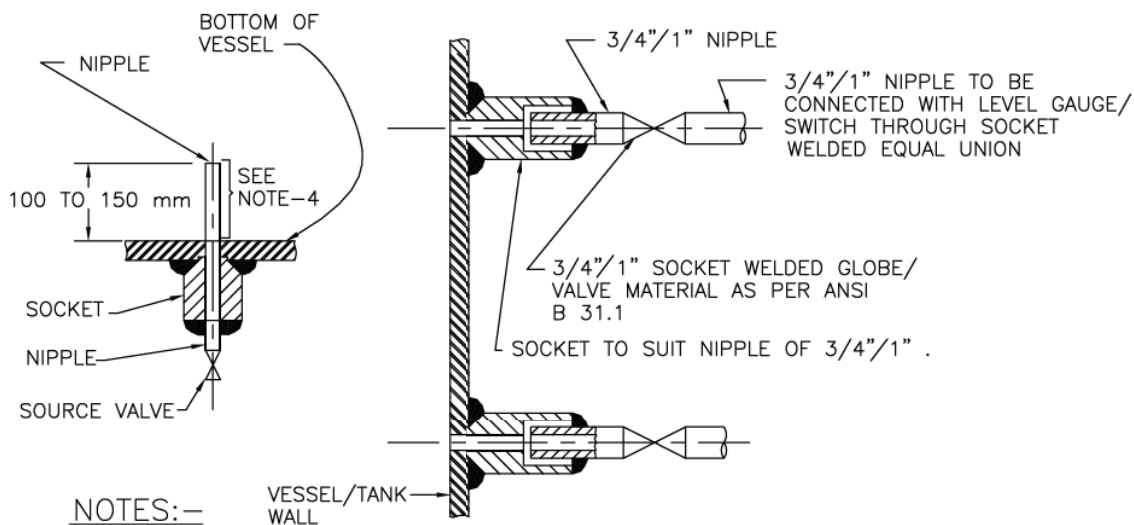

NOTES:-

1. THIS TYPE OF PROCESS CONNECTION SHALL BE USED FOR LEVEL GAUGE AND EXTERNAL CAGE TYPE FLOAT OR DISPLACER OPERATED LEVEL SWITCH.
2. FOR GAUGES 3/4" NIPPLE ALONG WITH 3/4" SW SOURCE VALVE AND FOR SWITCHES 1" NIPPLE ALONG WITH 1" SW SOURCE VALVE SHALL BE PROVIDED AS PROCESS CONNECTION.
3. SOURCE CONNECTION ON VESSEL SHOULD NOT BE LOCATED AT PLACES SUBJECTED TO INTERFACE AND TURBULENCE FROM INLETS AND OUTLETS.
4. IF LOWER CONNECTION IS TAKEN FROM BOTTOM OF THE VESSEL THEN THE NIPPLE MUST BE 100 mm TO 150 mm ABOVE THE BOTTOM OF THE VESSEL.

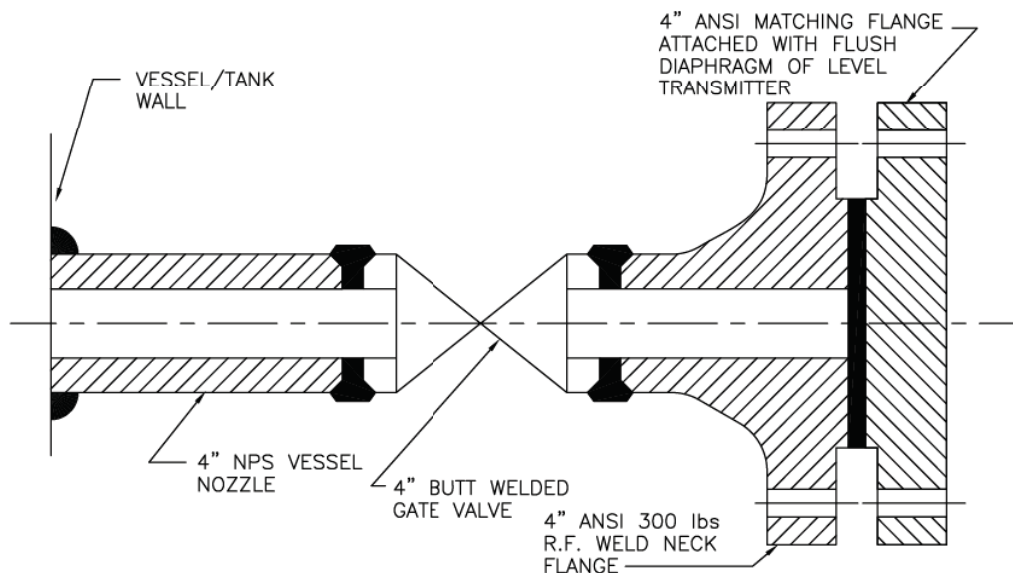

NOTES:-

1. THIS TYPE OF PROCESS CONNECTION SHALL BE PROVIDED FOR TANK LEVEL MEASUREMENT OF VISCOUS OR CORROSIVE LIQUID USING FLUSH DIAPHRAGM/WAFER TYPE LEVEL TRANSMITTER.
2. WELDING OF MATCHING FLANGE TO GATE VALVE SHALL BE DONE BY BIDDER.

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT **TYPICAL THERMAL POWER PROJECT**

TITLE **INSTRUMENT SOURCE CONNECTION DETAILS**


A	FIRST ISSUE								T.G.	31.08.12	
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD.	DATE

SIZE	SCALE	DRG. NO.	REV. NO.
25A4	N.T.S.	0000-999-POI-A-035	A

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

LEVEL MEASUREMENT

This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

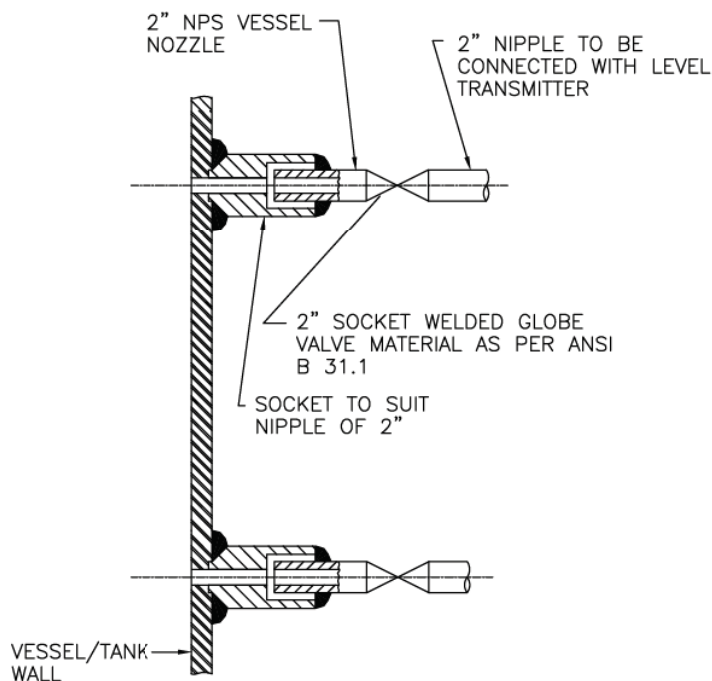

NOTES:-

1. THIS TYPE OF PROCESS CONNECTION SHALL BE USED FOR DISPLACER TYPE LEVEL TRANSMITTER.
2. SOURCE CONNECTION ON VESSEL SHOULD NOT BE LOCATED AT PLACES SUBJECTED TO INTERFACE AND TURBULENCE FROM INLETS AND OUTLETS.
3. IF LOWER CONNECTION IS TAKEN FROM BOTTOM OF THE VESSEL THEN THE NIPPLE MUST BE 100 mm TO 150 mm ABOVE THE BOTTOM OF THE VESSEL.

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION


PROJECT TYPICAL THERMAL POWER PROJECT														
TITLE INSTRUMENT SOURCE CONNECTION DETAILS														
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH. APPD. DATE	SIZE	SCALE	DRG. NO.	REV. NO.	
A	FIRST ISSUE								T.G.	31.08.12	25A4	N.T.S.	0000-999-POI-A-035	A
Cleared by										Sh-14 of 14				



**C&I SPECIFICATION FOR
HVAC SYSTEM**

SECTION: C
SUB SECTION: C&I


INSTRUMENT INSTALLATION DRAWING

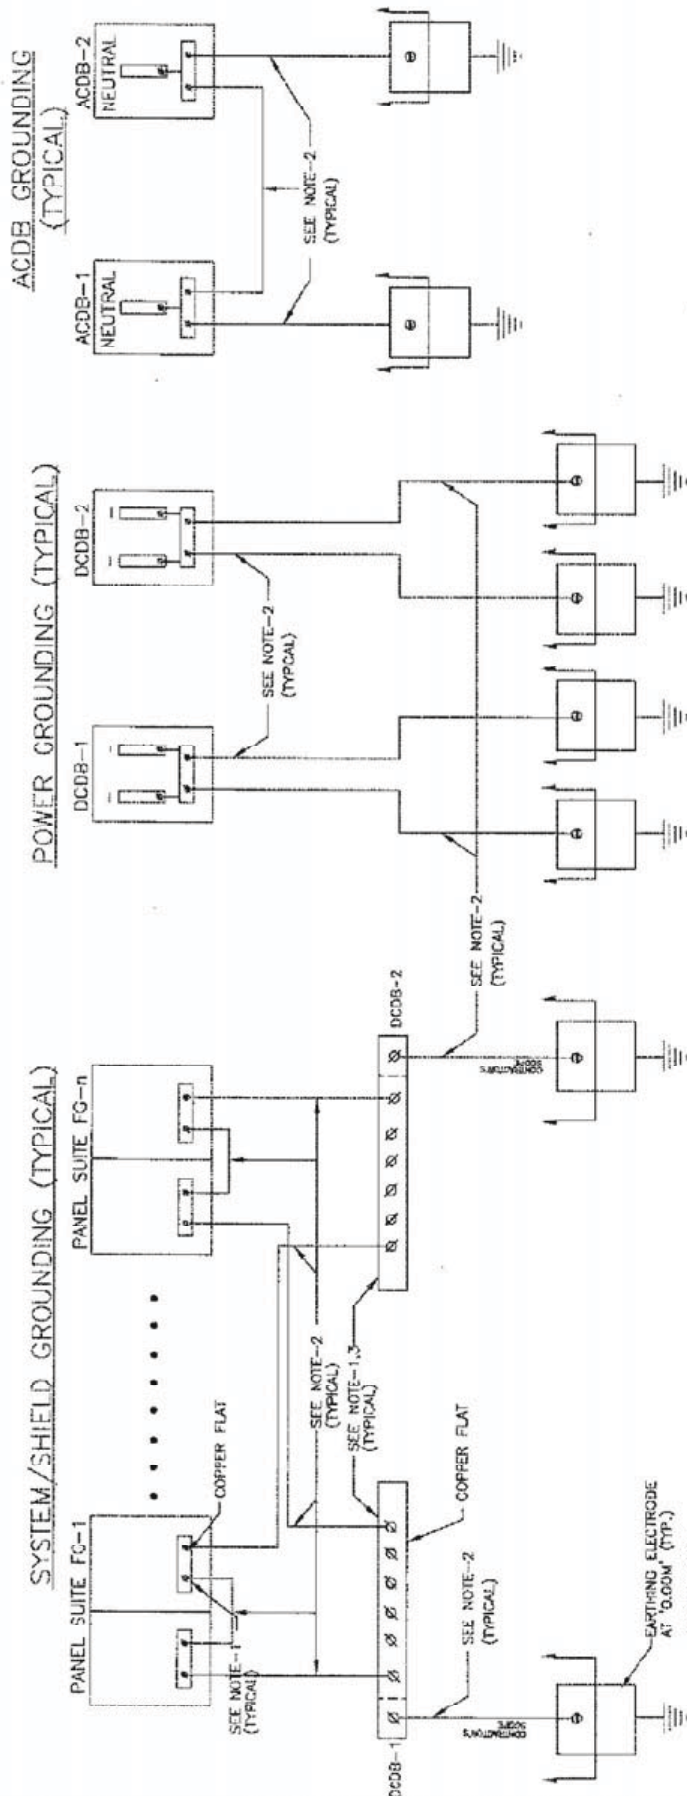

NOTES:--


1. SUPPLY, ERECTION, TERMINATION OF CABLES, FLATS ETC. REQUIRED FOR PROPER GROUNDING OF CONTRACTOR'S CONTROL SYSTEM, SYSTEM CABINETS, POWER SUPPLY CABINETS ETC. ARE IN THE SCOPE OF CONTRACTOR.
2. CABLE IN CONTRACTOR'S SCOPE.
3. TO BE LOCATED IN DCDB.
4. EXACT LOCATION, ARRANGEMENTS OF FLATS ETC. SHALL BE AS FINALISED WITH CONTRACTOR. DURING DETAILED ENGINEERING.
5. CABINET BODY, CABINET BOTTOM PLATE, CABINET DOORS ARE TO BE CONNECTED TO PANEL EARTH FLAT COPPER CABLE BY CONTRACTOR.

FOR TENDER PURPOSE ONLY

 NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION		PROJECT		TYPICAL THERMAL POWER PROJECT	
		TITLE		INSTRUMENTATION CABLING DIAGRAM GROUNDING SCHEME FOR CABINETS / PANELS / POWER SUPPLY	
REV. NO.	SIZE	SCALE	DRG. NO.	REV. NO.	
A	A3	N.I.S.	0000-999-PO-A-019A	A	
DESCRIPTION			DATE	21.08.12	
DRAWN DESIGN CHRD.			APPRO		
Cleared By			ARCH.		
			C&E		
			M		
			E		
			C		

No part of this document will be reproduced by any means without the written permission. This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.


GROUNDING FOR EACH ROW OF PANELS
(TYPICAL)

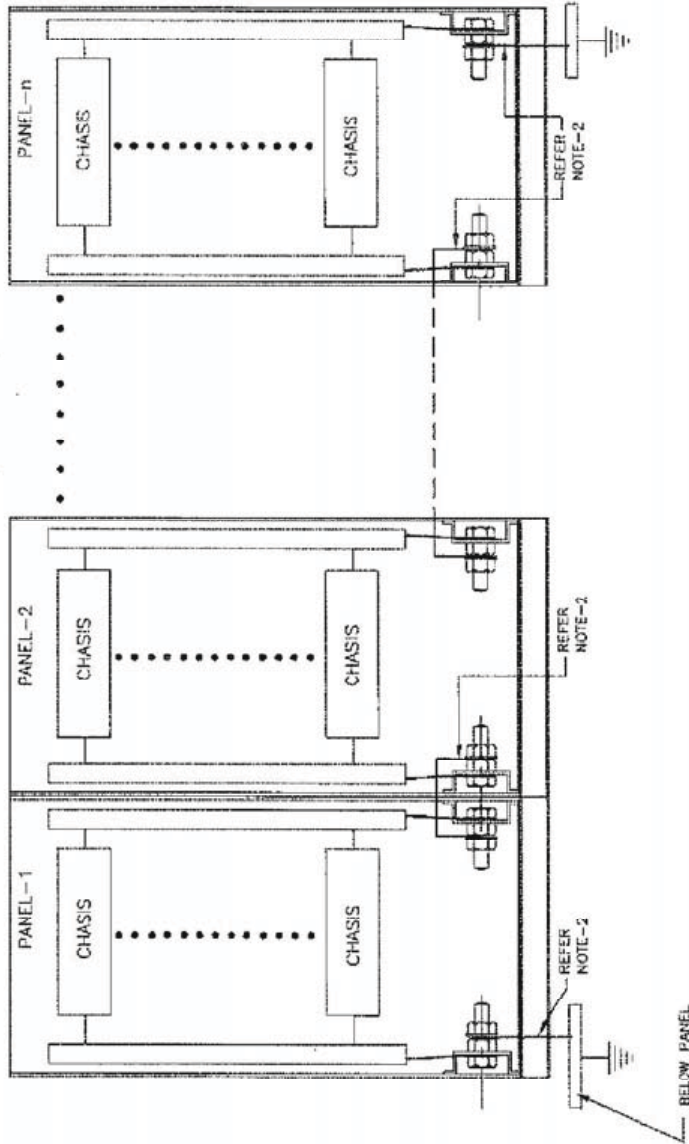

NOTES:-

1. SUPPLY, ERECTION, TERMINATION OF CABLES, FLATS ETC. REQUIRED FOR PROPER GROUNDING OF CONTRACTOR'S CONTROL SYSTEM, SYSTEM CABINETS, POWER SUPPLY CABINETS ETC. ARE IN THE SCOPE OF CONTRACTOR.
2. CABLE IN CONTRACTOR'S SCOPE.
3. TO BE LOCATED IN DCDB.
4. EXACT LOCATION, ARRANGEMENTS OF FLATS ETC. SHALL BE AS FINALISED WITH CONTRACTOR. DURING DETAILED ENGINEERING.
5. CABINET BODY, CABINET BOTTOM PLATE, CABINET DOORS ARE TO BE CONNECTED TO PANEL EARTH FLAT COPPER CABLE BY CONTRACTOR.

FOR TENDER PURPOSE ONLY





NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT TYPICAL THERMAL POWER PROJECT		TITLE INSTRUMENTATION CABLING DIAGRAM		REV. NO. A	
GROUNDING SCHEME FOR CABINETS / PANELS / POWER SUPPLY		SCALE A3		DRG. NO. 0000-999-POI-A-019A	
DATE 21.08.12		APPD [Signature]		REV. NO. A	
DRAWN DESIGN CHKD. [Signature]		M E C [Signature]		SH-2 OF 2	
DESCRIPTION		CLEARED BY		N.T.S.	

LIST OF MATERIALS

ITEM NO.	DESCRIPTION
1.	1/2" 3/4" 1" NPS SCH 40/80/160/WYS/PROT (AS PER PROCESS REQUIREMENT) NIPPLE OF MATERIAL SAME AS THAT OF MAIN PIPE.
2.	1/2"/3/4"/1" SW GLOBE VALVE/GATE VALVE
3.	3/4" / 1" x 1/2" SW REDUCING INSERT
4.	1/2" / 3/4" PIPE
5.	1/2" / 3/4" SW EQUAL TEE
6.	1/2" / 3/4" SW GLOBE VALVE
7.	1/2" / 3/4" NPS SW x 1/2" / 3/4" NPT(M) CARBON/ALLOY STEEL NIPPLE.
8.	1/2" / 3/4" NPT(F) CAP.
9.	1/2" / 3/4" PIPE UNION.
10.	6" SS SYPHON
11.	1/2" BLIND 300lbs RT ANSI FLANGE DRILLED AND TAPED FOR 1" NPT PIPE.
12.	SUITABLE ADAPTER.
13.	1/4" CHROME MOLY STEEL TUBE.
14.	
15.	1"/3/4" SW EQUAL TEE.
16.	DIAPHRAGM(WATER ELEMENT)
17.	ISOLATION VALVE 316 SS,1/4"SW

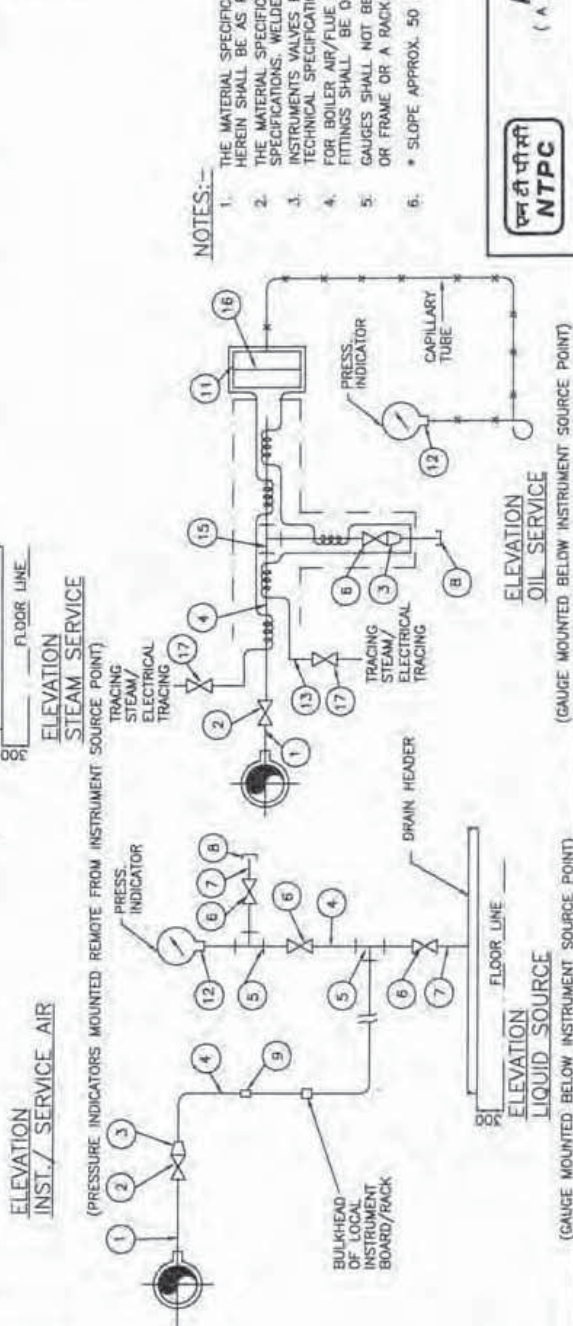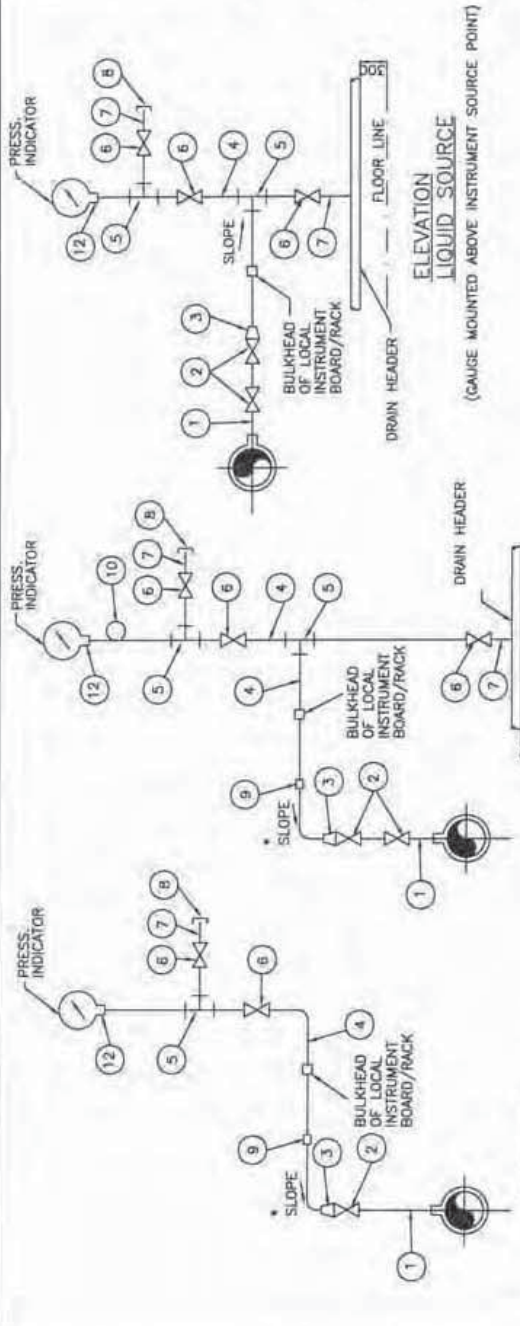

NOTES:-

1. THE MATERIAL SPECIFICATION AND SCHEDULE NO. OF IMPULSE PIPE & NIPPLE AS LISTED HEREIN SHALL BE AS PER TECHNICAL SPECIFICATIONS.
2. THE MATERIAL SPECIFICATION AND RATING OF FITTINGS AS LISTED SHALL BE AS PER SPECIFICATIONS. WELDED/THREADED FITTINGS SHALL CONFORM TO ANSI-B.16-11.
3. INSTRUMENTS VALVES BODY STEM MATERIAL AND PRESSURE CLASS SHALL BE AS PER TECHNICAL SPECIFICATIONS.
4. FOR BOILER AIR/FLUE GAS SERVICES SOURCE CONNECTIONS IMPULSE PIPING AND ALL FITTINGS SHALL BE OF 3/4" NB SIZE.
5. GAUGES SHALL NOT BE MOUNTED ON THE PIPE. IT WILL BE MOUNTED ON A CHANNEL OR FRAME OR A RACK...
6. * SLOPE APPROX. 50 MM / METRE.

FOR TENDER PURPOSE ONLY




NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT	TYPICAL THERMAL POWER PROJECT		
TITLE	INSTRUMENT INSTALLATION DIAGRAM (FOR PRESSURE GAUGE)		
REV. NO.	A	DRG. NO.	0000-999-POI-A-022
SCALE	N.T.S.	SIZE	A3
DATE	21.08.12	APPD	
DESIGN CHKD.	M	C&I ARCH.	
CHECKED BY		C&I	
DESCRIPTION	FIRST ISSUE		

No part of this document will be reproduced by any means without the written permission. This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.

LIST OF MATERIALS


ITEM NO.	DESCRIPTION
1.	1/2" / 3/4" NPS SCH. 80/160 XXS/PS1 NIPPLE OF MATERIAL SAME AS THAT OF MAIN PIPE.
2.	3/4" / 1" SW GLOBE VALVE.
3.	3/4" / 1" TO 1/2" REDUCING INSERT
4.	1/2" NPS PIPE
5.	1/2" SW EQUAL TEE
6.	1/2" SW GLOBE VALVE
7.	1/2" NPS SCH. 80/160 SW x 1/2" CS/AS COUPLER
8.	1/2" PIPE UNION
9.	2/3 VALVE MANIFOLD (FOR DETAIL SEE DRAWING NO.0000-102-POI-A-023.
10.	SUITABLE ADAPTER
11.	SS TUBE
12.	1/2" PIPE x 1/2" TUBE UNION
13.	1/2" NPS SCH. 80/160 SW x 1/2" NPT(M) CS/AS NIPPLE

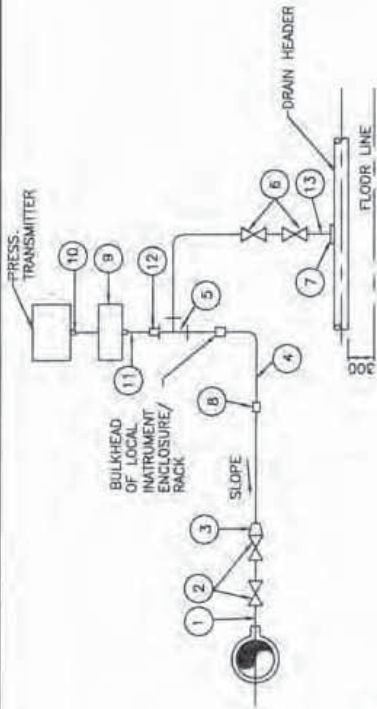

ELEVATION TRANSMITTER MOUNTED ABOVE INSTRUMENT SOURCE POINT LIQUID PRESSURE MEASUREMENT



ELEVATION TRANSMITTER MOUNTED BELOW INSTRUMENT SOURCE POINT LIQUID PRESSURE MEASUREMENT

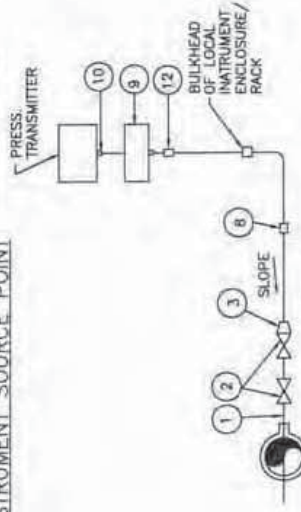

ELEVATION TRANSMITTER MOUNTED ABOVE INSTRUMENT SOURCE POINT VACUUM PRESSURE MEASUREMENT

NOTES:-

1. SAME NOTES UNDER DRG. NO. 0000-999-POI-A-023.
2. FOR VACUUM APPLICATION OTHER PORT OF TRANSMITTER SHALL BE KEPT OPEN TO ATMOSPHERE.

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT

TYPICAL THERMAL POWER PROJECT

TITLE


INSTRUMENT INSTALLATION DIAGRAM
(PRESSURE MEASUREMENT USING PRESS /DP TRANSMITTERS STEAM/LIQUID VACUUM)

SIZE SCALE DRG. NO. REV. NO.
A3 N.T.S. 0000-999-POI-A-025 A

DATE	APPD	ARCH.	CHECKED BY
21.08.12			

REV. NO.	DESCRIPTION
A	FIRST ISSUE

No part of this document will be reproduced by any means without the written permission. This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.

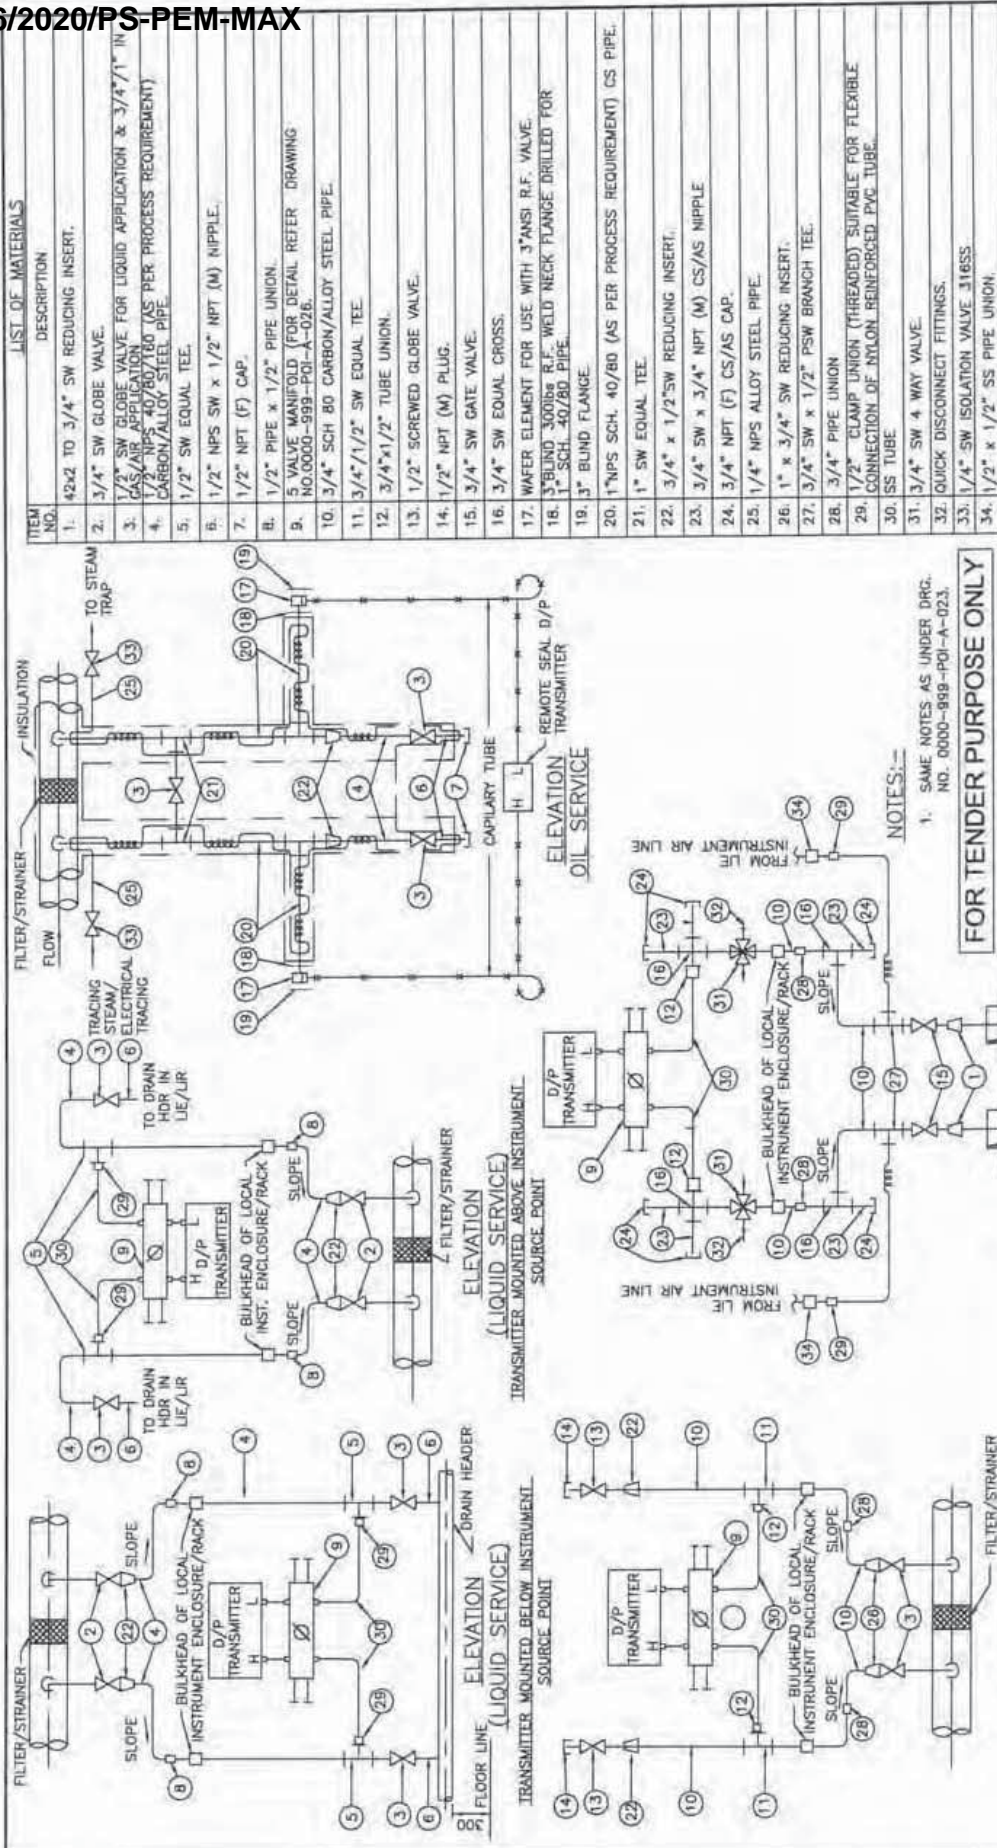

LIST OF MATERIALS	
ITEM NO.	DESCRIPTION
1.	42x2 TO 3/4" SW REDUCING INSERT.
2.	3/4" SW GLOBE VALVE.
3.	1/2" SW GLOBE VALVE FOR LIQUID APPLICATION & 3/4"/1" IN 1/2" NPS 40/80/160 (AS PER PROCESS REQUIREMENT)
4.	CARBON/ALLOY STEEL PIPE
5.	1/2" SW EQUAL TEE.
6.	1/2" NPS SW x 1/2" NPT (M) NIPPLE.
7.	1/2" NPT (F) CAP.
8.	1/2" PIPE x 1/2" PIPE UNION.
9.	5 VALVE MANIFOLD (FOR DETAIL REFER DRAWING NO.0000-999-POI-A-026.
10.	3/4" SCH 80 CARBON/ALLOY STEEL PIPE.
11.	3/4"/1/2" SW EQUAL TEE.
12.	3/4"x1/2" TUBE UNION.
13.	1/2" SCREWED GLOBE VALVE.
14.	1/2" NPT (M) PLUG.
15.	3/4" SW GATE VALVE.
16.	3/4" SW EQUAL CROSS.
17.	WAFER ELEMENT FOR USE WITH 3"ANSI R.F. VALVE.
18.	3"BLIND 3000LB R.F. WELD NECK FLANGE DRILLED FOR 1" SCH. 40/80 PIPE.
19.	3" BLIND FLANGE.
20.	1"NPS SCH. 40/80 (AS PER PROCESS REQUIREMENT) CS PIPE.
21.	1" SW EQUAL TEE.
22.	3/4" x 1/2"SW REDUCING INSERT.
23.	3/4" SW x 3/4" NPT (M) CS/AS NIPPLE.
24.	3/4" NPT (F) CS/AS CAP.
25.	1/4" NPS ALLOY STEEL PIPE.
26.	1" x 3/4" SW REDUCING INSERT.
27.	3/4" PIPE UNION
28.	3/4" SW BRANCH TEL.
29.	1/2" CLAMP UNION (THREADED) SUITABLE FOR FLEXIBLE CONNECTION OF NYLON REINFORCED PVC TUBE.
30.	SS TUBE
31.	3/4" SW 4 WAY VALVE.
32.	QUICK DISCONNECT FITTINGS.
33.	1/4" SW ISOLATION VALVE 316SS.
34.	1/2" x 1/2" SS PIPE UNION.

NTPC LIMITED
 (A GOVERNMENT OF INDIA ENTERPRISE)
 ENGINEERING DIVISION

PROJECT: TYPICAL THERMAL POWER PROJECT
 TITLE: INSTRUMENT INSTALLATION DIAGRAM
 DIFF. PRESS.MEASUREMENT (LIQUID, OIL, AIR/GAS SERVICE)

FOR TENDER PURPOSE ONLY


NOTES:-
 1. SAME NOTES AS UNDER DRG. NO. 0000-999-POI-A-023.

REV.NO	DESCRIPTION	DATE	APPD	ARCH.	SCALE	DRG. NO.	REV. NO.
A	FIRST ISSUE	21.08.12			A3	0000-999-POI-A-030	A

No part of this document will be reproduced by any means without the written permission. This document is the property of NATIONAL THERMAL POWER CORPORATION LTD.

LIST OF MATERIALS


ITEM NO.	DESCRIPTION
1.	3/4" x 1" NPS SCH.40/80/160/99.1 (AS PER PROCESS REQUIREMENT) CARBON /ALLOY STEEL PIPE.
2.	3/4" SW GLOBE VALVE.
3.	3/4" SW UNION.
4.	3/4" NPT GLOBE VALVE.
5.	3/4" NPT (M) CAP.
6.	3/4" NPT (F) UNION CONNECTION.
7.	1" SW EQUAL UNION.
8.	1" x 1/2" SW REDUCING INSERT.
9.	1" SW EQUAL TEE.
10.	1/2" SW GLOBE VALVE.
11.	1/2" NPS SW x 1/2" NPT(M) CS/AS NIPPLE.
12.	1/2" NPT (F) CAP
13.	3/4" x 1/2" NPS SCH.40/80 CS/AS PIPE.
14.	1/2" NPS SCH.80/160 CS/AS NIPPLE.
15.	1" SW GLOBE VALVE.

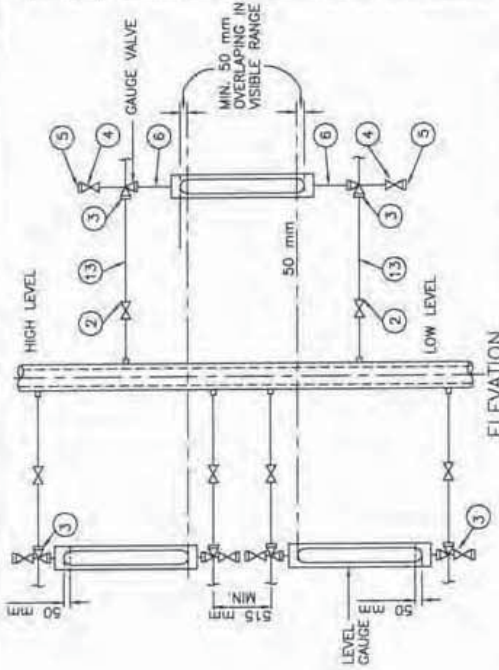

ELEVATION

LOCAL LEVEL INDICATION USING GAUGE GLASS

LOCAL LEVEL INDICATION USING MULTIPLE GAUGES.
FOR INCREASED RANGE NOT COVERED IN A SINGLE UNIT

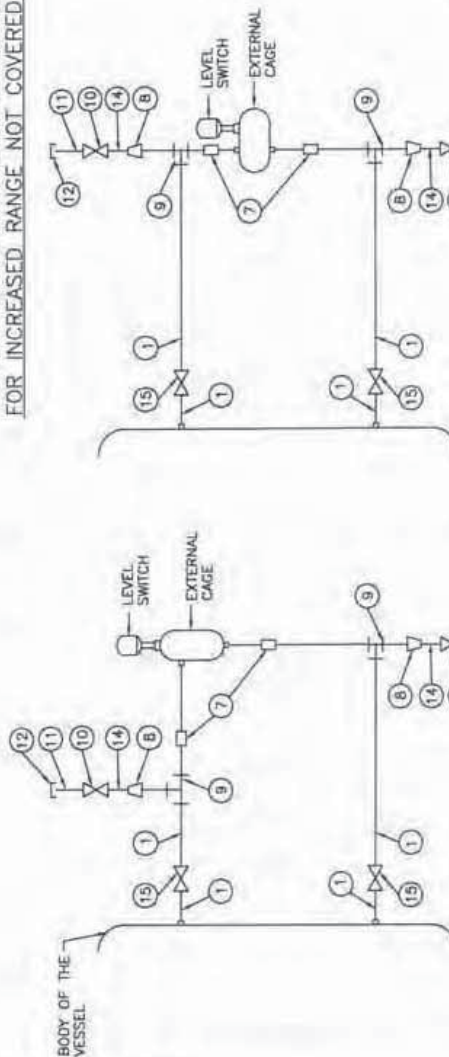

ELEVATION

FLOAT OR DISPLACER OPERATED EXTERNAL CAGE TYPE LEVEL SWITCH INSTALLATION

NOTES:-


1. FOR LEVEL GAUGE 3/4" AND FOR LEVEL SWITCH 1" PROCESS CONNECTION SHALL BE PROVIDED.
2. NOTES UNDER DRG. NO. 0000-999-POI-A-023 (WHICHEVER ARE RELEVANT).


FOR TENDER PURPOSE ONLY




PROJECT		TYPICAL THERMAL POWER PROJECT	
TITLE		INSTRUMENT INSTALLATION DIAGRAM (LEVEL GAUGE & SWITCHES)	
REV. NO.	DRG. NO.	SCALE	REV. NO.
A	0000-999-POI-A-031	A3	A
DATE	21.08.12	SIZE	N.T.S.
APPD	[Signature]	DATE	21.08.12
ARCH.	[Signature]	DATE	21.08.12
C&I	[Signature]	DATE	21.08.12
E	[Signature]	DATE	21.08.12
M	[Signature]	DATE	21.08.12
Cleared by			
DESCRIPTION			
FIRST ISSUE			

No part of this document is the property of NATIONAL THERMAL POWER CORPORATION LTD. This document is the property of NATIONAL THERMAL POWER CORPORATION LTD. No part of this document will be reproduced by any means without the written permission.

CLAUSE NO.	TECHNICAL REQUIREMENTS 								
PROCESS CONNECTION AND PIPING									
1.00.00	PROCESS CONNECTION PIPING								
1.01.00	The Contractor shall provide, install and test all required material for completeness of Impulse Piping System and Air Piping System as per the requirements of this Sub-Section on as required basis for the connection of all instruments and control equipments of entire plant.								
1.01.01	IMPULSE PIPING, TUBING, FITTINGS, VALVES AND VALVE MANIFOLDS								
1.01.02	All impulse pipes shall be of seamless type conforming to ANSI B36.10 for schedule numbers. The size of impulse pipe shall be ½" for Steam & Water Application and ¾" for Air & Flue Gas applications. The rating of material of impulse pipes, tubes, fittings, valves and their installation thereof shall conform to the latest edition of standards as per following table:								
<table border="1"> <tr> <td>Impulse Pipes, Tubes (Material, Rating)</td> <td>ANSI B31.1, ANSI B31.1a, ANSI/ISA 77.70</td> </tr> <tr> <td>Valves (Material, Pr. Class, Size)</td> <td>ASTM A182/ASTM A105 as per ASME 16.34</td> </tr> <tr> <td>Fittings (Size, Rating, Material)</td> <td>ANSI B31.1, ANSI B31.1a, ASME B16.11-2009</td> </tr> <tr> <td>Installation Schemes</td> <td>BS 6739-2009, ANSI/ISA 77.70</td> </tr> </table>		Impulse Pipes, Tubes (Material, Rating)	ANSI B31.1, ANSI B31.1a, ANSI/ISA 77.70	Valves (Material, Pr. Class, Size)	ASTM A182/ASTM A105 as per ASME 16.34	Fittings (Size, Rating, Material)	ANSI B31.1, ANSI B31.1a, ASME B16.11-2009	Installation Schemes	BS 6739-2009, ANSI/ISA 77.70
Impulse Pipes, Tubes (Material, Rating)	ANSI B31.1, ANSI B31.1a, ANSI/ISA 77.70								
Valves (Material, Pr. Class, Size)	ASTM A182/ASTM A105 as per ASME 16.34								
Fittings (Size, Rating, Material)	ANSI B31.1, ANSI B31.1a, ASME B16.11-2009								
Installation Schemes	BS 6739-2009, ANSI/ISA 77.70								
1.01.03	<p>Stainless steel tube shall be provided inside enclosures & racks from tee connection to valve manifold and then to instrument. The source shut-off (primary process root valve) and blow down valve shall be of 1/2 inch size globe valve type for all applications except for air and flue gas service wherein no source shut-off valves are to be provided. Two root valves are to be used wherever pressure is more than 40 Kg/cm² or Temp>280 °C. The end connections of valves shall be of socket welded type. Typical installation scheme of DP Transmitter (inside LIE/LIR) mounted below instrument source point is indicated in Drg. No. 0000-999-POI-A-036. Same scheme with necessary changes shall be applied for other instruments.</p> <p>The valve manifolds of 316 SS with pressure rating suitable for intended application shall be provided as given below:</p> <table border="1"> <thead> <tr> <th>Manifold</th> <th>Application/Measurement</th> </tr> </thead> <tbody> <tr> <td>2 Valve</td> <td>Pressure measurements using pressure transmitters/pressure switches</td> </tr> <tr> <td>3 Valve</td> <td>Pressure measurements using differential pressure transmitter/ switches</td> </tr> <tr> <td>5 Valve</td> <td>Differential Pressure, Flow and Level Measurements</td> </tr> </tbody> </table> <p>For Pr./D.P gauges, two-way globe/gate valve shall be provided on each impulse line to the instrument in Fluid/Air & Flue Gas applications respectively .</p>	Manifold	Application/Measurement	2 Valve	Pressure measurements using pressure transmitters/pressure switches	3 Valve	Pressure measurements using differential pressure transmitter/ switches	5 Valve	Differential Pressure, Flow and Level Measurements
Manifold	Application/Measurement								
2 Valve	Pressure measurements using pressure transmitters/pressure switches								
3 Valve	Pressure measurements using differential pressure transmitter/ switches								
5 Valve	Differential Pressure, Flow and Level Measurements								
2.00.00	AIR SUPPLY PIPING								
2.01.01	All pneumatic piping, fittings, valves, air filter cum regulator, purge rotameter and other accessories required for instrument air for the various pneumatic devices/ instruments shall be provided. This will include as a minimum air supply to pneumatically operated control valves, actuators, instruments, continuous and intermittent purging requirements etc.								
2.02.00	Instrument air and Service air supply shall be provided for continuous and intermittent purging respectively for all transmitters of mill, dirty air and flue gas applications. Purging Scheme shall be as per Drg. No. 0000-999-POI-A-036.								
2.03.00	The Contractor shall also provide SS Tubing and associated fittings (screwed type) of suitable sizes for all pneumatic equipments/actuators (including supply air, signal air and output to actuators) conforming to ANSI 31.1 and 31.3 standard. All other air supply lines shall be of mild steel hot dipped galvanized inside and outside as per IS-1239, heavy duty								
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C3 PCP	PAGE 1 OF 4						

CLAUSE NO.	TECHNICAL REQUIREMENTS 		
	<p>with threaded ends. Fittings for air supply line shall be of forged carbon steel A234 Gr. WPB galvanized inside and outside, screwed as per ASA B2.1. Dimensions of fittings shall be as per ASA B16.11 of rating 3000 lbs. Air supply piping shall be adequately sloped to prevent accumulation of condensed water within the pipe. The air supply headers, sub-headers and branch pipes shall be supported properly by clamps or supports.</p>		
2.04.00	<p>The instrument/service air supply to each equipment/devices requiring air supply shall be provided by a well designed air distribution scheme comprising of 2" GI Pipe Header feeding 1" GI Pipe sub-header feeding ½" pipe at each equipment/device. Instrument air filters cum regulator set with mounting accessories shall be provided for each pneumatic device requiring air supply except for Ash Handling System wherein it shall be provided on instrument air header at each location.</p>		
2.05.00	<p>All the isolation valves in the air supply line shall be gate valves as per ASTM B62 inside screw rising stem, screwed female ends as per ASA B2.1. Valve bonnet shall be union type & trim material shall be stainless steel, body rating 150 pounds ASA. The valve sizes shall be ½ inch to 2 inch.</p>		
2.06.00	<p>Instrument air filters cum regulator set with mounting accessories shall be provided for pneumatic device requiring air supply. The filter regulators shall be suitable for 10-kg/ sq.cm max. Inlet pressure. The filter shall be of size 5 microns and of material sintered bronze. The air set shall have 2-inch size pressure gauge and built in filter housing blowdown valve. The end connection shall be as per the requirement to be finalized during detailed engineering.</p>		
3.00.00	<p>INSTALLATION AND ROUTING</p>		
3.01.01	<p>All instrument piping, tubing and its accessories shall be supported in a safe manner to prevent excessive vibrations and anchored sufficiently to prevent undue strain on connected equipment. Impulse piping shall be supported at an interval not exceeding 1.5 meters. The slope of the impulse pipe from the process connection to the instrument shall be as per ANSI/ISA 77.70 latest edition and BS 6739-2009. All impulse piping shall be installed to permit free movement due to thermal expansion. Wherever required expansion loops shall be provided.</p> <p>Condensate pots shall be provided for all level measurements in steam and water services, all flow measurement in steam services and for flow measurements in water services above 120 Deg. C. Colour coding of all impulse pipes shall be done by the Contractor in line with the colour coding being followed for the parent pipes.</p>		
4.00.00	<p>SHOP AND SITE TESTS</p>		
4.01.01	<p>The equipment and work performed as per this Sub-section shall be subject to shop and site test as per requirements of Sub-section-III-E-04 (Quality Assurance & Inspection) other applicable clauses of this Sub-section and Employer approved quality assurance plan.</p>		
4.01.02	<p>Hydrostatic and Pneumatic leakage tests shall be performed on all pipes, tubing and systems and shall conform to ANSI B31.1.</p>		
5.00.00	<p>LOCAL INSTRUMENT ENCLOSURE AND RACKS</p> <p>All transmitters, switches etc. for FGD system and other system being provided under the contract shall be suitably grouped together and mounted inside (i) local instruments enclosures in case of open areas of the plant and (ii) In local instrument racks in case of covered areas. The GA of LIE with purging indicated in the Drg. No. 0000-999-POI-A-036 is to be followed by contractor. The GA of LIR shall be similar to LIE except for front/rear doors and side panels.</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-III-C3 PCP</p>	<p>PAGE 2 OF 4</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS 		
5.01.00	<p>The internal layout shall be such that the impulse piping/ blow down lines are accessible from back side of the enclosure / rack and the transmitters etc. are accessible from front side for easy maintenance. Bulkheads, especially designed to provide isolation from process line vibration shall be installed on instrument enclosures/racks to meet the process sensing line connection requirement. Vibration dampeners shall be installed for each enclosure / rack. The Degree of Protection of LIE and JB of LIE/LIR shall be IP-55.</p> <p>The enclosures shall be constructed of 3 mm sheet plate and shall be of modular construction with one or more modules and two end assemblies bolted together to form an enclosure. Double inter locking doors shall be provided. The doors shall be the three-point locking type constructed of not less than 1.6 mm thick steel. Doors shall have concealed quick removal type pinned hinges and locking handles. Door locks shall accept the same key.</p> <p>The instrument racks shall be free standing type constructed of suitable 5 mm thick channel frame of steel and shall be provided with a canopy to protect the equipment mounted in racks from falling objects, water etc. The canopy shall not be less than 3 mm thick steel, and extended beyond the ends of the rack.</p> <p>Enclosures/Racks shall be reinforced as required to ensure true surface and to provide adequate support for instruments and equipment mounted therein. Centre posts or any member which would reduce access shall not be provided.</p> <p>Contractor shall provide not more than three variants for LIE/LIR with respect to max. no. transmitters mounted in each LIE/LIR.</p> <p>ENCLOSURE / RACKS FOR DUAL I/P TEMPERATURE TRANSMITTERS</p> <p>All Dual Input temperature transmitters for FGD system and other system being provided under the contract shall be suitably grouped together and mounted inside (i) Enclosures in case of open areas of the plant and (ii) Racks in case of covered areas. Integral JB shall be provided with each Enclosure and Rack.</p> <p>The internal layout shall be such that the transmitters are accessible from both front and back side of the enclosure / rack for easy maintenance.</p> <p>Enclosure/ Racks shall be of robust and rugged design. Vibration dampeners shall be installed for each enclosure / rack. The Degree of Protection of Enclosure and JB shall be IP-55.</p> <p>Enclosure and Racks shall be free standing type.</p> <p>Enclosures/Racks shall be reinforced as required to ensure true surface and to provide adequate support for instruments and equipment mounted therein.</p> <p>Contractor shall provide not more than five variants for Enclosure/ Rack with respect to max. no. transmitters mounted in each Enclosure/ Rack. However, the maximum number of Transmitters that can be grouped in one Enclosure/ Rack shall be decided during detail Engineering.</p>		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C3 PCP	PAGE 3 OF 4

CLAUSE NO.	TECHNICAL REQUIREMENTS		
6.00.00	<p>INSTALLATION OF OTHER INSTRUMENTS:</p> <p>For installation and routing of other field mounted instruments which are not covered in Cl. No. 5.00.00, please refer Cl. No 52.04.00(J) of Section-VI, Part-D, Erection Conditions of Contract (ECC) of Technical Specifications.</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-III-C3 PCP</p>	<p>PAGE 4 OF 4</p>




C&I SPECIFICATION FOR
HVAC SYSTEM


SECTION: C
SUB SECTION: C&I

SIGNAL INTERFACE
BETWEEN
DRIVES AND DCS


DDCMIS INTERFACE WITH LT MCC (LT)

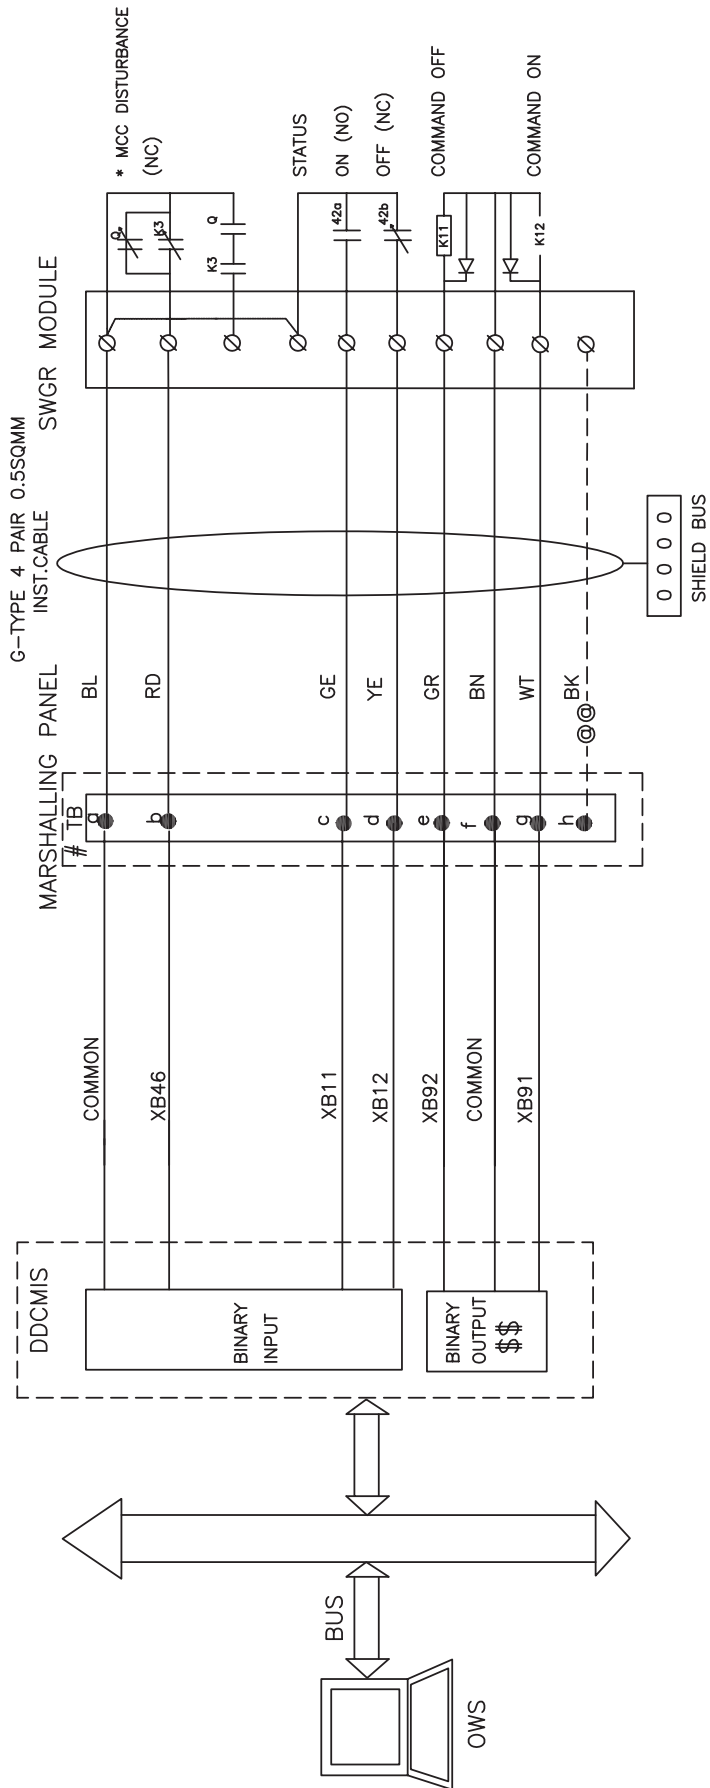


DCS INTERFACE FOR 3-WAY MIXING VALVE (MOD-AC)

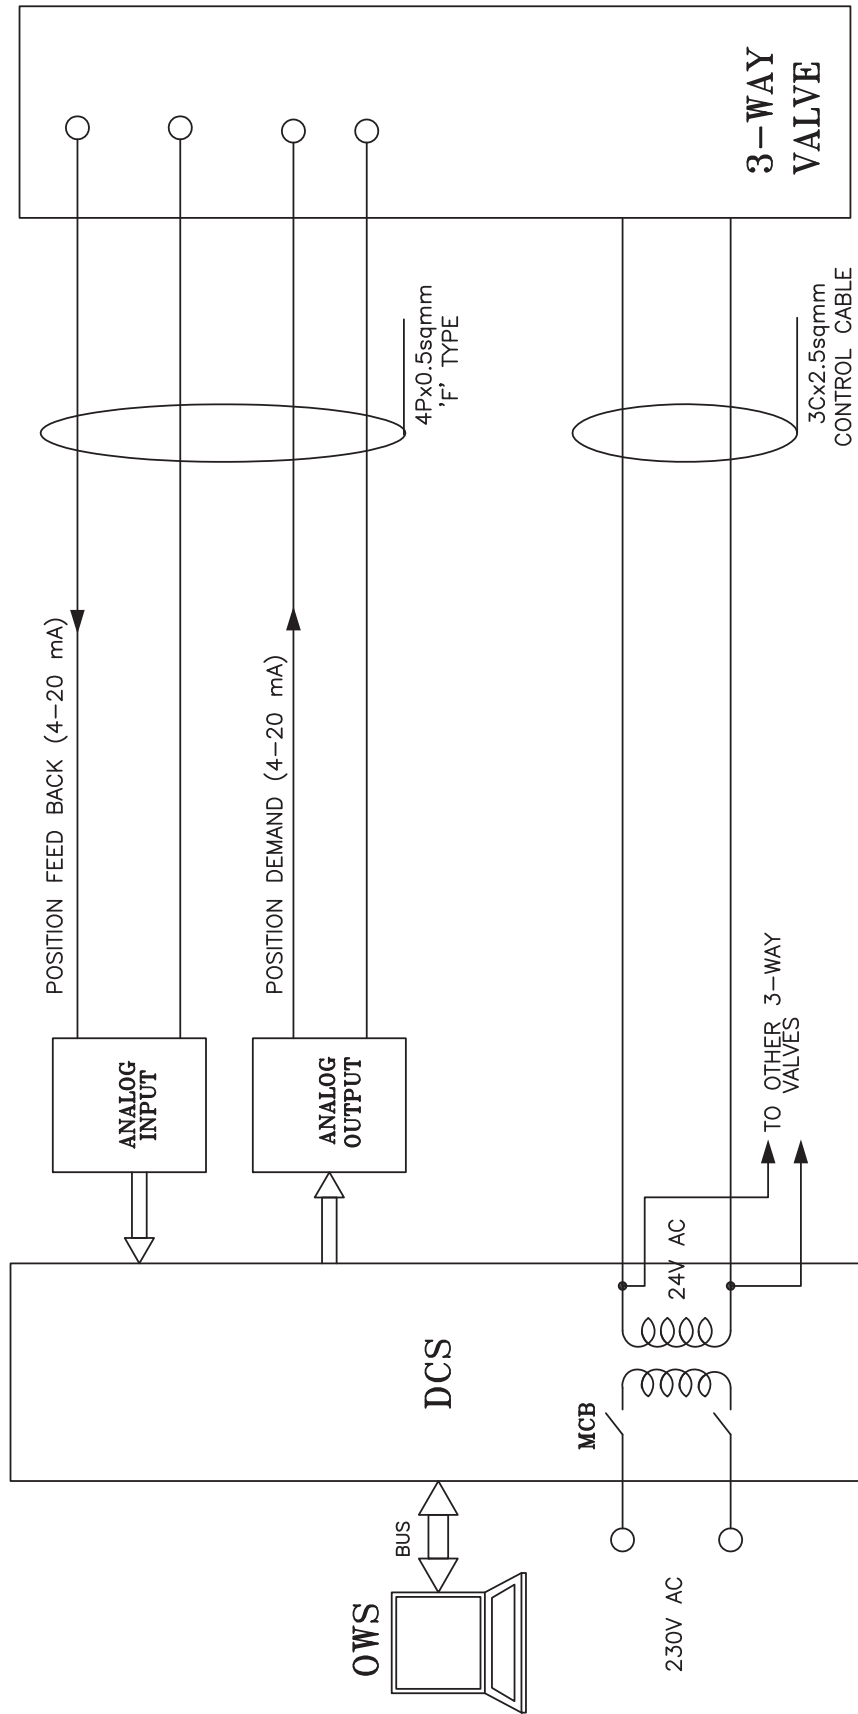


DCS INTERFACE FOR MOTORIZED OPERATED FIRE DAMPER (BID-FD)

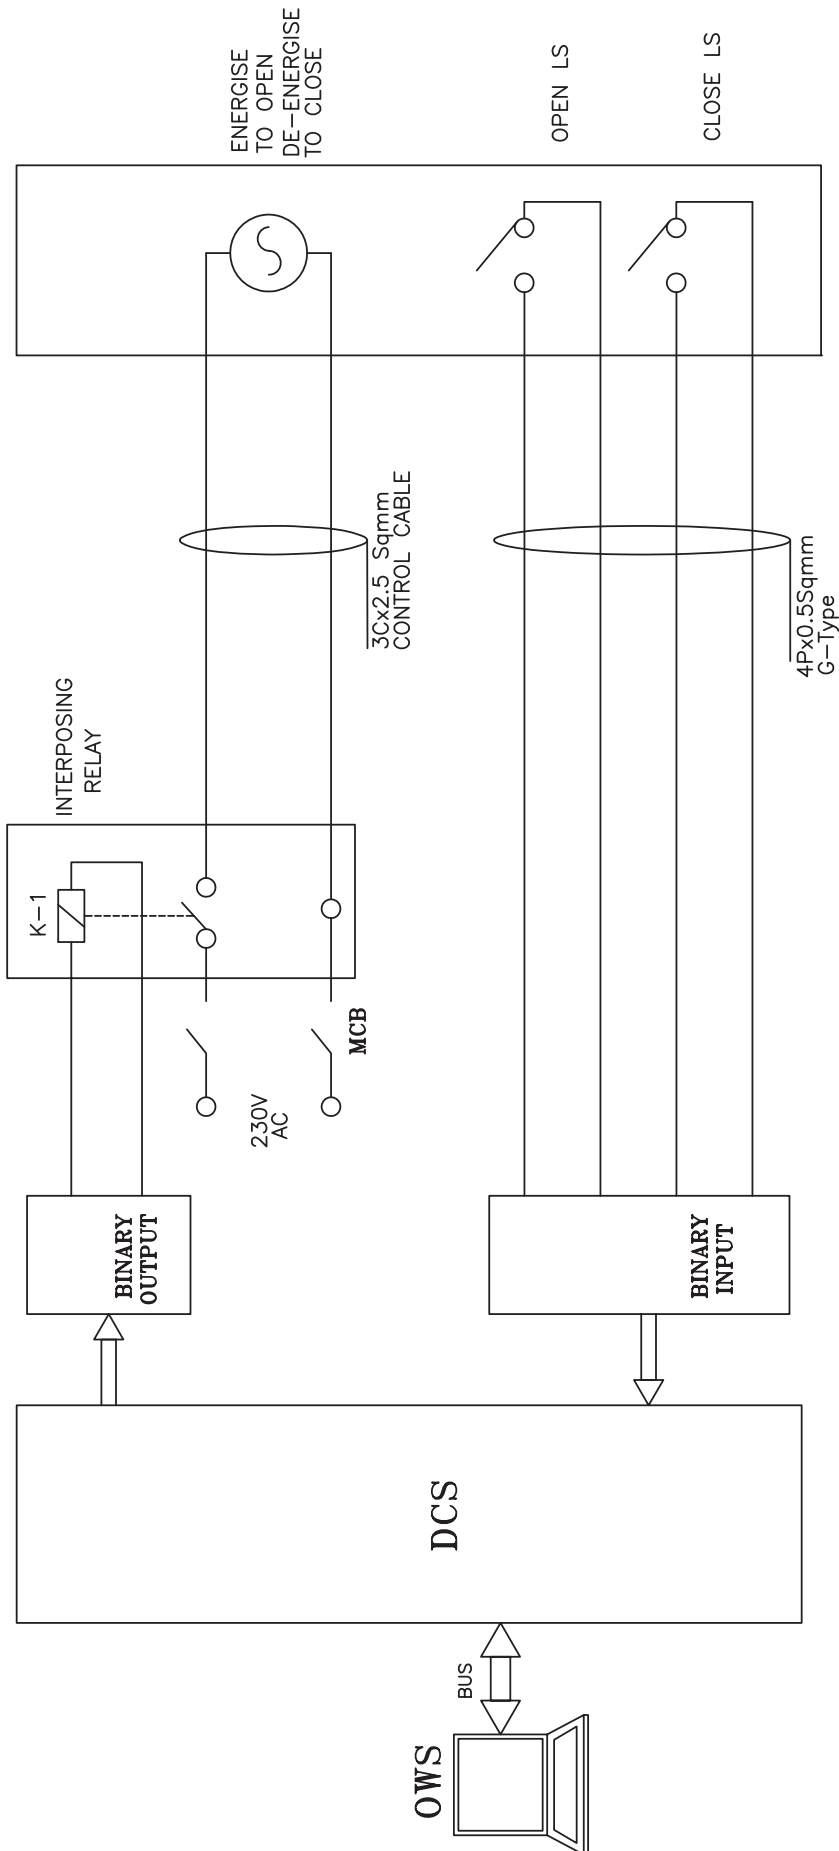


HOOK-UP DIAGRAM FOR ACCU/SCREW CHILLER

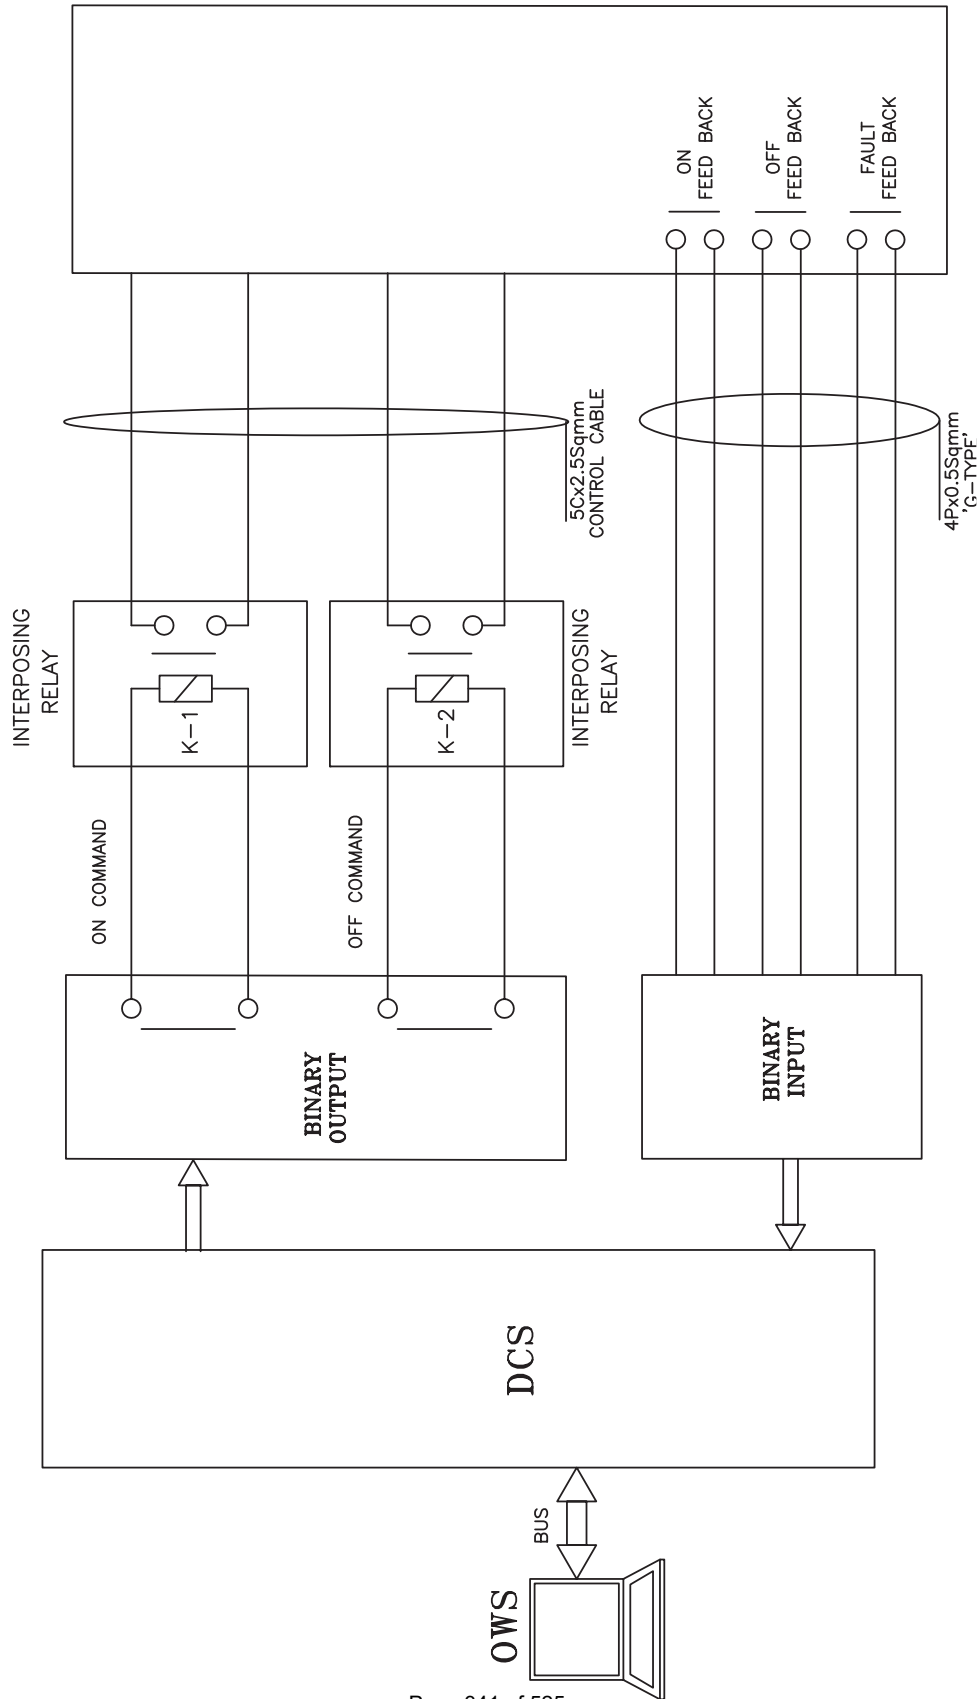

DCS INTERFACE FOR AHUS VFD(VFD-AC)

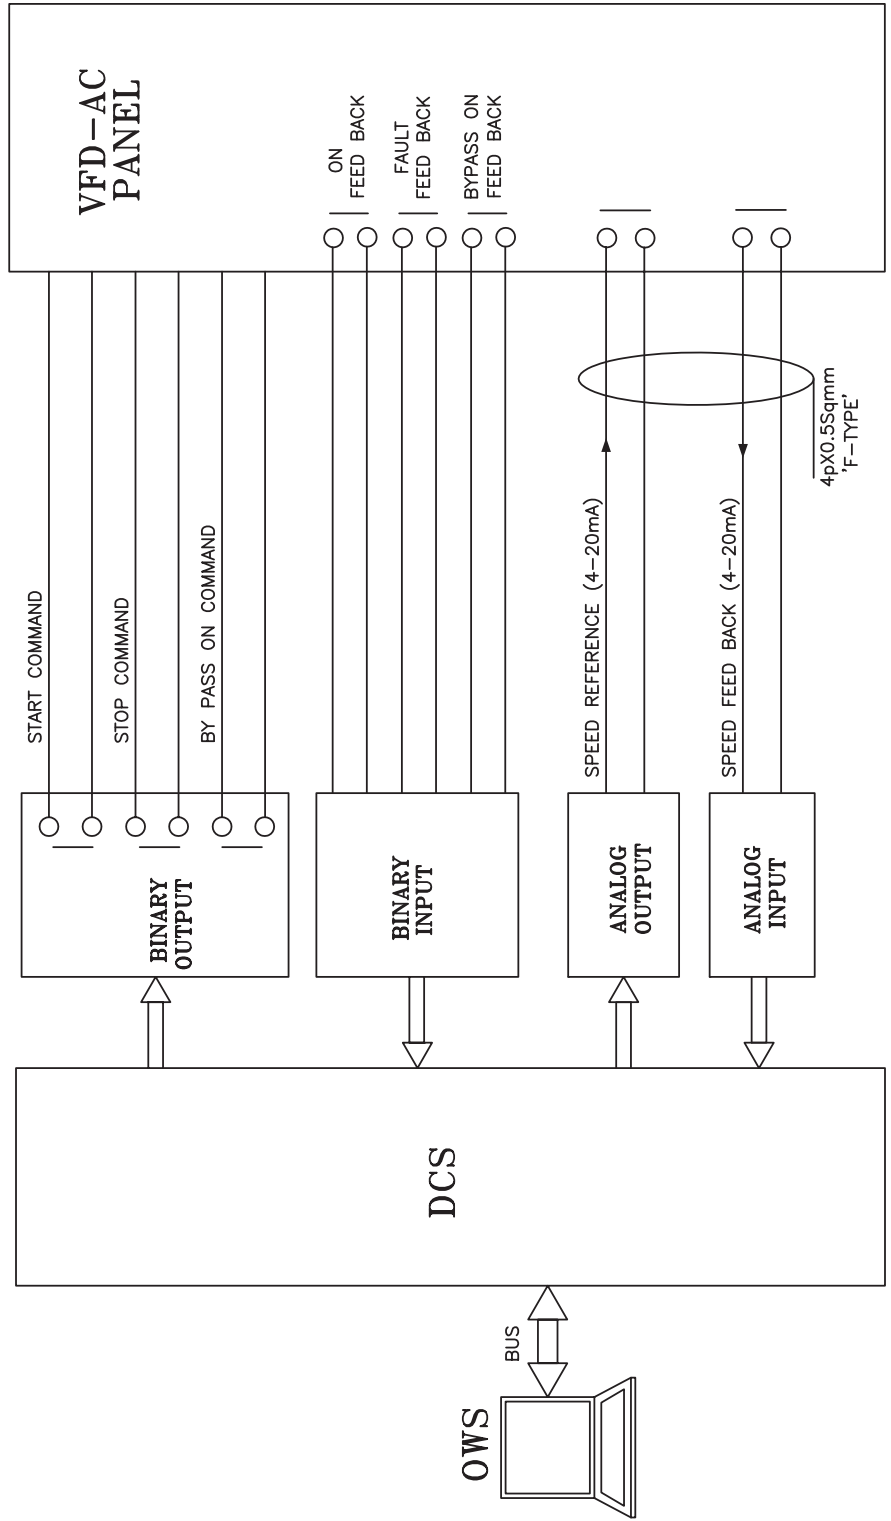

DCS INTERFACE FOR MOTORIZED OPERATED VALVES (BID-AC, BID-VCD)

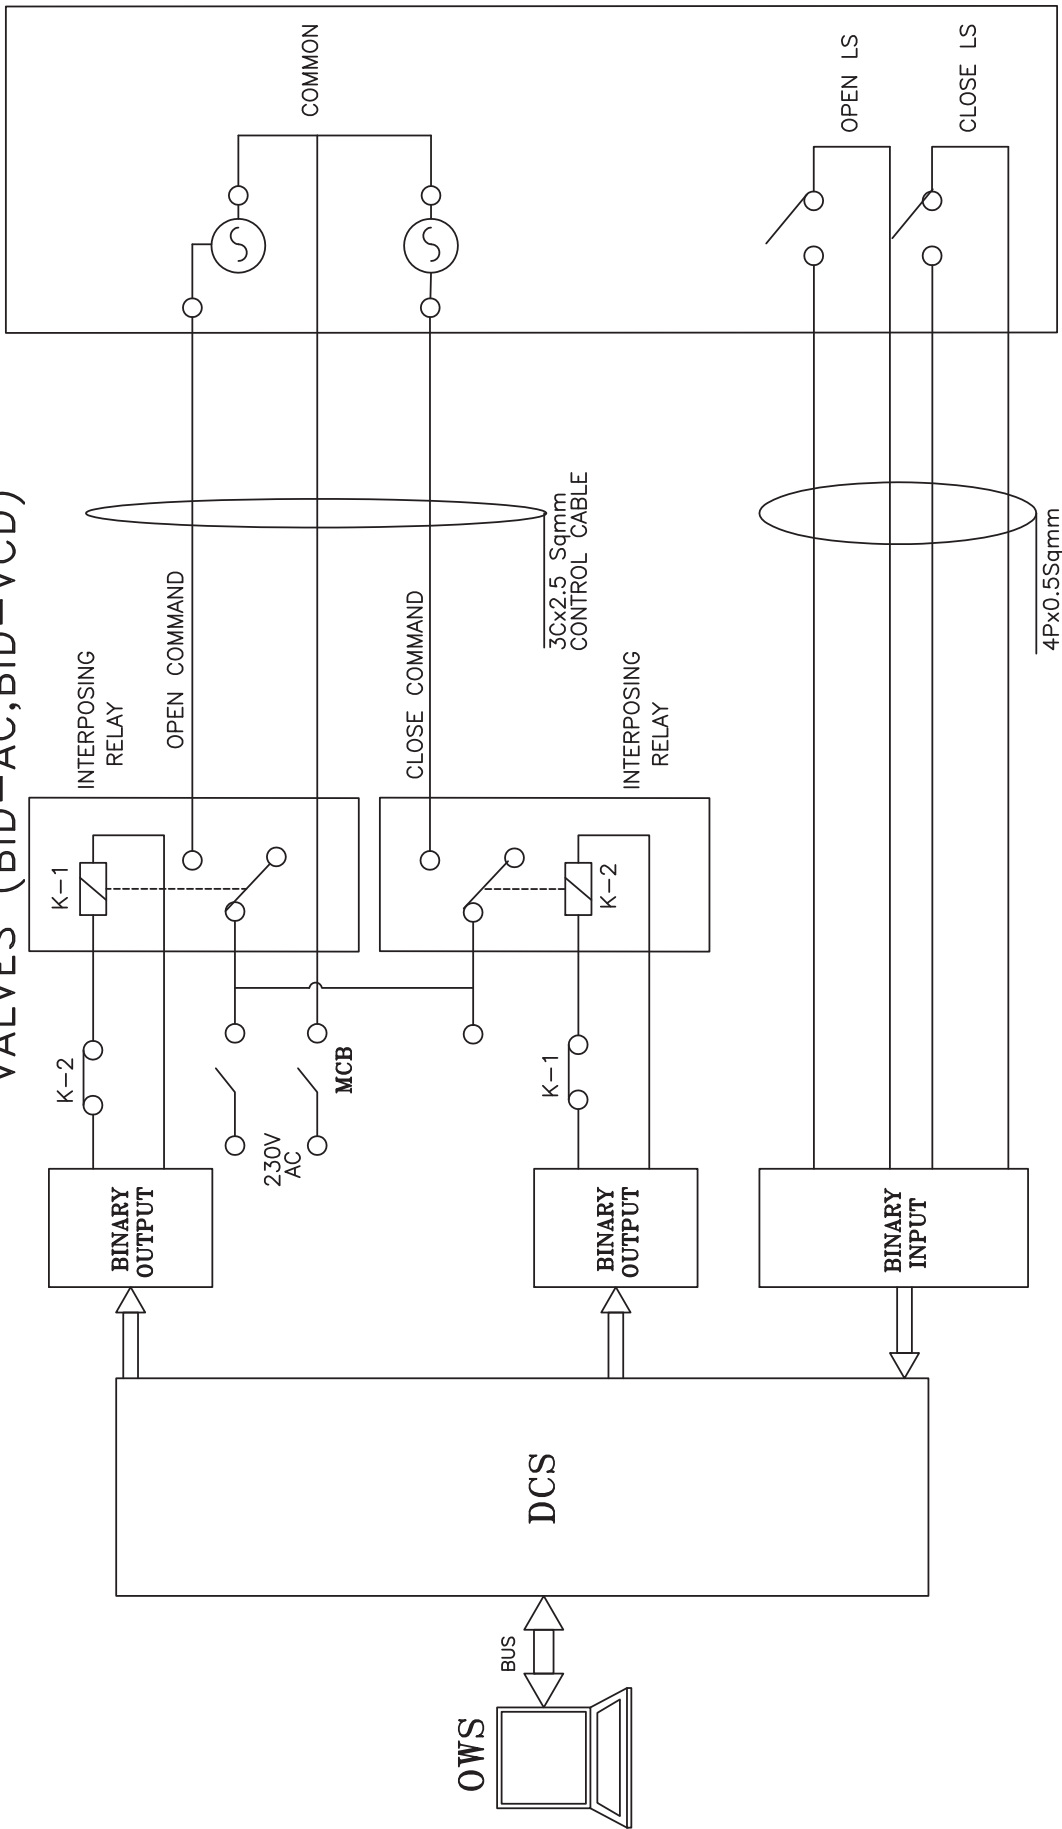



C&I SPECIFICATION FOR
HVAC SYSTEM

SECTION: C
SUB SECTION: C&I





DRIVE & INSTRUMENT INTERFACE
DIAGRAM

LIST OF MATERIALS

ITEM NO.	DESCRIPTION
1.	ISOLATION VALVE(gate/globe), SS.
2.	SEAMLESS SS PIPE.
3.	AIR FILTER REGULATOR.
6.	INST. AIR HEADER SS.
10.	COMP. NEEDLE VALVE SS.
11.	AIR PURGE SET.
12.	COMP VALVE SS.
13.	PLUG SS.
15.	TUBE SS CONNECTOR.
16.	TUBE COMP. EQUAL TEE UNION.
24.	BULKHEAD-SS SUITABLE FOR GI PIPE CONNECTION
25.	SEAMLESS TUBE SS.
27.	BRANCH TEE SS.
28.	PFL GALUZE.
30.	NYLON FLEX. HOSE BRAIDED WITH SS WIRE.
31.	HOSE BARBED CONNL. SS.
33.	QUICK DISCONNECT SS (PURGE AIR CONNECTION TO INSTRUMENT SOURCE END).

LIST OF MATERIALS

ITEM NO.	DESCRIPTION
14.	SW GLOBE VALVE.
17.	SW EQUAL TEE
18.	S.S. NIPPLE
19.	5 VALVE MANIFOLD
20.	SW HALF COUPLER CS
21.	PIPE x TUBE UNION
22.	SUITABLE ADAPTER
23.	SS TUBE

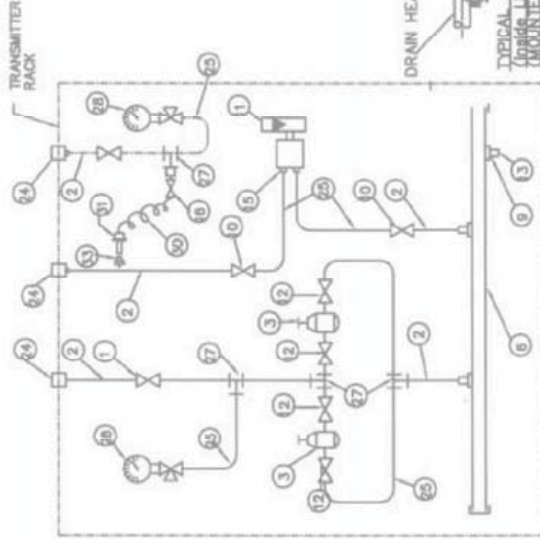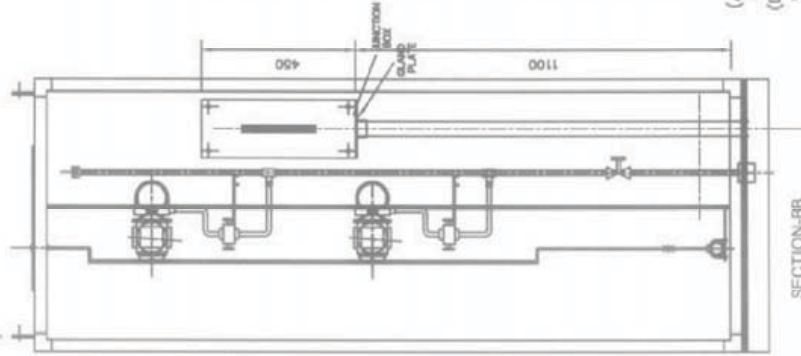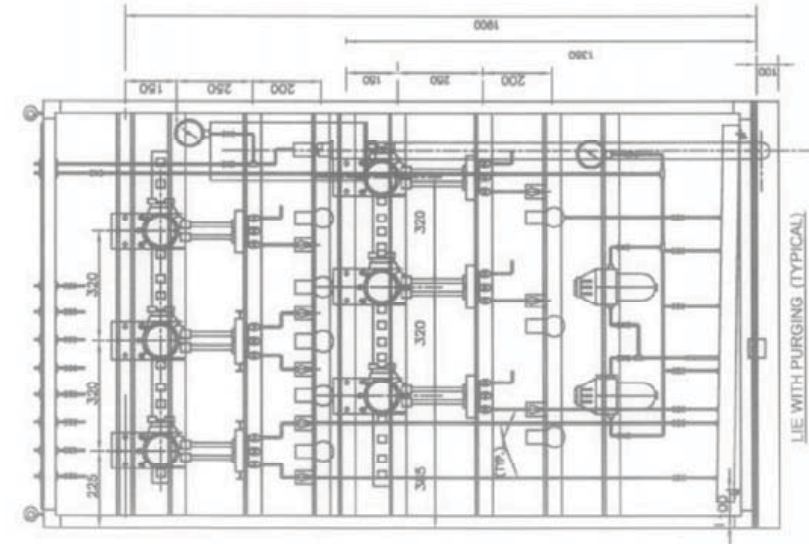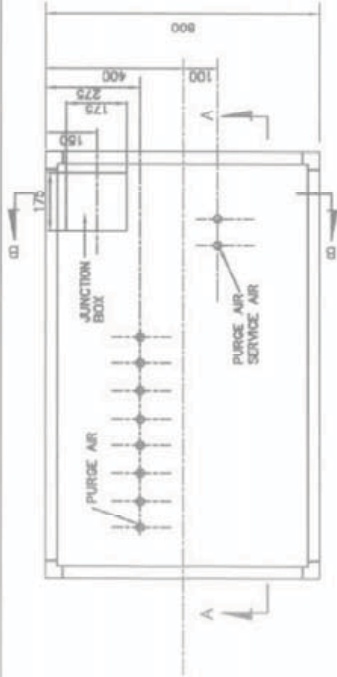

LIE WITH PURGING (TYPICAL)

SECTION-BB

TYPICAL PURGE AIR CONNECTION INSIDE THE INST. ENCLOSURE (APPLICABLE FOR MILL, AIR & FLUE GAS SERVICE INSTRUMENTS REQUIRING PURGE AIR)

TYPICAL ARRANGEMENT OF DP TRANSMITTER (DRUG LIE/LJR) MOUNTED BELOW INSTRUMENT SOURCE POINT.

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
INSTRUMENTATION DIVISION

REV. NO.	DATE	BY	CHKD.	APPD.	DATE	SCALE	DWG. NO.	REV. NO.
A						AS	0000-999-POI-A-036	A


CLEARED BY:

DESCRIPTION:

PROJECT: TYPICAL THERMAL POWER PROJECT (TURNKEY EPC PACKAGE)

TITLE: TYPICAL GA OF LOCAL INSTRUMENT ENCLOSURE, PURGING SCHEME, DP TRANSMITTER

TERMINATION AT CONTROL SYSTEM END

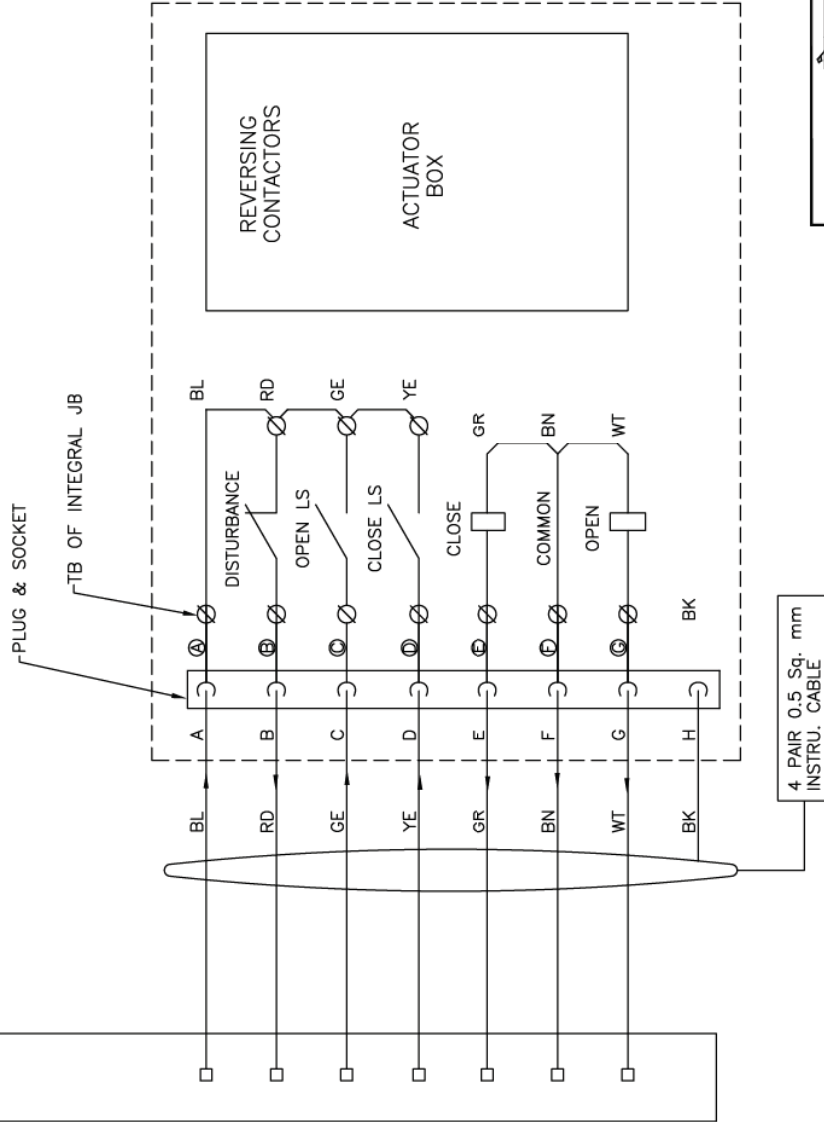


FOR TENDER PURPOSE ONLY



नेशनल थर्मल पावर कारपोरेशन लिमिटेड
 National Thermal Power Corporation Ltd.
 (A GOVERNMENT OF INDIA ENTERPRISE)
 ENGINEERING DIVISION

PROJECT		TYPICAL THERMAL POWER PROJECT	
TITLE		INTERFACING OF ACTUATORS	
REV. NO.	D	DRG. NO.	0000-999-POI-A-063
SCALE	N.T.S.	SIZE	A3
DATE	21.06.12	APPD	
ARCH.		C&I	
E		C	
M			
DESIGN	CHKD.	CLEARED BY	
D	FIRST ISSUE	DESCRIPTION	

MARSHALLING/TERMINATION CUBICLE

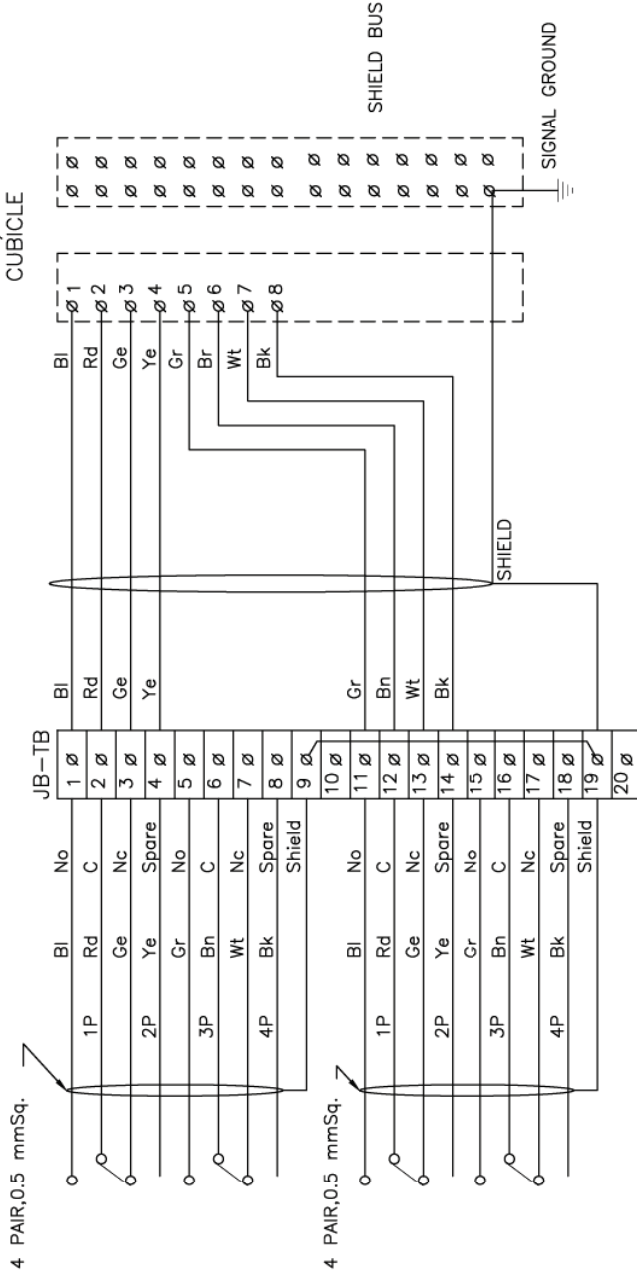


FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT		TYPICAL THERMAL POWER PROJECT	
TITLE		INTERFACING OF FIELD INSTRUMENTS/ SWGR SWITCH (COC) TERMINATION DETAILS	
REV. NO.	REV. NO.	SCALE	DRG. NO.
A	A	NTS	0000-999-POI-A-065
SIZE	DATE	DATE	SH. 01 OF 15
A3	21.08.12		
Cleared By		APPD	ARCH.
M		C&I	C
E		C	
M		CHKD.	
DRAWN		DESIGN	
DESCRIPTION			
FIRST ISSUE			

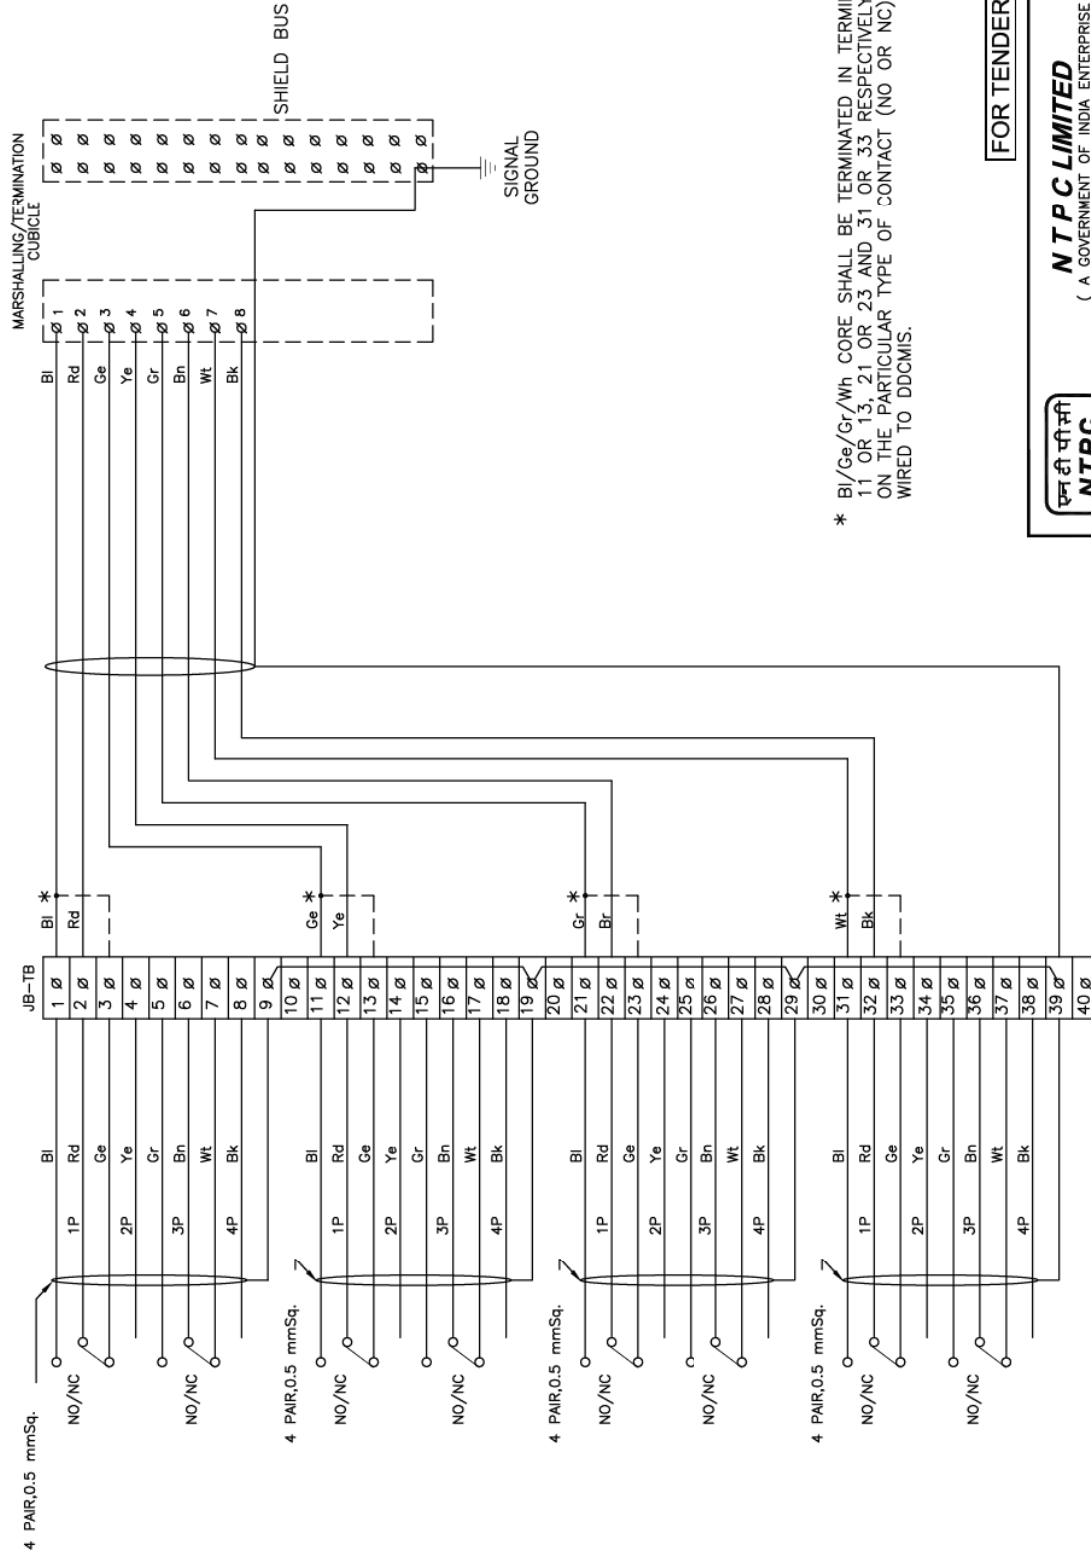


* BI/Ge/Gr/Wt CORE SHALL BE TERMINATED IN TERMINAL 1 OR 3, 11 OR 13, 21 OR 23 AND 31 OR 33 RESPECTIVELY DEPENDING ON THE PARTICULAR TYPE OF CONTACT (NO OR NC) IS TO BE WIRED TO DDCMIS.

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION


PROJECT		TYPICAL THERMAL POWER PROJECT	
TITLE		INTERFACING OF FIELD INSTRUMENTS SWITCH TERMINATION DETAILS NO/NC	
REV. NO.	A	DRG. NO.	0000-999-POI-A-065
SIZE	A3	SCALE	NTS
DATE	21.08.12	APPD	
DRAWN		DESIGN	CHKD.
DESCRIPTION		CLEARED BY	
M		E	C
C&I		ARCH.	
REV. NO.		REV. NO.	A
SH. 02 OF 15			

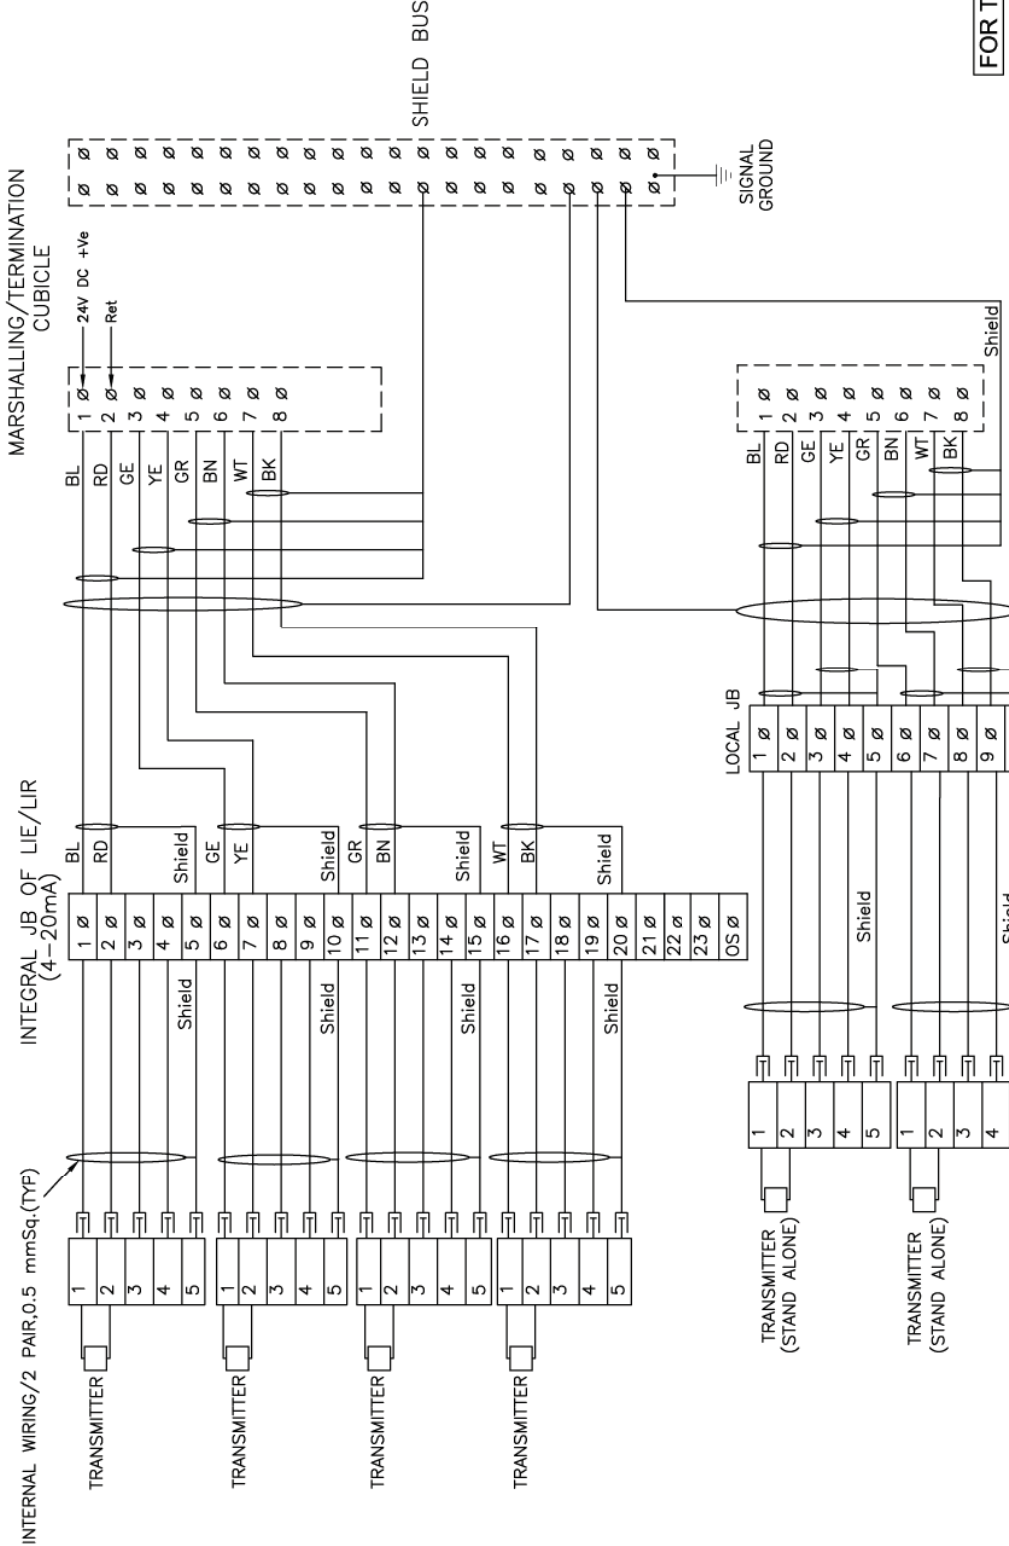

FOR TENDER PURPOSE ONLY

NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT		TYPICAL THERMAL POWER PROJECT			
TITLE		INTERFACING OF FIELD INSTRUMENTS 4-20mA			
REV. NO.	DRG. NO.	SCALE	SIZE	DATE	APPD
B	0000-999-POI-A-065	NTS	A3	21.08.12	
REV. NO.	SH. 04 OF 15	CLEARED BY			
A		M	E	C	ARCH.
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	
	INTERNAL WIRING FOR LIE/LIR MOUNTED SHOWN WIRING OF STAND ALONE TXTR SHOWN				
	FIRST ISSUE				

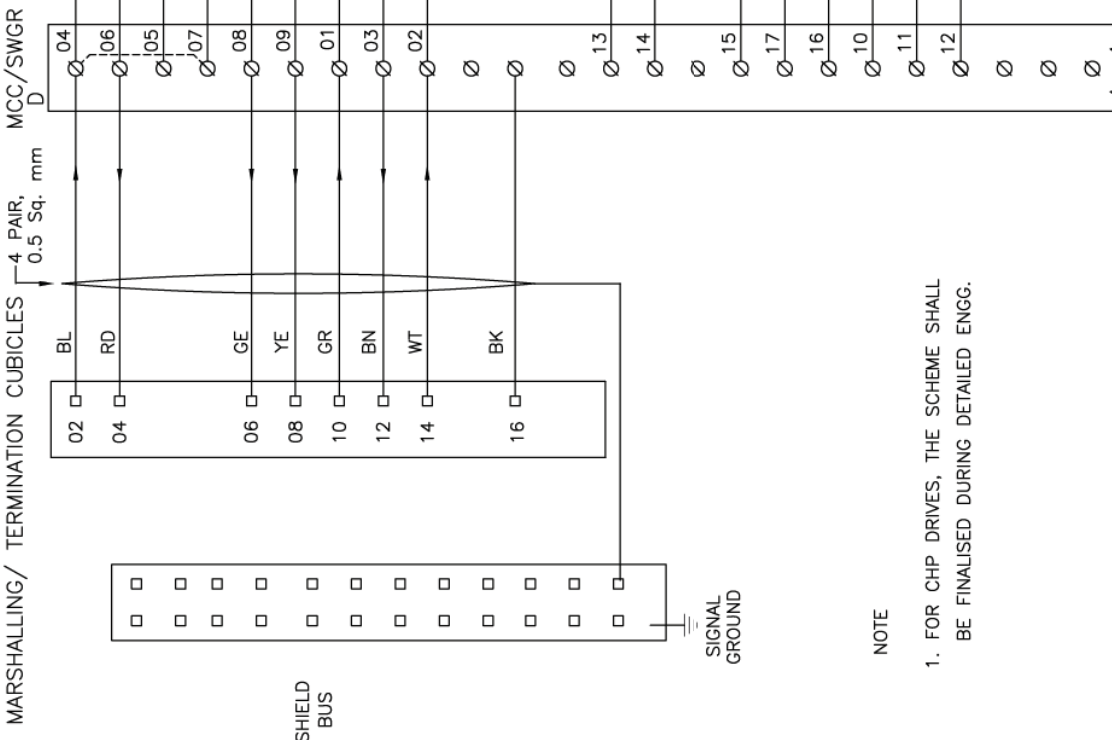

NOTE


- 1. FOR CHP DRIVES, THE SCHEME SHALL BE FINALISED DURING DETAILED ENGG.

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT		TYPICAL THERMAL POWER PROJECT	
TITLE		INTERFACE OF FIELD INSTRUMENTS (L.T MOTORS)	
REV. NO.	DATE	SCALE	DRG. NO.
A	21.08.12	NTS	0000-999-POI-A-065
DESCRIPTION		SIZE	REV. NO.
		A3	A
		SH. 05 OF 15	

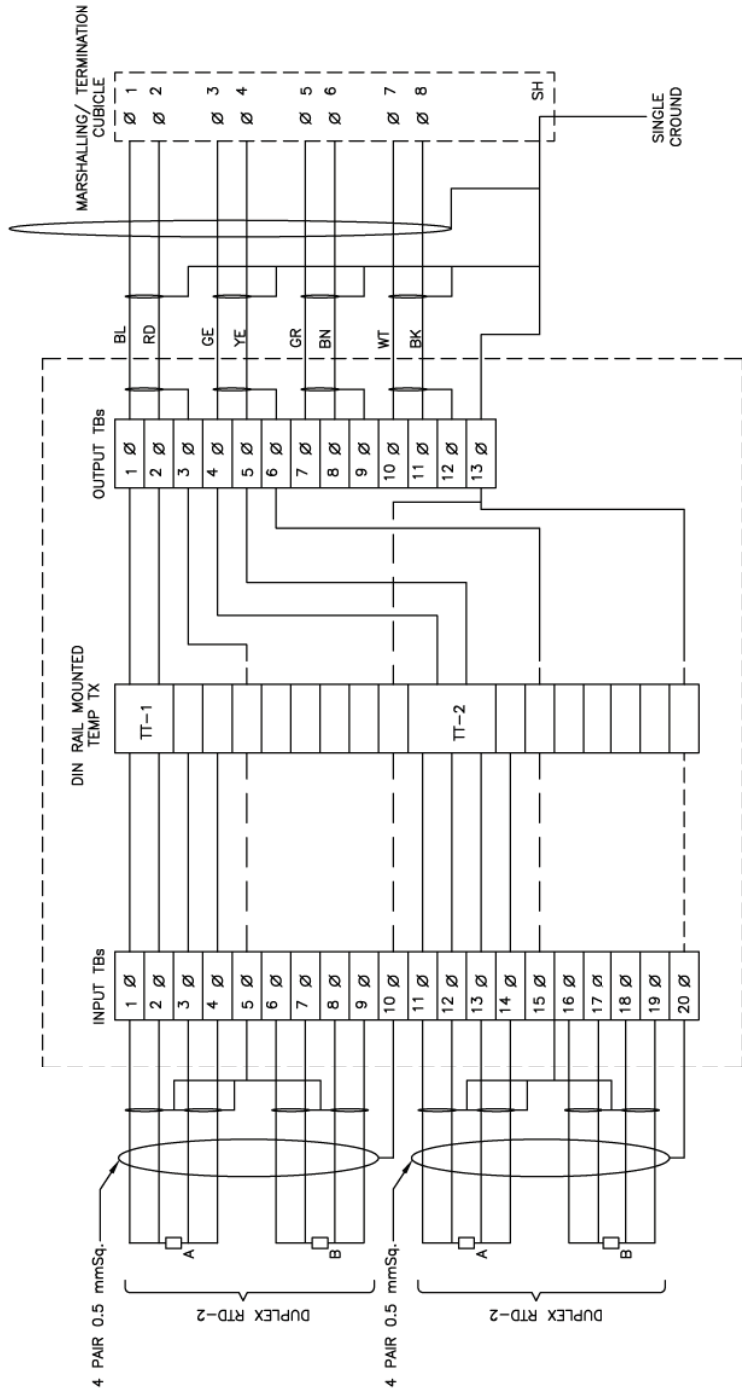

JUNCTION BOX FOR MOUNTING TEMP TX


- NOTE :-
- 1) ABOVE IS THE TYP. DRG. MOUNTED TEMP TRANSMITTER FRO T/C APPLICATION. EXACT TYPE OF TEMP TRANSMITTERS SHALL BE AS PER PART-A OF SPECIFICATION.
 - 2) THE EXACT GROUPING OF TEMP TXs SHALL BE FINISHED DURING DETAILED ENGG. STAGE.
 - 3) PLEASE NOTE THAT THIS CONFIGURATION IS SHOWN FOR SINGLE INPUT DIN MOUNTED TT. FOR DUAL INPUT TT BOTH THE ELEMENTS OF RTD SHALL BE CONNECTED TO TT THROUGH INPUT TBs.

FOR TENDER PURPOSE ONLY




NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT		TYPICAL THERMAL POWER PROJECT			
TITLE		INTERFACING OF FIELD INSTRUMENTS TYPICAL RTD CONNECTION WITH TEMP TRANSMITTERS IN JBS			
REV. NO.	DESCRIPTION	DATE	APPD	ARCH.	CLEARED BY
A	FIRST ISSUE	21.08.12			
REV. NO.	DESCRIPTION	DATE	APPD	ARCH.	CLEARED BY
SIZE	SCALE	DRG. NO.	REV. NO.		
A3	NTS	0000-999-POI-A-065	A		
		SH 06 OF 15			

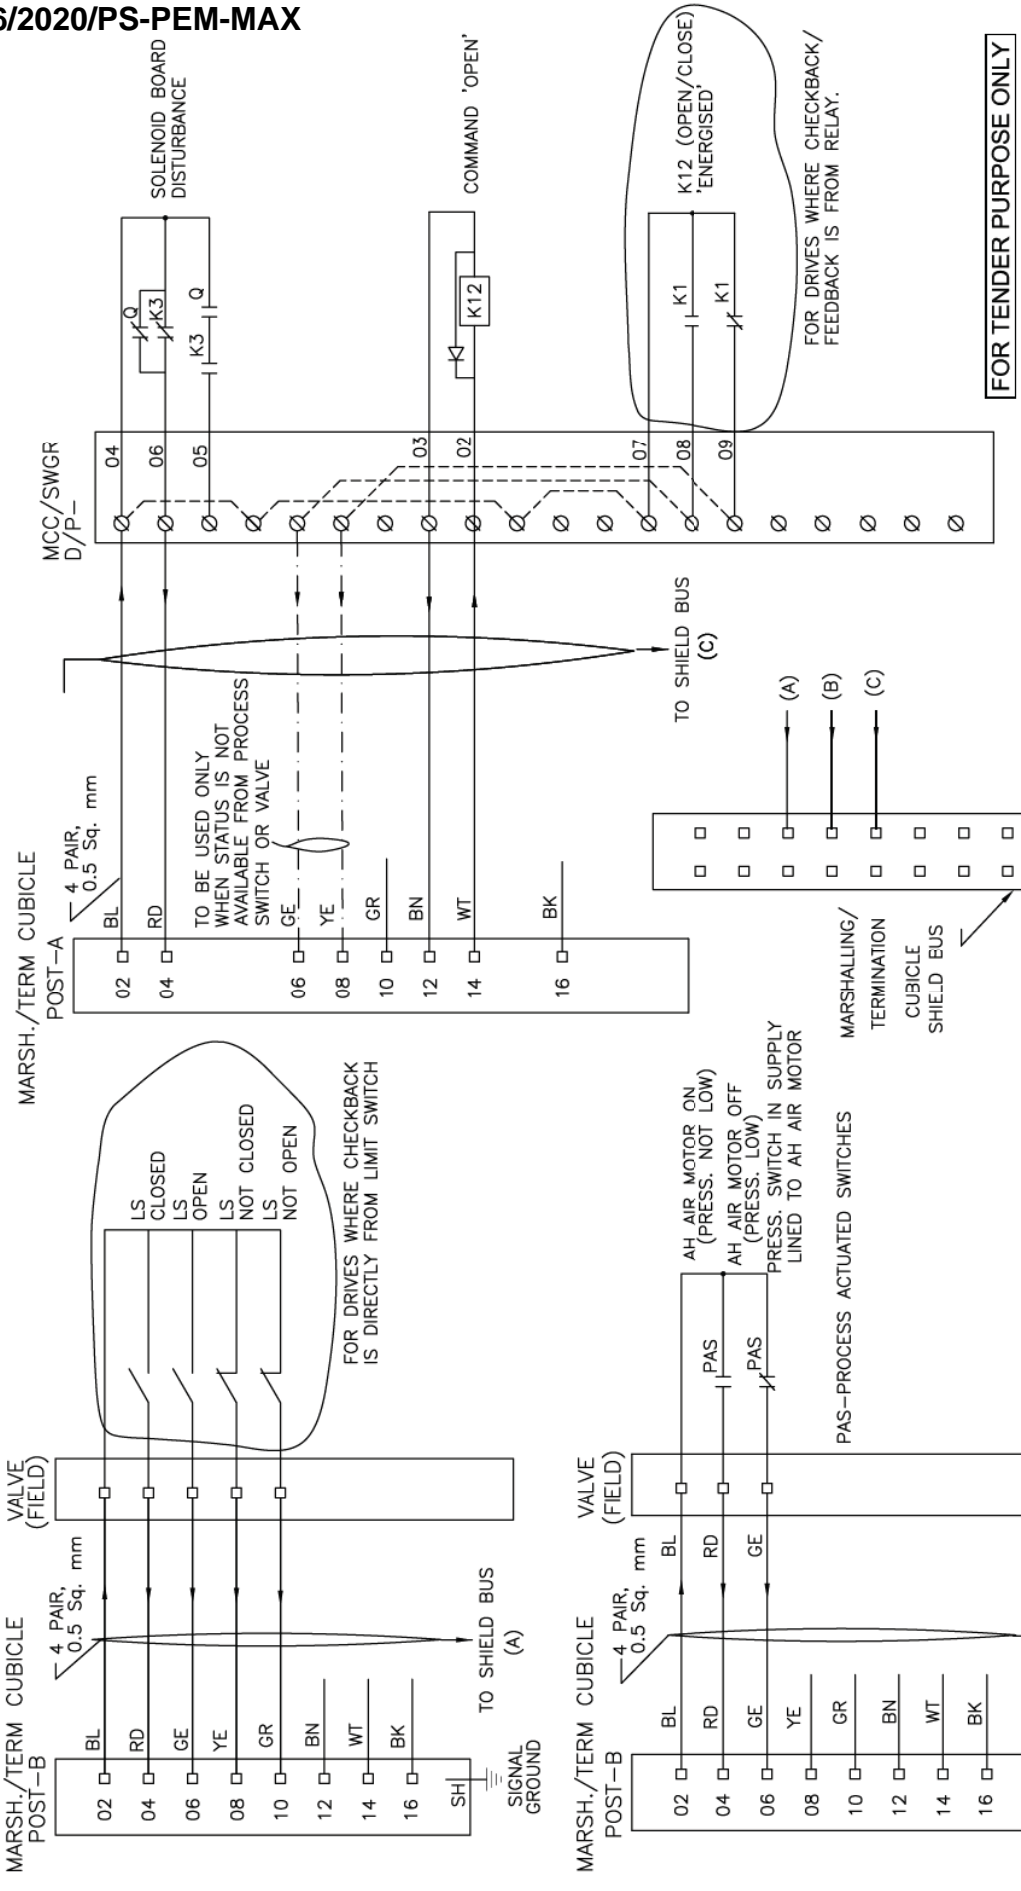

<p>NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION</p>		<p>PROJECT: TYPICAL THERMAL POWER PROJECT</p>	
<p>TITLE: INTERFACE OF DDCMIS WITH MCC/SWGR/ACTUATOR (SINGLE COIL SOLENOID)</p>		<p>DATE: 21.08.12</p>	<p>REV. NO. A</p>
<p>SIZE: A3</p>	<p>SCALE: NTS</p>	<p>DRG. NO. 0000-999-POI-A-065</p>	<p>SH. 08 OF 15</p>
<p>DESCRIPTION</p>			
<p>REV. NO. A</p>	<p>FIRST ISSUE</p>	<p>DRAWN DESIGN CHKD.</p>	<p>CHECKED BY</p>
<p>CLEARED BY</p>			

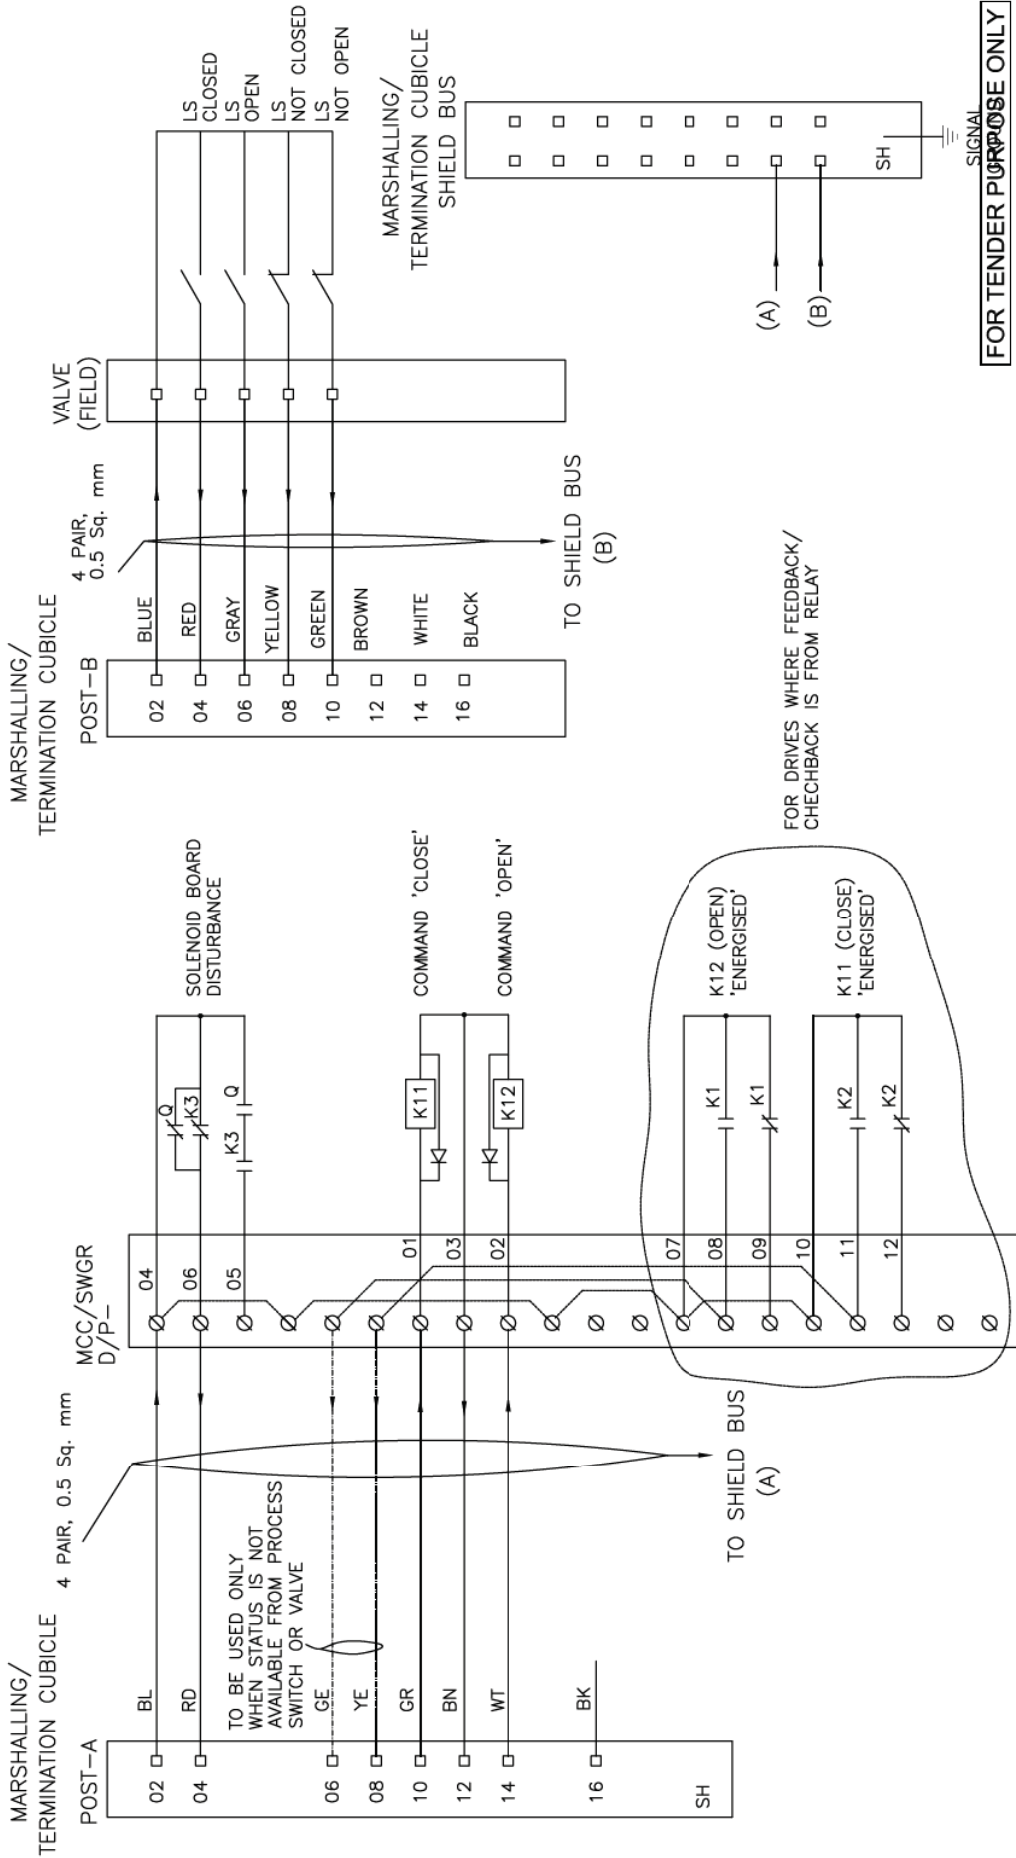

FOR TENDER PURPOSE ONLY



NTPC LIMITED
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION


PROJECT		TYPICAL THERMAL POWER PROJECT	
TITLE		INTERFACE OF FIELD INSTRUMENTS (DOUBLE COIL SOLENOIDS)	
REV. NO.	DATE	SCALE	DRG. NO.
A	21.08.12	NTS	0000-999-POI-A-065
DESCRIPTION		SIZE	REV. NO.
		A3	A
DRAWN DESIGN CHKD.		SH 09 OF 15	
C&I		ARCH.	
M		E C	
CLEARED BY			



**C&I SPECIFICATION FOR
HVAC SYSTEM**

SECTION: C
SUB SECTION: C&I

**QUALITY ASSURANCE FOR
INSTRUMENTS & LCP AND TYPE TEST
REQUIREMENTS**


CLAUSE NO.	QUALITY ASSURANCE & INSPECTION										
MEASURING INSTRUMENTS (PRIMARY AND SECONDARY)											
TESTS	Dimensions (R)	Make, Model, Type, Rating (R)	Process / Electrical connection (R)	Calibration (R)	Test as per standard(R)	Insulation Resistance (R)	IBR Certification (if applicable)(R)	Hydro Test(R)	Material Test certificate ®		
ITEMS											
1. PR Gauge (IS-3624)	Y	Y	Y	Y	Y						
2. Temp. Gauge (BS-5235)	Y	Y	Y	Y	Y						
3. Pr./D.P.Switch(BS-6134)	Y	Y	Y	Y	Y	Y					
4. Electronic Transmitter(IEC-60770)	Y	Y	Y	Y	Y	Y					
5. Temp. Switch	Y	Y	Y	Y	Y	Y					
6. Recorder(IS-9319/ANSI C-39.4)	Y	Y	Y	Y	Y	Y					
7. Vertical indicators	Y	Y	Y	Y		Y					
8. Digital Indicators	Y	Y	Y	Y		Y					
9. Integrators	Y	Y	Y	Y							
10. Electrical Metering Instrument (IS-1248)	Y	Y	Y	Y	Y	Y					
11. Transducer (IEC-688)	Y	Y	Y	Y	Y	Y					
12. Thermocouples (IEC – 754 / ANSI-MC-96.1)	Y	Y	Y	Y	Y	Y					
13. RTD(IEC-751)	Y	Y	Y	Y	Y	Y					
14. Thermowell	Y		Y				Y	Y	Y		
R-Routine Test A- Acceptance Test Y – Test applicable											
<p>: Note: 1) Detailed procedure of Environmental Stress Screening shall be as per Quality Assurance Programme in General Technical Conditions. Requirement of test and procedure (if required) finalized during QP finalization</p> <p>2) This is an indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the Practices and Procedure adopted along with relevant supporting documents.</p>											


CLAUSE NO.	QUALITY ASSURANCE & INSPECTION											एनटीपीसी NTPC
MEASURING INSTRUMENTS (PRIMARY AND SECONDARY)												
TESTS												
ITEMS	Dimensions (R)	Make, Model, Type, Rating (R)	Process / Electrical connection (R)	Calibration (R)	Requirement as per standard (R)	WPS approval (A)	Non-destructive testing (R)	Calculation for accuracy (R)	Insulation Resistance (R)	IBR Certification as applicable (R)	Hydro test (R)	Material test certificate (A)
15. Cold junction compensation box	Y	Y	Y	Y					Y			
16. Orifice plate(BS-1042)	Y	Y	Y	Y*	Y	Y**	Y**			Y	Y**	Y
17. Flow nozzle(BS-1042)	Y	Y	Y	Y*	Y	Y	Y			Y	Y	Y
18. Impact head type element	Y	Y	Y					Y				Y
19. Level transmitter/float type switch	Y	Y	Y	Y					Y	Y	Y	Y
20. Analysers	Y	Y	Y	Y								
21. Dust emission monitors	Y	Y	Y	Y								
*Calibration to be carried out on one flow element of each type and size if calibration carried out as type test same shall not be repeated.												
** If applicable												
R-Routine Test	A- Acceptance Test				Y – Test applicable							
<p>Note: 1) Detailed procedure of Environmental Stress screening test shall be as per Quality Assurance Programme in General Technical Conditions. Requirement of test and procedure (if required) finalized during QP finalization</p> <p>2) This is an indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the Practices and Procedure adopted along with relevant supporting documents.</p>												
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE				TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO CS-0011-109(1A)-2				SUB-SECTION-V-QC1 MEASURING INSTRUMENTS (PRIMARY & SECONDARY)				PAGE 2 OF 2

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION													एनटीपीसी NTPC			
Process, Connection & piping FOR C&I SYSTEMS																	
TESTS	Visual ®	GA, BOM, Layout of component & construction feature®	Dimension ®	Paint Shade/thickness ®	Flattening, flaring, hydrotest, hardness check as per ASTM standard	Component Ratings ®	Wiring ®	Make, Model, Type, Rating®	IR & HV ®	Review of TC for instrument/devices (R)	Accessibility of TBs/Devices ®	Illumination,grounding ®	Tubing ®	Leak/Hydro test(A)	Chemical/physical properties of material (A)	Proof pressure test,Dismantling & reassembly test,Hydraulic impulse and vibration test (R)	Tests as per standards & specification
ITEMS																	
Local Instrument enclosure	Y	Y	Y	Y		Y	Y	Y	Y	Y	Y	Y	Y	Y			
Local instruments racks	Y	Y	Y	Y		Y	Y	Y	Y	Y	Y	Y	Y	Y			
Junction Box	Y	Y	Y	Y	*	Y		Y	Y								
Gauge Board	Y	Y	Y	Y		Y		Y		Y			Y	Y			
Impulse pipes and tubes	Y		Y		Y			Y							Y		
Socket weld fittings ANSI B-16.11	Y		Y					Y							Y		Y
Compression fittings	Y		Y					Y						Y	Y	Y	
Instrument valves & Valve manifolds	Y		Y					Y						Y	Y		
Copper tubings ASTM B75	Y							Y									Y
<p>*-applicable for painted junction boxes.</p> <p>Note: R-Routine Test A- Acceptance Test Y – Test applicable</p> <p>Note: This is an indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the Practices and Procedure adopted alongwith relevant supporting documents.</p>																	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO CS-0011-109(1A)-2	SUB-SECTION-V-QC2 PROCESS CONNECTION PIPING	PAGE 1 OF 1														


CLAUSE NO.		QUALITY ASSURANCE & INSPECTION											एनटीपीसी NTPC			
INSTRUMENTATION CABLE																
TESTS	ITEMS	Conductor Resistance ® & (A)	High Voltage ® & (A)	Insulation Resistance ® & (A)	Constructional detail, dimensions (A)	Outer-Sheath/core marking, end sealing (A)	Thermal Stability (A) +	Visual, Surface finish (A) +	Electrical Parameters ** (A) +	Persulphate Test (A) +	Overall/Coverage/Continuity (A)	Swidesh chimney Test (SS-4241475) (A) ++	FRLS Test * (A) ++	Tensile & Elongation before & after aging (A) ++	Vol. Resistivity. at room & Elevated Temp. (A) ++	Spark test report review ®
1. Instrument cable twisted and shielded																
Conductor(IS-8130)		Y			Y		Y									
Insulation(VDE-207)					Y	Y	Y	Y						Y		Y
Pairing/Twisting					Y	Y	Y									
Shielding					Y			Y		Y						
Drain wire		Y			Y			Y		Y	Y					
Inner Sheath					Y	Y	Y	Y					Y	Y		
Outer Sheath					Y	Y	Y	Y					Y	Y		
Over all cable		Y	Y	Y	Y	Y		Y	Y			Y			Y	
Cable Drums(IS-10418)					Y			Y								
<p>Note : High Temp. cables shall be subjected to tests as per VDE-207(Part-6) Compensating cables shall be checked for Thermal EMF/Endurance test as per IS 8784.</p> <p>Note : This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating his practice & Procedure along with relevant supporting documents during QP finalization for all items.</p> <p>Note : ® - Routine Test A - Acceptance Test Y - Test Applicable</p> <p>Note : Sampling Plan for Acceptance test shall be as per IS 8784 (As applicable)</p> <ul style="list-style-type: none"> * FRLS Tests: Oxygen / Temp Index (ASTM D-2863), Smoke Density Rating (ASTM – D 2843), HCL Emission (IEC-754-1) ** Characteristic Impedance, Attenuation, Mutual Capacitance, Cross Talk (As applicable) <p>+ Sample size will be One No. of each size/type per lot.</p> <p>++ Sample size will be One No. sample for complete lot offered irrespective of size/type.</p>																
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE					TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO CS-0011-109(1A)-2					SUB-SECTION-V-QC3 INSTRUMENTATION CABLES				PAGE 1 OF 1		

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION													एनटीपीसी NTPC	
CONTROL DESK, PLC PANEL, SMOKE DETECTOR, FIRE ALARM & CONTROL SYSTEM															
ITEMS	TESTS														
	Visual ®	GA, BOM , Lay Out of components ®	Dimensions ®	Paint Shade/Thickness/Adhesion ®	Alignment of Section ®	Component Rating/ Make / Type ®	Wiring ®	IR & HV ®	Review of TC for instruments/ Devices/ Recorders, Indicators/ osaic Items/ Transducers ®	Accessibility of TBS/ Devices ®	Illumination ®	Functional Check for Control Element	Mimic ®	Test as per IEC 1131 ® *	Test as per Std ® & (A)
1. Control Desk	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
2. Annunciation/ Control/ PLC Panel	Y	Y	Y	Y		Y	Y	Y	Y	Y	Y			Y	
3.Smoke Detectors (UL-268,EN-54 PT-7), Heat Detectors(UL-521/EN 54 PT-5) Annunciation/ Control Panel (UL -864, EN-54, PT-2)														Y	
<p>Note: 1) Detailed procedure of Environmental Stress Screening test shall be as per Quality Assurance Programme in General Technical Conditions</p> <p>2) This is an indicative list of test/ checks. The manufacturer is to furnish a detailed quality plan indicating the Practice and Procedure alongwith relevant supporting documents.</p> <ul style="list-style-type: none"> *Applicable for PLC Y - Test Applicable , ® - Routine Test (A) - Acceptance Test 															
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION - VI, PART-B BID DOC. NO CS-0011-109(1A)-2				SUB-SECTION-V-QC4 CONTROL DESK, PLC PANEL, SMOKE DETECTOR, FIRE ALARM & CONTROL SYSTEM				PAGE 1 OF 1						

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION															
ELECTRICAL ACTUATOR WITH INTEGRAL STARTER																
Test/Attributes Characteristics																
ITEM/ COPONENT/ SUB SYSTEM ASSEMBLY/ TESTING	RPM ®	No Load Current ®	IR & HV Test®	Mounting Dimension®	All routine Test as per Standard & Specification®	Correct Phase Sequence®	Operation & Setting of limit Switch/Torque Switch®	Stall Torque/Current (A)	Hand Wheel operation/ Auto de clutch function (A)	Function of Aux. like Potentiometer, space heater, position indicator	EPT output ®	Grease leakage ®	Local/ Remote (Open-Stop-Close) Operation®	Safety check (Single phasing, Phase correction, Tripping etc.) (A)		
ELECTRICAL ACTUATOR WITH INTEGRAL STARTER (IS 9334)																
Motor	Y	Y	Y	Y	Y											
Final Testing	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y			
<p>Note: 1) Detailed procedure of Environmental Stress Screening test shall be as per Quality Assurance Programme in General Technical Conditions. Requirement of test and procedure finalized during QP finalization</p> <p>2) This is an indicative list of tests/checks. The manufacturer is to furnish a detailed quality plan indicating the practices and procedure adopted along with relevant supporting documents.</p> <p>® - Routine Test (A) - Acceptance Test Y - Test applicable</p>																
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE					TECHNICAL SPECIFICATION SECTION - VI, PART-B BID DOC. NO CS-0011-109(1A)-2					SUB-SECTION-V-QC7 ELECTRICAL ACTUATOR WITH INTEGRAL STARTERS					PAGE 1 OF 1	

CLAUSE NO.	QUALITY ASSURANCE & INSPECTION			
VFD MODULE SQE_28				
ATTRIBUTES / CHARACTERISTICS	Visual & Dimensional checks	Make / Type / Rating etc.	Final Inspectio n as ISS / IEC	Remarks
ITEMS/COMPONENTS, SUB SYSTEM ASSEMBLY				
HT Breaker (IEC 56)	Y	Y	Y	
DC Reactor	Y	Y		For details refer table for DC Reactor
Transformer	Y	Y		For details refer table for Transformer
Motor	Y	Y		For details refer separate table for Motor
VFD Panel	Y	Y		For details refer table for VFD
<p>Note : 1) This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating the practices & Procedure followed alongwith relevant supporting documents during QP finalisation.</p> <p>2) Make of all major Bought Out Items will be subject to NTPC approval.</p>				
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO CS-0011-109(1A)-2		SUB-SECTION-V-QE13 VFD MODULE	PAGE 1 OF 5

CLAUSE NO.		QUALITY ASSURANCE & INSPECTION							एनटीपीसी NTPC
DC REACTOR									
ATTRIBUTES / CHARACTERISTICS		Visual	Dimensional	Mech. & Chem. Property	Electrical Characteristics	Pretreatment by Seven Tank	Painting by Stove Enameling	Final Inspection as per IS-2026	Welding/NDT
ITEMS/COMPONENTS, SUB SYSTEM ASSEMBLY									
Winding Material (Aluminium)		Y	Y	Y	Y				
Insulation Material		Y	Y		Y				
Sheet Steel		Y	Y	Y					
Winding		Y	Y		Y				
Fabrication of Enclosures		Y	Y			Y	Y		Y
Assembly		Y	Y						
Routine Tests		Y	Y					Y	
<p>Note : 1) This is an indicative list of tests/checks. The manufacturer to furnish a detailed Quality Plan indicating their practice & procedure along with relevant supporting documents during QP finalisation for all items.</p> <p>2) All major Bought Out Items will be subject to NTPC approval.</p>									
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE			TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO CS-0011-109(1A)-2			SUB-SECTION-V-QE13 VFD MODULE		PAGE 2 OF 5	

CLAUSE NO.		QUALITY ASSURANCE & INSPECTION											
													
TRANSFORMER (OIL FILLED)													
Attributes / Characteristics Items/Components Sub Systems	Visual & Dimensional Checks	Mechanical properties	Electrical strength	Thermal properties	Chemical Composition	Compatibility with oil	NDT / DPT / MPI / UT	Ageing Test.	Voltage Ratio, Vector Group & Polarity, Magnetic Balance Test	Make / Type / Rating / Model / TC / General Physical Inspection.	WPS & PQR	Routine Test as per relevant test	Routine Test
Tank, H.V. & L.V. Cable Box / Flange throat	Y	Y					Y						
Conservator / Radiator / Cooler / Pipes	Y	Y					Y						
Copper Conductor (IS:191)	Y	Y	Y		Y								
Insulating Material	Y	Y	Y	Y	Y	Y							
CRGO Lamination & Built Core	Y	Y	Y		Y	Y							
Bushing / Insulator (IS:2544 / 5621)	Y	Y								Y		Y	
Gasket	Y				Y	Y		Y				Y	
Transformer Oil (IS:335 / IEC296)												Y	
Off-Circuit Tap Changer	Y									Y			
Core Coil Assembly & Pre-tanking	Y								Y				
Marshalling Box	Y	Y					Y					Y	
WTI, OTI, MOG, PRD, Breather, Terminal Connector, Bucholz Relay, Globe & Gate Valve,	Y									Y			
Welding (ASME Sect-IX)	Y										Y		
Complete Transformer (IS:2026/ IEC-60076)	Y												Y
<p>Note: 1) This is an indicative list of tests / checks. The manufacturer is to furnish a detailed Quality Plan indicating the practice and procedure along with relevant supporting documents. 2) All major Bought Out Items will be subject to NTPC approval.</p>													
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE				TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO CS-0011-109(1A)-2				SUB-SECTION-V-QE13 VFD MODULE			PAGE 3 OF 5		


CLAUSE NO.		QUALITY ASSURANCE & INSPECTION										एनटीपीसी NTPC	
DRY TYPE TRANSFORMER													
Attributes / Characteristics	Items/Components Sub Systems	Visual & Dimensional check	Mechanical properties	Electrical strength	Thermal Properties	Chemical Properties	NDT / DP / MPI	Voltage Ratio, Vector Group & Polarity	Make / Type / Rating / Model /TC / General Physical Inspection	WPS & PQR	Routine Test as per relevant standard	Measurement of capacitance & tan delta between winding	Routine Test
	Enclosure door, H.V. & L.V. Cable Box / Flange Throat	Y	Y						Y				
	Copper Conductor	Y	Y	Y		Y							
	Insulating Material	Y			Y	Y							
	CRGO Lamination & Built Core	Y											
	Bushing /Insulator (IS:2544 / 5621)	Y							Y		Y		
	Gasket	Y							Y		Y		
	Off-Circuit Tap Changer	Y							Y				
	Core Coil Assembly	Y						Y					
	Marshalling Box	Y									Y		
	WTI, Thermister, Terminal Connector	Y							Y				
	Welding								Y				
	Complete Transformer (IS:11171 / IEC 60076)	Y										Y	Y
Notes: 1)		This is an indicative List of test/checks. The manufacturer is to furnish a detailed Quality Plan indicating his practice and procedure along with relevant supporting documents during QP finalization for all item.											
2.		All major Bought out Items will be subject to NTPC approval.											





CLAUSE NO.		QUALITY ASSURANCE & INSPECTION											एनटीपीसी NTPC		
VFD PANEL															
Attributes Characteristics	Item Components Sub System Assembly	Electrical Properties	Mechanical Properties	Chemical Properties	Dimensions / Finish	Type/ Rating/Functional check	HV/IR	Routine test as per relevant std.	Constructional Features	IS:6005 ,Seven tank process	Paint finish/ shade/thickness	Mountings / BOM/ Make, Completeness	Interlock Functional & Operation Testing / Simulation check	Degree of Protection Test	Final testing as per Relevant
		Sheet Steel (IS-513)		Y	Y	Y									
Aluminum / Copper Bus-bar (IS-5082/IS-613/IS-1987)		Y	Y	Y	Y										
Support Insulator (BS-2782/IEC-660/IS-10912)		Y	Y	Y	Y										
Control / Selector Switch (IS-6875)						Y	Y	Y							
Contactors/ MCB (IS-13947)						Y	Y	Y							
O/L Protection relays (IS-3231)						Y		Y							
C.T /V.T/ Indicating Meter (IS-2705/3156/1248)						Y	Y	Y							
Fuse/ Fuse carrier (IS-13703)						Y	Y	Y							
Terminals/lugs/pvc wires (IS-13947//IS-694)		Y			Y	Y	Y	Y							
Timers (IS-3231)						Y	Y	Y							
Push Button/ Lamp/ (IS-6875)						Y	Y	Y							
Control Transformer (IS-12021)						Y	Y	Y							
Mimic, Annunciater						Y		Y							
GASKET (IS-11149)			Y	Y	Y	Y		Y							
Fabrication									Y						
Pretreatment & Painting										Y	Y				
VFD panel										Y	Y	Y	Y	Y	Y
NOTE:															
1. This is an indicative list of Test/ Checks. The manufacturer to furnish a detailed Quality Plan indicating the practice and procedure along with relevant supporting documents.															
2. All major Bought Out Items will be subject to NTPC approval.															
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE					TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO CS-0011-109(1A)-2					SUB-SECTION-V-QE13 VFD MODULE			PAGE 5 OF 5		

MANUFACTURER/BIDDER/SUPPLIER		STANDARD QUALITY PLAN				SPEC. NO. :		DATE:			
NAME & ADDRESS		CUSTOMER :				QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020			
PROJECT:		PROJECT:				PO NO.: --		DATE: --			
ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I				SECTION: C		SHEET 1 OF 9			
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY	REMARKS
					M	C/N				M C N	
1	2	3	4	5	6	7	8	9	*	D	**
1.0	RAW MATERIAL Sheet Steel (CRCA & HR)	1. Chemical Composition 2. Bend Test 3. Surface finish 4. Waviness 5. Thickness 6. Mill marking	MA CR MA MA MA MA	Chemical analysis Mech. test Visual Visual Measurement Visual	100% 100% 100% 100%	Samp le Samp le 10% 10%	IS:1079 IS:513 IS:1079 IS:513 Manufacturing Standard Manufacturing Standard	IS:1079 IS:513 IS:1079 IS:513 Manufacturing Standard No Waviness	Test Certificate Test Certificate Inspection Report Inspection Report Inspection Report Inspection Report	PW PW PW PW PW PW	V V -- -- V V
2.0	Flats / Angles / Channels	1. Dimensions 2. Surface Defects 3. Straightness 4. Mill marking	MA MA MA MA	Measurement Visual Measurement Visual	100% 100% 100% 100%	Samp le 100% 100% 100%	IS:2062 Manufacturing Standard Manufacturing Standard IS:2062	IS:2062 Manufacturing Standard Manufacturing Standard IS:2062	Test Certificate Inspection Report Inspection Report Inspection Report	PW PW PW PW	-- -- -- V

ENGINEERING				QUALITY			
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name	Reviewed by:	Seal
<i>[Signature]</i>	14/12/2020	CHETAN MALIK	<i>[Signature]</i>	14/12/2020	KUNDAN PRASAD		
<i>[Signature]</i>	14/12/2020	RK RAINA	<i>[Signature]</i>	14/12/2020	RK JAISWAL		

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal

MANUFACTURER/BIDDER/SUPPLIER		STANDARD QUALITY PLAN				SPEC. NO. :		DATE:			
		CUSTOMER :				QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020			
		PROJECT:				PO NO.: --		DATE: --			
		ITEM: LOCAL CONTROL PANEL				SYSTEM: C&I		SECTION: C		SHEET 2 OF 9	
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY	REMARKS	
1	2	3	4	5	6	7	8	9	**		
					M			D	M	C	N
3.0	Cables / Wires	1. Visual / Surface defects 2. IR and HV 3. Conductor a) Resistance b) Size c) Sheet colour	MA MA MA	Visual Electrical	100% 100%	IS:1554 or IS:694 IS:1554 or IS:694	IS:1554 or IS:694 IS:1554 or IS:694	Inspection Report Inspection Report	PW PW		
4.0	Electrical Components like Annunciator Transformers Lamps Switches PBs Contactors Relays	1. Verification at make and Type 2. Verification of Test Certificates 3. Operation / Functional check	CR CR CR	Visual Scrutiny of Type / Routine T.Cs. Electrical	100% 100% 100%	Approved Drg/Datasheet Relevant Indian Std & Catalogue Relevant Indian Std & Catalogue	Approved Drg/Datasheet Relevant Indian Std & Catalogue Relevant Indian Std & Catalogue	Test Certificate Inspection Report Inspection Report	PW PW PW		+ for relay & contactors only

ENGINEERING				QUALITY			
Sign & Date	Name	Sign & Date	Name	Sign & Date	Name	Sign & Date	Name
	CHETAN MALIK		KUNDAN PRASAD				
	RK RAINA		RK JAIWAL				







FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal

MANUFACTURER/BIDDER/SUPPLIER		STANDARD QUALITY PLAN				SPEC. NO.:		DATE:		
NAME & ADDRESS		CUSTOMER :				QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020		
PROJECT:		PROJECT:				PO NO.: --		DATE: --		
ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I				SECTION: C		SHEET 3 OF 9		
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY	REMARKS
					M				M C N	
1	Timers, Space Heaters, Thermostat, Indicating meters etc.	4. I.R. 5. H.V.	MA	Electrical	100% 10%	Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue	Inspection Report	PW	@ for all components except relays & contactors.
		6. Calibration	MA	Electrical	100%	Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue	Inspection Report	PW	
		7. Pick up / Drop off Voltage	MA	Electrical	100%	Relevant Indian Std & Catalogue	Relevant Indian Std & Catalogue	Inspection Report	PW	
5.0	Misc. Components like Gaskets, Terminal Blocks etc.	1. Verification of Type / Make 2. Surface defects 3. IR / HV on Terminal Blocks	MA	Visual	Samp le	Manufacturing Standard	Manufacturing Standard	Test Certificate	PW	
			MA	Visual	Samp le	Manufacturing Standard	Manufacturing Standard	Test Certificate	PW	
			MA	Electrical	Samp le	Manufacturing Standard	Manufacturing Standard	Test Certificate	PW	
	IN PROCESS INSPECTION									


BHEL			
ENGINEERING		QUALITY	
Sign & Date	Name	Sign & Date	Name
<i>[Signature]</i>	CHETAN MALIK	<i>[Signature]</i>	KUNDAN PRASAD
Prepared by:		Checked by:	
<i>[Signature]</i>	RK RAINA	Reviewed by:	RK JAISWAL
Reviewed by:		Reviewed by:	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

MANUFACTURER/BIDDER/SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN				SPEC. NO.:		DATE:			
		CUSTOMER:		QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020					
		PROJECT:		PO NO.: --		DATE: --					
		ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I		SECTION: C		SHEET 4 OF 9			
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY	REMARKS
					M	C/N				M C N	
1	2	3	4	5	6	7	8	9	10	11	12
6.0	Blanking / Bending / Forming	1. Dimensions 2. Surface defects after bending	MI MA	Measurement Visual	100% 100%	10% 10%	Approved Drg/Datasheet Manufacturing Standard	Approved Drg/Datasheet Manufacturing Standard	Inspection Report Inspection Report	PW PW	
7.0	Nibbling / Punching	1. Cutout Sizes 2. Deburring	MI MA	Measurement Visual	100% 100%	10% 10%	Approved Drg/Datasheet Approved Drg/Datasheet	Approved Drg/Datasheet Approved Drg/Datasheet	Inspection Report Inspection Report	PW PW	
8.0	ASSEMBLY Frame Assembly & Sheet fixing	1. Dimensions 2. Alignment 3. Welding Quality 4. Surface defects	MA MA MA MA	Measurement Measurement Visual Visual	100% 100% 100% 100%	10% 10% 10% 10%	Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet	Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet	Inspection Report Inspection Report Inspection Report Inspection Report	PW PW PW PW	

ENGINEERING				QUALITY			
Sign & Date	Name	Sign & Date	Name	Sign & Date	Name	Sign & Date	Name
	CHETAN MALIK		Checked by:		KUNDAN PRASAD		
	RK RAINA		Reviewed by:		RK JAISWAL		

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal

MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN					SPEC. NO. :		DATE:			
		CUSTOMER :					QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020			
		PROJECT:					PO NO.: --		DATE: --			
		ITEM: LOCAL CONTROL PANEL					SYSTEM: C&I		SECTION: C			
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY	REMARKS	
					M	C/N				M	C	N
1	2	3	4	5	6	7	8	9	*	**		
9.0	Pre-treatment and Painting	1. Pretreatment Process 2. Process parameters like bath temp. concentration etc. 3. Dipping / Removal Time 4. Surface quality after every dip 5. Primer after phosphating 6. Putty Application & Rubbing after primer 7. Paint first coat	MA MA MA MA MA MA MA	Visual Measurement Measurement Visual Visual, Thickness Visual Visual, Thickness	100% Periodic 100% 100% 100% 100% 100%	10% Periodic 10% 10% 10% 10% 10%	Manufacturing Standard Manufacturing Standard Manufacturing Standard Manufacturing Standard Manufacturing Standard Manufacturing Standard Manufacturing Standard	Manufacturing Standard Manufacturing Standard Manufacturing Standard Manufacturing Standard Manufacturing Standard Manufacturing Standard Manufacturing Standard	✓ ✓ ✓ ✓ ✓ ✓ ✓	PW PW PW PW PW PW PW	V V V V V V V	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			


BIDDER/ SUPPLIER	
Sign & Date	Seal





BHEL			
ENGINEERING		QUALITY	
Prepared by:	Sign & Date	Checked by:	Sign & Date
Reviewed by:	Name	Reviewed by:	Name
	CHETAN MALIK		KUNDAN PRASAD
	RK RAINA		RK JAISWAL

MANUFACTURER/BIDDER/SUPPLIER		STANDARD QUALITY PLAN					SPEC. NO.:		DATE:				
NAME & ADDRESS		CUSTOMER :					QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020				
PROJECT:		SYSTEM: C&I					PO NO.: --		DATE: --				
ITEM: LOCAL CONTROL PANEL		QUANTUM OF CHECK					SECTION: C		SHEET 6 OF 9				
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANC E NORMS	FORMAT OF RECORD	AGENCY			REMARKS
					M	C/N				M	C	N	
1	2	3	4	5	6	7	8	9	*	**			
		8. Putty Application and Rubbing after first coat of paint	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	✓	P/W	V	
		9. Paint second coat	MA	Visual, Thickness, Scratch test Colour adhesion	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	✓	P/W	V	
10.	Panel Wiring	1. Wiring Layout	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	✓	P/W		
		2. Wiring Termination (Crimped Lugs)	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	✓	P/W		
		3. Ferrule numbers	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	✓	P/W		
		4. Colour of wiring	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	✓	P/W	V	
		5. Size of Conductor	MA	Measurement	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	✓	P/W	V	
11.	Component Mounting	1. Correct components	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	✓	P/W		
		2. Fixing	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	✓	P/W		

BHEL				QUALITY			
ENGINEERING		SIGNATURE		SIGNATURE		SIGNATURE	
Sign & Date	Name	Sign & Date	Name	Sign & Date	Name	Sign & Date	Name
	CHETAN MALIK		KUNDAN PRASAD		RK RAINA		RK JAISWAL
Prepared by:		Checked by:		Reviewed by:		Reviewed by:	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN					SPEC. NO.:		DATE:	
		CUSTOMER :		QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020				
		PROJECT:		PO NO.: --		DATE: --				
		ITEM: LOCAL CONTROL PANEL		SYSTEM: C&I		SECTION: C		SHEET 7 OF 9		
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY	REMARKS
1	2	3	4	5	6	7	8	9	M C N	
12.	Final Inspection	1. Workmanship 2. Component layout (neatness, accessibility & safety) Mounting / Proper fixing of all components 3. Components identification Marking / Name plates 5. Dimensions 6. Door functioning 7. Paint Shade	MA MA MA MA MA CR	Visual Visual Visual Measurement Functional Visual	100% 100% 100% 100% 100% 100%	Manufacturing Standard Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet	Manufacturing Standard Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet Approved Drg/Datasheet	Inspection Report Inspection Report Inspection Report Inspection Report Inspection Report Inspection Report	PW PW PW PW PW PW	At Random by BHEL, based on 100 % internal test reports by Mfr. At Random by BHEL, based on 100 % internal test reports by Mfr.

ENGINEERING				QUALITY			
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name	Reviewed by:	Sign & Date
		CHETAN MALIK			KUNDAN PRASAD		
		RK RAINA			RK JAISWAL		

BHEL				BIDDER/ SUPPLIER			
Doc No.:	Sign & Date	Name	Seal	Sign & Date	Name	Seal	Seal

FOR CUSTOMER REVIEW & APPROVAL

MANUFACTURER/ BIDDER/ SUPPLIER		STANDARD QUALITY PLAN					SPEC. NO.:		DATE:		
		CUSTOMER :					QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020		
		PROJECT:					PO NO.: --		DATE: --		
		ITEM: LOCAL CONTROL PANEL					SYSTEM: C&I		SECTION: C		SHEET 8 OF 9
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY	REMARKS
					M	C/N				M C N	
1	2	3	4	5	6	7	8	9	10	11	12
	8. Paint Thickness	CR	Measurement	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	PW	W	
	9. Workmanship of Gaskets	MA	Visual	100%	10%	Manufacturing Standard	Manufacturing Standard	Inspection Report	PW	W	
	10. Wiring Layout	MA	Visual	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	PW	W	
	11. Wire Termination	MA	Pulling manually	Sample	Sample	-----	Firm termination	Inspection Report	PW	W	
	12. Continuity	MA	Electrical	100%	10%	-----	Continuity OK	Inspection Report	PW	W	
13.	TYPE TEST	CR	Degree of Protection	Mech. Protection	Sample	Sample	Approved Drg/Datasheet	Type Test Certificate	PW	V	
14	ROUTINE TEST	CR	IR before & after HV Test	Electrical	100%	10%	Approved Drg/Datasheet	Inspection Report	PW	W	

BHEL				BIDDER/ SUPPLIER				FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING		QUALITY		Sign & Date		Sign & Date		Sign & Date		Name	
Prepared by:		Checked by:		Sign & Date:	07/02/2020	Sign & Date:		Reviewed by:		Reviewed by:	
Reviewed by:		Reviewed by:		Sign & Date:	07/02/2020	Sign & Date:		Approved by:		Approved by:	

MANUFACTURER/BIDDER/SUPPLIER		STANDARD QUALITY PLAN				SPEC. NO.:		DATE:			
NAME & ADDRESS		CUSTOMER :				QP NO.: PE-QP-999-145-1056		DATE: 07.02.2020			
		PROJECT:				PO NO.: --		DATE: --			
		ITEM: LOCAL CONTROL PANEL				SYSTEM: C&I		SECTION: C			
		SYSTEM: C&I				SECTION: C		SHEET 9 OF 9			
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY	REMARKS
1	2	3	4	5	M	C/N	7	8	9	**	
15	FUNCTIONAL TEST	1. Control Logic Operation 2. Instrument Calibration 3. Temperature rise	CR	Electrical	100%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	PW	
			CR	Electrical	10%	10%	Approved Drg/Datasheet	Approved Drg/Datasheet	Inspection Report	PW	
			CR	Electrical	100%	10%	Approved Drg/Datasheet Relevant IS.	Approved Drg/Datasheet Relevant IS.	Inspection Report	PW	

NOTES:

- Customer's specification for painting shall be included in the technical specification. In the absence of Customer's spec. for painting, vendor to obtain BHEL's approval on their painting specification / procedure.
- Copies of all TC's (Test Certificates) for components shall be submitted to BHEL for verification and acceptance.
- BHEL reserves the right to conduct repeat tests, if required.


LEGENDS:


*RECORDS, IDENTIFIED WITH "TICK"(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION, D: DOCUMENTATION, ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, C: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, N: CUSTOMER, P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
MA: MAJOR, MI: MINOR, CR: CRITICAL


ENGINEERING		QUALITY	
Sign & Date	Name	Sign & Date	Name
	CHE TAN MALIK		KUNDAN PRASAD
	RK RAINA		RK JAI/SWAL

BIDDER/ SUPPLIER	
Sign & Date	Seal

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

CLAUSE NO.	TECHNICAL REQUIREMENTS		
TYPE TEST REQUIREMENTS			
1.00.00	TYPE TEST REQUIREMENTS		
1.01.00	General Requirements		
1.01.01	<p>The Contractor shall furnish the type test reports of all type tests as per relevant standards and codes as well as other specific tests indicated in this specification. A list of such tests are given for various equipment in table titled 'TYPE TEST REQUIREMENT FOR C&I SYSTEMS' at the end of this chapter and under the item Special Requirement for Solid State Equipments/Systems. For the balance equipment instrument, type tests may be conducted as per manufactures standard or if required by relevant standard.</p> <p>(a) Out of the tests listed, the Bidder/ sub-vendor/ manufacturer is required to conduct certain type tests specifically for this contract (and witnessed by Employer or his authorized representative) even if the same had been conducted earlier, as clearly indicated subsequently against such tests.</p> <p>(b) For the rest, submission of type test results and certificate shall be acceptable provided.</p> <p>i. The same has been carried out by the Bidder/ sub-vendor on exactly the same model /rating of equipment.</p> <p>ii. There has been no change in the components from the offered equipment & tested equipment.</p> <p>iii. The test has been carried out as per the latest standards alongwith amendments as on the date of Bid opening but not more than five (5) year back.</p> <p>(c) In case the approved equipment is different from the one on which the type test had been conducted earlier or any of the above grounds, then the tests have to be repeated and the cost of such tests shall be borne by the Bidder/ sub-vendor within the quoted price and no extra cost will be payable by the Employer on this account.</p>		
1.01.02	As mentioned against certain items, the test certificates for some of the items shall be reviewed and approved by the main Bidder or his authorized representative and the balance have to be approved by the Employer.		
1.01.03	The schedule of conduction of type tests/ submission of reports shall be submitted and finalized during pre-award discussion.		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS	PAGE 1 OF 7

CLAUSE NO.	TECHNICAL REQUIREMENTS		
1.01.04	<p>For the type tests to be conducted, Contractor shall submit detailed test procedure for approval by Employer. This shall clearly specify test setup, instruments to be used, procedure, acceptance norms (wherever applicable), recording of different parameters, interval of recording precautions to be taken etc. for the tests to be carried out.</p>		
1.01.05	<p>The Bidder shall indicate in the relevant BPS schedule, the cost of the type test for each item only for which type tests are to be conducted specifically for this project. The cost shall only be payable after conduction of the respective test in presence of authorize representative of Employer. If a test is waived off, then the cost shall not be payable.</p>		
2.00.00	<p>SPECIAL REQUIREMENT FOR SOLID STATE EQUIPMENTS/ SYSTEMS</p>		
2.01.00	<p>The minimum type test reports, over and above the requirements of above clause, which are to be submitted for each of the major C&I systems Analyzer instruments, various PLCs etc. shall be as indicated below:</p> <p>i) Surge Protections for Solid State Equipments/ Systems</p> <p>All solid state systems/ equipments shall be able to withstand the electrical noise and surges as encountered in actual service conditions and inherent in a power plant. All the solid state systems/ equipments shall be provided with all required protections that needs the surge withstand capability as defined in ANSI 37.90a/ IEEE-472. Hence, all front end cards which receive external signals like Analog input & output modules, Binary input & output modules etc. including power supply, data highway, data links shall be provided with protections that meets the surge withstand capability as defined in ANSI 37.90a/ IEEE-472. Complete details of the features incorporated in electronics systems to meet this requirement, the relevant tests carried out, the test certificates etc. shall be submitted alongwith the proposal. As an alternative to above, suitable class of IEC-60255-4 which is equivalent to ANSI 37.90a/ IEEE-472 may also be adopted for SWC test.</p> <p>ii) Dry Heat test as per IEC-68-2-2 or equivalent.</p> <p>iii) Damp Heat test as per IEC-68-2-3 or equivalent.</p> <p>iv) Vibration test as per IEC-68-2-6 or equivalent.</p> <p>v) Electrostatic discharge tests as per IEC 61000-4-2 or equivalent.</p> <p>vi) Radio frequency immunity test as per EN 50082-2 or equivalent.</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS</p>	<p>PAGE 2 OF 7</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS			
	<p>vii) Electromagnetic immunity as per EN 61131-2 or equivalent.</p> <p>Test listed at item no. v, vi, vii, above are applicable for front end cards only as defined under item (i) above.</p>			
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS</p>	<p>PAGE 3 OF 7</p>	

3.00.00 TYPE TEST REQUIREMENT FOR C&I SYSTEMS

SI No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval req. On test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
1	Elect. Metering instruments	As per standard (col 4)	IS-1248	No	Yes	
2	Electronic transmitter	As per standard (col 4)	BS-6447 / IEC-60770	No	Yes	
3	INSTRUMENTATION CABLES TWISTED & SHIELDED					
4	Pressure gauge	Degree of protection test	IS-2147	No	No	
		Temp interference test	IS -3624	No	No	
5	Temperature gauge	Degree of protection test	IS-2147	No	No	
6	Pressure & DP switch	Degree of protection test	IS-2147	No	No	
		As per standard (col 4)	BS 6134	No	No	
7	Level switch	Degree of protection test	IS-2147	No	No	
8	Control valves	CV Test	ISA 75.02	No	Yes	
9	Flow Nozzles & Orifice plate	Calibration	ASME PTC , BS 1042	No	Yes	
10	PLCs	All tests as per IEC-1131	IEC-601131	No	Yes	

LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS	PAGE 4 OF 7
--	--	--	-------------

SI No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
11	Junction Box	Degree of protection test	IS-13947	No	Yes	
12	Battery charger (Not required for inbuilt chargers)	Degree of protection test	IS-13947	No	No	
		Short circuit current capability	IEC-60146-2	No	Yes	
		Temp rise test without redundant fans	Approved procedure, IEC 60146-2	No	Yes	
		SWC test	Approved procedure	No	Yes	
		Burn-in-test	Approved procedure	No	Yes	
		Efficiency	IEC-60146-2,	No	Yes	
		Audible Noise Test	IEC 60146-2	No	Yes	
		Fuse Clearing Capability	Approved procedure	No	Yes	
		Relative harmonic content	Approved procedure	No	Yes	

LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS	PAGE 5 OF 7
--	--	--	-------------

SI No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
		ESD immunity test	IEC-61000-4-2-9(1)	No	Yes	
		Radio interference	IEC 60146-2	No	Yes	
		Over Load Test on Inverter & charger	Approved procedure	No	Yes	
		Restart Test	IEC 60146-2	No	Yes	
		Output voltage tolerance	Approved	No	Yes	
		Output voltage Harmonic content	Approved procedure	No	Yes	
		Insulation test	IEC 60146	No	Yes	
		Load Tests	Approved procedure	No	Yes	
		Preliminary light load test	IEC 60146	No	Yes	
		Current division / Voltage division	IEC 60146-2	No	Yes	
13	Battery	As per standard (col 4)	IEC -623 / IS 10918 for Ni-Cd IS-1652 for Plante Lead Acid	No	Yes	
14	Voltage stabilizers	Over Load Test	Approved procedure	No	Yes	

LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS	PAGE 6 OF 7
--	--	--	-------------

SI No	Item	Test requirement	Standard	Test to be specifically conducted	NTPC's approval test certificate	Remarks
Col 1	Col 2	Col 3	Col 4	Col 5	Col 6	Col 7
		Temp rise test without redundant fans	Approved procedure	No	Yes	

LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C6 TYPE TEST REQUIREMENTS	PAGE 7 OF 7
--	--	--	-------------



C&I SPECIFICATION FOR
HVAC SYSTEM

SECTION: C
SUB SECTION: C&I

SUB VENDOR LIST

PACKAGE WISE REGISTERED SUPPLIER LIST (PERMANENT CATEGORY)			
SI No	Package Name	Supplier Name	Supplier Communication Address
1	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	Kaustubha Udyog,	S.No. 36/1/1, Sinhgad Road, Vadgaon Khurd, Near Lokmat Press, Pune, Phone- 020-24393577, Pincode : Email : pressure@vsnl.com,
2	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	SWITZER PROCESS INSTRUMENTS PVT. LTD.	Mr. V S Jayaprakash, 128, SIDCO North Phase, Ambattur Estates CHENNAI Phone- 044-26252017/2018 Pincode : 600050 Email : sales@switzerprocess.co.in
3	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	DRESSER INDUSTRIES INC.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 02764-233682 Pincode : 382729 Email : Nishit.patel@ashcroftindia.com
4	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	GENERAL INSTRUMENTS CONSORTIUM	Mr. Amarendra Kulkarni 194/195, Gopi Tank Road, Off. Pandurang Naik Marg, Mahim Mumbai Phone- 9323195251 Pincode : 400016 Email : amarendra@general-gauges.com
5	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	Barksdale GmbH, Germany	Michael Weileder Dorn Assenheimer, Strasse 27 Reichelsheim Phone- +91-9999107840 Pincode : D-61203 Email : msingh@barksdale.de
6	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	PRECISION MASS PRODUCTS PVT. LTD.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 9999464663 Pincode : 382729 Email : sales@precisionmass.com
7	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	SOR INC.	LARRY DEGARMO/Avdshesh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdshesh@sherman-india.com,
8	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	INDFOS INDUSTRIES LIMITED	B-20-21, INDUSTRIAL AREA, MEERUT ROAD, GHAZIABAD Phone- 0120-2712016 Pincode : Email : mktg@indfos.com
9	PRESSURE SWITCH/DIFF. PRESSURE SWITCH	INDFOS (INDIA) LIMITED	MR.L.C.VENKATRANGAN/MR.B.KANNAN New No.17, II Floor, Adwave Towers, Dr.Sevalia Shivaji Salai, T.Nagar Chennai Phone- +91 44 24353407 Pincode : 600017 Email : delhi@indfos.com
10	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	BOSE PANDA INSTRUMENTS PVT.LTD.	Mr. Partha Bose 44, Saheed Hemanta Kumar Bose, Sarani, Kolkata Phone- +91 33 2548 7220 Pincode : 700074 Email : parthabosebpi@gmail.com; bosepanda@vsnl.net
11	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	A.N. INSTRUMENTS PVT. LTD.	MARKETING DIVISION, 5th FLOOR, 59-B, CHOWRINGHEE ROAD, KOLKATA Phone- 24757784,22472509 Pincode : 700020 Email : anidel@bol.net.in
12	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	H.GURU INDUSTRIES	Mr. G. D. Hazra/Mr. P. K. Mitra 10 B, HO-CHI-MINH SARANI, KOLKATA Phone- 033 2282 2463 / 1637 Pincode : 700071 Email : mguru@vsnl.net
13	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	PRECISION MASS PRODUCTS PVT. LTD.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 9999464663 Pincode : 382729 Email : sales@precisionmass.com

34636/2020/PS-PEM-MAX

14	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
15	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	H.GURU INSTRUMENTS (SOUTH INDIA) P. LTD	32,INDUSTRIAL SUBURB YESWANTHAPUR BANGALORE Phone- 080-23370300, Pincode : 560022 Email : info@hgurusouth.com
16	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	FORBES MARSHALL (HYD) LTD.	MR SAILESH PATALAY/MR. M K SRINIVASAN PLOT NO.A-19/2, & T-4/2, IDA, NACHARAM, HYDERABAD Phone- 9849913704 Pincode : 500 076 Email : mksrinivasan@forbesmarshall.com
17	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	GAUGE BOURDON INDIA PVT. LTD.	194/195, Gopi Tank Road, Off Pandurang Naik Marg, Mahim Mumbai, Phone- 011-41607463, Pincode : 400016, Email : gicdelhi@general-gauges.com,
18	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	Nesstech Instruments Private Limited	26/2, G Type, Global Industrial Park Near Nahuli Railway Crossing, Valvada Vapi Phone- 9920576002 Pincode : 396105 Email : sales@nesstech.co.in
19	PRESSURE GAUGE/ DIFF.PRESSURE GAUGE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
20	TEMPERATURE GAUGE	FORBES MARSHALL (HYD) LTD.	MR SAILESH PATALAY/MR. M K SRINIVASAN PLOT NO.A-19/2, & T-4/2, IDA, NACHARAM, HYDERABAD Phone- 9849913704 Pincode : 500 076 Email : mksrinivasan@forbesmarshall.com
21	TEMPERATURE GAUGE	GOA INSTRUMENTS INDUSTRIES PVT.LTD.,	D2/5, Mapusa Industrial Estate, Mapusa, Goa, Phone- 09326054551, Pincode : 403507, Email : sumukh@goainstruments.com,
22	TEMPERATURE GAUGE	H.GURU INSTRUMENTS (SOUTH INDIA) P. LTD	32,INDUSTRIAL SUBURB YESWANTHAPUR BANGALORE Phone- 080-23370300, Pincode : 560022 Email : info@hgurusouth.com
23	TEMPERATURE GAUGE	GAUGE BOURDON INDIA PVT. LTD.	194/195, Gopi Tank Road, Off Pandurang Naik Marg, Mahim Mumbai, Phone- 011-41607463, Pincode : 400016, Email : gicdelhi@general-gauges.com,
24	TEMPERATURE GAUGE	H.GURU INDUSTRIES	Mr. G. D. Hazra/Mr. P. K. Mitra 10 B, HO-CHI-MINH SARANI, KOLKATA Phone- 033 2282 2463 / 1637 Pincode : 700071 Email : mguru@vsnl.net
25	TEMPERATURE GAUGE	GOA THERMOSTATIC INSTRUMENTS PVT.LTD.	FLAT -B , GF, HILL CROWN APTS., COLLEGE ROAD, MAPUSA Phone- Pincode : 403525 Email : gtilworks@pyro-electric.in
26	TEMPERATURE GAUGE	A.N. INSTRUMENTS PVT. LTD.	MARKETING DIVISION, 5th FLOOR, 59-B, CHOWRINGHEE ROAD, KOLKATA Phone- 24757784,22472509 Pincode : 700020 Email : anidel@bol.net.in
27	TEMPERATURE GAUGE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
28	TEMPERATURE GAUGE	PRECISION MASS PRODUCTS PVT. LTD.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 9999464663 Pincode : 382729 Email : sales@precisionmass.com

29	LEVEL GAUGE	TOSHNIWAL BROTHERS PVT.LTD.	WORKS:TOSHNIWAL IND.PVT.LTD, INDUSTRIAL ESTATE MAKHUPURA, AJMER Phone- 441171 Pincode : 305002 Email : toshniwalprocess@gmail.com
30	LEVEL GAUGE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in
31	LEVEL GAUGE	BLISS ANAND PVT. LTD.	Mr. Vikas Anand/ Mr.RGRajan 92B & 93 B , IMT MANESAR Gurgaon Phone- 0124-4366000 TO 9 Pincode : 122001 Email : sales@blissanand.com
32	TEMP. ELEMENT	DETRIVE INSTRUMENTATION & ELECTRONICS LTD.	320, TV INDUSTIAL ESTATE, OFF.DR.A.BESANT ROAD, BEHIND GLAXO, WORLI, MUMBAI Phone- 24934125,24938403 Pincode : 400025 Email : trivtech@vsnl.com
33	TEMP. ELEMENT	Nesstech Instruments Private Limited	26/2, G Type, Global Industrial Park Near Nahuli Railway Crossing, Valvada Vapi Phone- 9920576002 Pincode : 396105 Email : sales@nesstech.co.in
34	TEMP. ELEMENT	Thermal Instrument India Pvt. Ltd.	Mr. Raghavendra M. Kulkarni 194/195, Gopi Tank Road Behind Citylight Cinema, Mahim Mumbai Phone- 09322664709 Pincode : 400016 Email : ramk@giconindia.com
35	TEMP. ELEMENT	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
36	TEMP. ELEMENT	GOA INSTRUMENTS INDUSTRIES PVT.LTD.,	D2/5, Mapusa Industrial Estate, Mapusa, Goa, Phone- 09326054551, Pincode : 403507, Email : sumukh@goainstruments.com,
37	TEMP. ELEMENT	PYRO ELECTRIC INSTRUMENTS GOA PVT.LTD.	M. D. BICHU/R. M. BICHU G.B, HILL CROWN APARTMENTS, COLLEGE ROAD, MAPUSA Phone- 9326114601 Pincode : 403507 Email : priyanka.marketing@pyro-electric.in
38	TEMP. ELEMENT	GAUGE BOURDON INDIA PVT. LTD.	194/195, Gopi Tank Road, Off Pandurang Naik Marg, Mahim Mumbai, Phone- 011-41607463, Pincode : 400016, Email : gicdelhi@general-gauges.com,
39	TEMP. ELEMENT	TOSHNIWAL INDUSTRIES PVT. LTD.,	Industrial Estate, Makhupura, Ajmer, Phone- 9352009000, Pincode : 305002, Email : info@tipl.com,
40	TEMP. ELEMENT	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
41	TEMP. ELEMENT	Tempens Instrument (I) Pvt Ltd	MR. V.P.RATHI/MR. HEMANT RATHI B-188A ROAD NO.5 , M.I.A UDAIPUR Phone- 09352420069 Pincode : 313003 Email : info@tempens.com
42	TRANSMITTERS	YOKOGAWA INDIA LIMITED,	PLOT NO.96, ELECTRONICS CITY COMPLEX, HOSUR ROAD, BANGALORE, Phone- 080-41586000, Pincode : Email : uday.shankar@in.yokogawa.com,
43	TRANSMITTERS	ABB INDIA LIMITED	MR. RAJIV GOVIL 14, MATHURA ROAD, FARIDABAD Phone- 09971085678 Pincode : 121003 Email : vipin.swami@in.abb.com

44	TRANSMITTERS	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com
45	TRANSMITTERS	Pune Techtrol Pvt. Ltd.	N.P.Khatan/Sudhakar Badiger S-18, MIDC Bhosari, Pune Phone- 9850560042 Pincode : 411 026 Email : ho@punetechtrol.com
46	TRANSMITTERS	TOSHNIWAL INDUSTRIES PVT. LTD.,	Industrial Estate, Makhupura, Ajmer, Phone- 9352009000, Pincode : 305002, Email : info@tipl.com,
47	TRANSMITTERS	SBEM PVT. LTD.	MR.N.K. BEDARKAR/MR. VISHWANATH KARANDIK 39, ELECTRONIC CO.OP. ESTATE, PUNE SATARA ROAD PUNE, Phone- 912041030100 Pincode : 411009 Email : newdelhi@sbem.co.in
48	TRANSMITTERS	Endress + Hauser (India) Pvt. Ltd.,	Mr. Prakash Vaghela 215-216, DLF Tower 'A', Jasola District Centre, New Delhi, Phone- 9717593001, Pincode : 110025, Email : prakash.vaghela@in.endress.com,
49	TRANSMITTERS	Moore Industries International Inc.	Leonard.W. Moore/ Matt Moren 16650 Schoenborn St. North Hills Phone- +1 818 830 5548 Pincode : 91343 Email : mmoren@miinet.com
50	TRANSMITTERS	PANAM ENGINEERS	Mr. Santosh Shukla 203, Jaisingh Business,Parsiwada, Sahar road,Andheri(East), Mumbai, Phone- 9892179529, Pincode : 400099, Email : santosh@panamengineers.com,
51	TRANSMITTERS	SMART INSTRUMENTS LTD, BRAZIL	Agents: Digital Electronic Ltd. 74/11 'C' Cross Road MIDC Andheri (East) MUMBAI Phone- 28208477 Pincode : 400093 Email : corp@delbby.rpgms.ems.vsnl.net.in
52	TRANSMITTERS	SIEMENS LIMITED	Dr. Armin Bruck/Sandeep Mathur 130, Pandurang Budhkar Marg Worli Mumbai Phone- 0124 383 7377 Pincode : 400018 Email : ankit.varshney@siemens.com
53	TRANSMITTERS	EMERSON PROCESS MANAGEMENT (INDIA) PVT.LTD.	Mr. Amit Paithankar/Vikram Raj Singh 206- 210,BALARAMA BUILDING 2ND FLR. BANDRA EAST MUMBAI Phone- 9619121500 Pincode : 400051 Email : vikramraj.singh@emerson.com
54	TRANSMITTERS	Honeywell Automation India Limited	Mr. Ritwij Kulkarni 917, INTERNATIONAL TRADE TOWER, NEHRU PLACE, NEW DELHI Phone- 9890200584 Pincode : 110019 Email : rajesh.chaudhary@honeywell.com
55	TRANSMITTERS	NIVO CONTROLS PVT. LTD.	Mr. Praveen Toshniwal 104-115, Electronic Complex, Indore Phone- 0731-4081305 Pincode : 452010 Email : sales@nivocontrols.com
56	TEMPERATURE SWITCH	SOR INC.	LARRY DEGARMO/Avdhesh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdhesh@sherman-india.com,
57	TEMPERATURE SWITCH	TOSHNIWAL BROTHERS PVT.LTD.	WORKS:TOSHNIWAL IND.PVT.LTD, INDUSTRIAL ESTATE MAKHUPURA, AJMER Phone- 441171 Pincode : 305002 Email : toshniwalprocess@gmail.com
58	TEMPERATURE SWITCH	DRESSER INDUSTRIES INC.	Mr. Nishit Patel/Mr. Anuj Verma Plot No.2306, Phase II, GIDC Chhatral Kalol Phone- 02764-233682 Pincode : 382729 Email : Nishit.patel@ashcroftindia.com

34636/2020/PS-PEM-MAX

59	TEMPERATURE SWITCH	INDFOS (INDIA) LIMITED	MR.L.C.VENKATRANGAN/MR.B.KANNAN New No.17, II Floor, Adwave Towers, Dr.Sevalia Shivaji Salai, T.Nagar Chennai Phone- +91 44 24353407 Pincode : 600017 Email : delhi@indfos.com
60	TEMPERATURE SWITCH	SWITZER PROCESS INSTRUMENTS PVT. LTD.	Mr. V S Jayaprakash, 128, SIDCO North Phase, Ambattur Estates CHENNAI Phone- 044-26252017/2018 Pincode : 600050 Email : sales@switzerprocess.co.in
61	DIFFERENTIAL PRESSURE SWITCH	SOR INC.	LARRY DEGARMO/Avdshesh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdshesh@sherman-india.com,
62	JUNCTION BOX	K.S.INSTRUMENTS PVT.LTD.	S Raghavan No. 72, 3rd Main, 1st Stage Industrial Suburb, Yeshwanthpur Bangalore Phone- 9880385770 Pincode : 560022 Email : sales1@ksinstruments.net
63	JUNCTION BOX	SUCHITRA INDUSTRIES	NO-2,OPP-27 AECS LAYOUT 2ND STG REJAMAHALVILAS EXTN 2ND STG BANGALORE Phone- Pincode : Email : suchitra.industriesblr@gmail.com
64	JUNCTION BOX	Shrenik & Company,	Mr. Mitesh Shah/Mr. Pulin Shah 39 A/3 ,Panchratna Industrial Estate, Sarkhej-Bavla Road Ahmedabad Phone- 9825024921 Pincode : 382213 Email : sales@pustron.com, pulin@sumip.com
65	JUNCTION BOX	FLEXPRO ELECTRICALS PVT. LTD.	Mr. Dineshbhai Zaveri C-1/ 27&37, GIDC, Kabilpore, Navsari Phone- 02637-265140,265003 Pincode : 396424 Email : flexpro@flexproltd.com
66	JUNCTION BOX	AJMERA INDUSTRIAL & ENGINEERING WORKS	JIGNESH MAHENDRA AJMERA DENA BANK BLDG.,SHREE NAGESH INDL. ESTATE,STATION ROAD, MUMBAI Phone- 022 67973578 Pincode : 400 088 Email : ajmera@ajmera.net, jmajmera@yahoo.com
67	INSTRUMENTS TUBE FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com
68	INSTRUMENTS TUBE FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Moochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone- (022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com
69	INSTRUMENTS TUBE FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com
70	INSTRUMENTS TUBE FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com
71	LEVEL SWITCH-CAPACITANCE TYPE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in

34636/2020/PS-PEM-MAX

72	LEVEL SWITCH-CAPACITANCE TYPE	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com
73	LEVEL SWITCH-CAPACITANCE TYPE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
74	LEVEL SWITCH-CAPACITANCE TYPE	LEVCON INSTRUMENTS PVT. LTD.	Mr Shayak Gupta/Badal Jana Rajkamal', 7th floor, 13, Camac Street KOLKATA Phone- 0 33 2283 2766 Pincode : 700017 Email : b_jana@levcongroup.com
75	LEVEL SWITCH-CAPACITANCE TYPE	Flow Star Engineering Pvt. Ltd.,	MR. KHALID AKHTAR/MR. TAPAN KUMAR JANA Plot No- 7 F/2, Northern India Industrial 20/3, Mathura Road FARIDABAD Phone- 9818176380 Pincode : 121005 Email : khalid@flowstar.co.in
76	LEVEL SWITCH-CAPACITANCE TYPE	Pune Techtrol Pvt. Ltd.	N.P.Khatan/Sudhakar Badiger S-18, MIDC Bhosari, Pune Phone- 9850560042 Pincode : 411 026 Email : ho@punetechtrol.com
77	LEVEL SWITCH-CAPACITANCE TYPE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
78	LEVEL SWITCH-CONDUTIVITY TYPE	Sapcon Instrument Pvt Ltd.	131, PALSHIKAR COLONY Contact Person- Mr. Ashwin (9826080207) INDORE Phone- +91-731- 4085751, Pincode : 452004 Email : sales@sapconinstruments.com
79	LEVEL SWITCH-CONDUTIVITY TYPE	LEVCON INSTRUMENTS PVT. LTD.	Mr Shayak Gupta/Badal Jana Rajkamal', 7th floor, 13, Camac Street KOLKATA Phone- 0 33 2283 2766 Pincode : 700017 Email : b_jana@levcongroup.com
80	LEVEL SWITCH-CONDUTIVITY TYPE	BLISS ANAND PVT. LTD.	Mr. Vikas Anand/ Mr.RGRajan 92B & 93 B , IMT MANESAR Gurgaon Phone- 0124-4366000 TO 9 Pincode : 122001 Email : sales@blissanand.com
81	LEVEL SWITCH-CONDUTIVITY TYPE	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com
82	LEVEL SWITCH-CONDUTIVITY TYPE	HI-TECH SYSTEMS & SERVICES LTD.	Mr. Vikash Agrawal/Mr. Tarun Debnath 119, PARK STREET , KOLKATA Phone- 033-22290045 Pincode : 700016 Email : sandeep@hitech.in
83	LEVEL SWITCH-CONDUTIVITY TYPE	RAMAN INSTRUMENTS PVT.LTD.	Mr. N R Shenoy/Mr G B Vijn 8, First Floor.Plot : 160A Bait-Ush-Sharaf, 29th Road,Bandra(W) MUMBAI Phone- 09892331381 Pincode : 400050 Email : ramanbpl@vsnl.com
84	LEVEL SWITCH-CONDUTIVITY TYPE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in
85	LEVEL SWITCH-CONDUTIVITY TYPE	SOR INC.	LARRY DEGARMO/Avdhesh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdhesh@sherman-india.com,

34636/2020/PS-PEM-MAX

86	LEVEL SWITCH-FLOAT TYPE	Pune Techtrol Pvt. Ltd.	N.P.Khatan/Sudhakar Badiger S-18, MIDC Bhosari, Pune Phone- 9850560042 Pincode : 411 026 Email : ho@punetechtrol.com
87	LEVEL SWITCH-FLOAT TYPE	D.K. INSTRUMENTS PVT.LTD.	N.SIKDAR/ SUMIT SIKDAR 76/2,SELIMPUR RD DHAKURIA Kolkata Phone- 033-2415-1310. Pincode : 700031 Email : dkinst@vsnl.net
88	LEVEL SWITCH-FLOAT TYPE	V. AUTOMAT & INSTRUMENTS (P) LTD.	Mr. R. K. BASSI/Mr. PRAVEEN KUMAR F-61, OKHLA INDL.AREA, PH-1 NEW DELHI Phone- 9810005826 Pincode : 110 020 Email : sales@vautomat.com
89	LEVEL SWITCH-FLOAT TYPE	SCIENTIFIC DEVICES (BOMBAY) PVT LTD,	Office no. 53, Shree Manoshi Complex, Plot No. 5 & 6, Sec-3, Ghansoli (East), Navi Mumbai, Phone- 9892230623, Pincode : 400 701, Email : sdbpl@vsnl.com
90	LEVEL SWITCH-FLOAT TYPE	LEVCON INSTRUMENTS PVT. LTD.	Mr Shayak Gupta/Badal Jana Rajkamal', 7th floor, 13, Camac Street KOLKATA Phone- 0 33 2283 2766 Pincode : 700017 Email : b_jana@levcongroup.com
91	LEVEL SWITCH-FLOAT TYPE	GENERAL INSTRUMENTS CONSORTIUM	Mr. Amarendra Kulkarni 194/195, Gopi Tank Road, Off. Pandurang Naik Marg, Mahim Mumbai Phone- 9323195251 Pincode : 400016 Email : amarendra@general-gauges.com
92	LEVEL SWITCH-FLOAT TYPE	SBEM PVT. LTD.	MR.N.K. BEDARKAR/MR. VISHWANATH KARANDIK 39, ELECTRONIC CO.OP. ESTATE, PUNE SATARA ROAD PUNE, Phone- 912041030100 Pincode : 411009 Email : newdelhi@sbem.co.in
93	LEVEL SWITCH-FLOAT TYPE	Baumer Technologies India Pvt. Ltd.	Mr. Shyam Warilani/Mr. V Suresh Babu 36, DAMJI SHAMJI INDUSTRIAL COMPLEX, OFF.-MAHAKALI CAVES ROAD, ANDHERI(E) MUMBAI Phone- +91 99589 25151 Pincode : 400093 Email : sales.in@baumer.com
94	LEVEL SWITCH-FLOAT TYPE	SIGMA INSTRUMENTS CO.	Gopal Kannan/R Gopinath 201, ANANDRAJ INDUSTRIAL ESTATE, OFF.LBS MARG, SONAPUR LANE, BHANDUP (W) MUMBAI Phone- +919821038162 Pincode : 400078 Email : sales@sigmainstruments.co.in
95	LEVEL SWITCH-FLOAT TYPE	SOR INC.	LARRY DEGARMO/Avdhesh Chandra, 14685 W. 105TH STREET LENEXA Phone- 09810905139, Pincode : 66215 Email : Ldegarmo@sorinc.com, avdhesh@sherman-india.com,
96	INSTRUMENTS PIPE FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com
97	INSTRUMENTS PIPE FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Moochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone- (022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com
98	INSTRUMENTS PIPE FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com
99	INSTRUMENTS PIPE FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com

34636/2020/PS-PEM-MAX

100	INSTRUMENT FITTINGS	Perfect Instrumentation Control (India) Pvt. Ltd.	MD Hussain Shaikh/Shahanawaz Khan Gala No. 168, Loheki Chwal,216/ 218, Maulana Azad Rd. Nagpada Junction Mumbai Phone- 91-9324383121 Pincode : 400008 Email : shahanawaz.khan@perfectinstrumentation.com
101	INSTRUMENT FITTINGS	Arya Crafts & Engineering Pvt. Ltd.	Mr.Sanjay Brahman/Mr.Shyam Vazirani 102, Vora Industrial Estate No.4 Navghar, Vasai Road (E) Dist.Thane, Mumbai Phone- +91-250-2392246 Pincode : 401210 Email : arya@aryaengg.com
102	INSTRUMENT FITTINGS	AURA INCORPORATED	NIRAJ SHARAN/SUJIT KUMAR W-167A, GREATER KAILASH-II NEW DELHI Phone- 9810182430 Pincode : 110048 Email : niraj@aurainc.com
103	INSTRUMENT FITTINGS	PRECISION ENGINEERING INDUSTRIES	K. SITARAM/ K. SRINIVAS 7,SIDHAPURA INDUSTRIAL ESTATE S.V. ROAD,GOREGAON(W) MUMBAI Phone- 022 42631700 Pincode : 400 062 Email : peiks@vsnl.com
104	INSTRUMENT FITTINGS	Comfit & Valve Pvt. Ltd.	Mr. Jeetu Jain/Mr. Vinay Sosa Survey No. 23/1, Part 2, Ahmedabad-Mehsana Highway Laxmipura, Nandasan Phone- 02764-267036/37 Pincode : 382705 Email : marketing@com-fit.com
105	INSTRUMENT FITTINGS	HP VALVES & FITTINGS INDIA PVT. LTD.	S. Harichandran/P.S. Pandi B-11, Mugappair Industrial Estate, CHENNAI Phone- 044 26252537 Pincode : 600037 Email : sales@hpvalvesindia.com
106	INSTRUMENT FITTINGS	FLUIDFIT ENGINEERS PVT. LTD.	Mr. Abbas Bhola Potia Building No. 2, Office No. 3,292, Bellasis Road,Mumbai Central (East) Mumbai Phone- 9920044113 Pincode : 400008 Email : ab@fluidfitengg.com
107	INSTRUMENT FITTINGS	VIKAS INDUSTRIAL PRODUCTS	S.R.SINGH/NAVEEN SINGH B - 2, SECTOR - 6, NOIDA Phone- +91-9810122070 Pincode : 201301 Email : naveensingh@vsnl.com
108	INSTRUMENT FITTINGS	Fluid Controls Pvt. Ltd.	Sophie Y. Moochhala/Mayur Rajput J.V.PATEL, I.T.I CMPD, B.MADHUKAR MARG, ELPHINSTONE ROADSTN.(WR), MUMBAI Phone- (022) 43338000 Pincode : 400013 Email : sales@fluidcontrols.com
109	INSTRUMENT FITTINGS	PANAM ENGINEERS	Mr. Santosh Shukla 203, Jaisingh Business,Parsiwada, Sahar road,Andheri(East), Mumbai, Phone- 9892179529, Pincode : 400099, Email : santosh@panamengineers.com,

Notes:-

- 1.)The above Sub-Vendor list is tentative & reference only. However Sub-Vendor List is subject to BHEL/End user approval without any commercial /delivery implication.
- 2.)New Sub-Vendor if proposed by Vendor during contract stage shall subject to BHEL/end user approval without commercial/delivery implication.