

**NTPC LIMITED**

**4x250 MW BRBCL NABINAGAR TPP  
(FGD SYSTEM PACKAGE)**



**TECHNICAL SPECIFICATION**

**FOR**

**HVAC SYSTEM**

**SPECIFICATION NO.: - PE-TS-463- (571-13000-A)-A001 (REV-0)**



**BHARAT HEAVY ELECTRICALS LIMITED  
POWER SECTOR  
PROJECT ENGINEERING MANAGEMENT  
POWER ENGINEERING INSTITUTE BUILDING  
SECTOR-16A, PLOT NO.-25, NOIDA, INDIA**

	<b>TITLE:</b> 4x250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) <b>TECHNICAL SPECIFICATION FOR HVAC SYSTEM</b>	<b>SPECIFICATION No: PE-TS-463-(571-13000-A)-A001</b>	
		<b>SECTION</b>	
		<b>REV. 00</b>	
		<b>SHEET : 1 OF 2</b>	

### CONTENTS

This Technical specification consists of two sections:

#### SECTION - I

SUB- SECTIONS	TITLE	Page No
<b>Sub-Section-A</b>	INTENT OF SPECIFICATION	5
<b>Sub-Section-B</b>	PROJECT INFORMATION WITH WIND AND SEISMIC DESIGN CRITERIA	8
<b>Sub-Section-C</b>	TECHNICAL SPECIFICATIONS	25
<b>Sub Section-C1</b>	SPECIFIC TECHNICAL REQUIREMENT	24
<b>Sub Section-C2</b>	CUSTOMER SPECIFICATION	57
	<b>C2 - A</b> TECHNICAL REQUIREMENT	58
	<b>C2 - B</b> PROJECT SPECIFIC GENERAL REQUIREMENTS INCLUDING:	96
	GENERAL TECHNICAL REQUIREMENT	97
	PERFROMANCE GUARANTEE TESTS	184
	QUALITY ASSURANCE	188
	<b>C2 - C</b> PAINTING SPECIFICATIONS (REFER SECTION C2-A)	192
<b>Sub Section-C3</b>	TECHNICAL SPECIFICATION (ELECTRICAL PORTION)	193
<b>Sub Section-C4</b>	TECHNICAL SPECIFICATION (C&I PORTION)	246
<b>Sub Section-D</b>	STANDARD TECHNICAL SPECIFICATIONS	397
<b>Sub Section-E</b>	ANNEXURE-I LIST OF MAKES OF SUB-VENDOR ITEMS	456
	ANNEXURE-II MANDATORY SPARE LIST	471
	ANNEXURE-III PAINTING & COLOUR SCHEME	477
	ANNEXURE-IV LIST OF TOOLS & TACKLES	479
	ANNEXURE-VI DRAWINGS / DOCUMENTS SUBMISSION PROCEDURE	480
	ANNEXURE-VII MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION	481
	ANNEXURE-VIII FORMAT FOR OPERATION AND MAINTENANCE MANUAL	486
	ANNEXURE-IX SITE STORAGE AND PRESERVATION	490
	ANNEXURE-X PACKING PROCEDURE (REFER SECTION C2-B)	-



**TITLE:**  
**4x250 MW BRBCL NABINAGAR TPP (FGD  
 SYSTEM PACKAGE)**  
**TECHNICAL SPECIFICATION FOR  
 HVAC SYSTEM**

**SPECIFICATION No: PE-TS-463-(571-13000-  
 A)-A001**

**SECTION**

**REV. 00**

**SHEET : 2 OF 2**

**SECTION - II**

<b>SUB SECTIONS</b>	<b>TITLE</b>	<b>Page No</b>
<b>Sub Section-1</b>	INSPECION AND TESTING WITH STANDARD QUALITY PLAN	507
<b>Sub Section-2</b>	LIST OF DOCUMENTS TO BE SUBMITTED WITH BID	511
<b>Sub Section-3</b>	COMPLIANCE CUM CONFIRMATION CERTIFICATE	512
<b>Sub Section-4</b>	PRE BID CLARIFICATION SCHEDULE	514
<b>Sub Section-5</b>	DEVIATION SHEET (COST OF WITHDRAWL)	515
<b>Sub Section-6</b>	GUARANTEED POWER CONSUMPTION	517
<b>Sub Section-7</b>	<b>DRAWINGS</b>	518
	<b>DRG TITLE</b>	
a	P&ID FOR AIR COOLED CONDENSING UNIT FOR FGD	519
b	P&ID FOR UAF FOR FGD	520
c	SCHEME FOR HVAC MAKE UP WATER	521
d	ELECTRICAL LAYOUT FOR FGD CONTROL ROOM BUILDING	522
e	GA OF GYPSUM DEWATERING BUILDING	523



**4X250 MW BRBCL NABINAGAR TPP (FGD  
SYSTEM PACKAGE)**

**TECHNICAL SPECIFICATIONS FOR  
HVAC SYSTEM**

**SPECIFICATION No: PE-TS-463-(571-13000-  
A)-A001**

**SECTION: I**

**REV. 00**

## **SECTION - I**



**4X250 MW BRBCL NABINAGAR TPP  
(FGD SYSTEM PACKAGE)  
INTENT OF SPECIFICATION**

**SPECIFICATION No: PE-TS-463-(571-13000-A)-A001**


**SECTION : I**

**Sub Section: A**

**REV. 00**


**SHEET 1 OF 3**

**SECTION-I  
SUB-SECTION-A  
INTENT OF SPECIFICATION**

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) INTENT OF SPECIFICATION</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		Sub Section: A	
		REV. 00	
		SHEET 1 OF 3	


## 1.0 INTENT OF SPECIFICATION

- 1.1 The specification covers design, engineering, manufacture, supply / procurement, inspection and testing at vendor's / sub vendor's / manufacturer's works, painting, forwarding, proper packing and shipment and delivery at site, unloading, handling & transportation, storage, preservation, security / safety at site, Erection & Commissioning, minor civil & structural (as applicable) works as required on FOR site basis, Performance and guarantee testing / demonstration testing and handing over to BHEL's customer of **HVAC SYSTEM** as per details in different sections / volumes of this specification and various pre-award agreements for **4x250 MW NABINAGAR TPP (FGD SYSTEM PACKAGE)**.
- 1.2 The contractor shall be responsible for providing all material, equipment & services, which are required to fulfil the intent of ensuring operability, maintainability, reliability and complete safety of the complete work covered under this specification, irrespective of whether it has been specifically listed herein or not. Omission of specific reference to any component / accessory necessary for proper performance of the equipment shall not relieve the contractor of the responsibility of providing such facilities to complete the supply, erection and commissioning, performance and guarantee/demonstration testing of **HVAC SYSTEM**.
- 1.3 It is not the intent to specify herein all the details of design and manufacture. However, the equipment shall conform in all respects to highest standards of design, engineering and workmanship and shall be capable of performing the required duties in a manner acceptable to purchaser who will interpret the meaning of drawings and specifications and shall be entitled to reject any work or material which in his judgement is not in full accordance herewith.
- 1.4 The extent of supply under the contract includes all items shown in the drawings, notwithstanding the fact that such items may have been omitted from the specification or schedules. Similarly, the extent of supply also includes all items mentioned in the specification and /or schedules, notwithstanding the fact that such items may have been omitted in the drawing. Similarly, the extent of supply also includes all items required for completion of the system and not withstanding that they may have been omitted in drawings / specifications or schedules.
- 1.5 The general term and conditions, instructions to tenderers and other attachment referred to elsewhere are made part of the tender specification. The equipment materials and works covered by this specification is subject to compliance to all attachments referred to in the specification. The bidder shall be responsible for and governed by all requirements stipulated herein.
- 1.6 While all efforts have been made to make the specification requirement complete & unambiguous, it shall be bidders' responsibility to ask for missing information, ensure completeness of specification, to bring out any contradictory / conflicting requirement in different sections of the specification and within a section itself to the notice of BHEL and to seek any clarification on specification requirement in the format enclosed under

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) INTENT OF SPECIFICATION</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		Sub Section: A	
		REV. 00	
		SHEET 1 OF 3	

Vol-III of the specification **within 10 days of receipt of tender documents.** In absence of any such clarifications, in case of any contradictory requirement, the more stringent requirement as per interpretation of Purchaser / Customer shall prevail and shall be complied by the bidder without any commercial implication on account of the same. Further in case of any missing information in the specification not brought out by the prospective bidders as part of pre-bid clarification, the same shall be furnished by Purchaser/ Customer as and when brought to their notice either by the bidder or by purchaser/ customer themselves. However, such requirements shall be binding on the successful bidder without any commercial & delivery implication.

- 1.7 The bidder's offer shall not carry any sections like clarification, interpretations and /or assumptions.
- 1.8 Deviations, if any, should be very clearly brought out clause by clause along with cost of withdrawal in the format attached with GCC (Annexure-II Deviation sheet (Cost of withdraw), otherwise, it will be presumed that the vendor's offer is strictly in line with NIT specification.
- 1.9 In the event of any conflict between the requirements of two clauses of this specification documents or requirements of different codes and standards specified, "Section - C shall prevail over section – D", "section C1A (BHEL section C & C1B (Customer spec), later shall supersede, however more stringent requirement as per the interpretation of the owner shall apply.
- 1.10 In case all above requirements are not complied with, the offer may be considered as incomplete and would become liable for rejection.
- 1.11 For definition of word like Contractor, bidder, supplier, vendor, Customer/ Purchaser Employer, consultant, please referred relevant clause of GCC

	<p style="text-align: center;"><b>4X250 MW NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM PROJECT INFORMATION WITH WIND AND SEISMIC DESIGN CRITERIA</b></p>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		Sub Section : B	
		REV. 00	

**SECTION: I**

**SUB-SECTION: B**

**PROJECT INFORMATION WITH WIND AND SEISMIC DESIGN  
CRITERIA**








**SUB-SECTION-II-A11**


**PROJECT INFORMATION- NABINAGAR 4X250 MW**


<p><b>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</b></p>	<p><b>TECHNICAL SPECIFICATION SECTION-VI BID DOCUMENT NO.: CS-0011-109(1A)-2</b></p>
--	--


CLAUSE NO.	PROJECT INFORMATION			
1.00.00	<p><b>BACKGROUND</b></p> <p><b>Details of proposed Stage / Units</b></p> <p>Project name : Nabinagar TPP</p> <p>No. of Units x capacity : 4 x 250 MW</p> <p>Project setting up by : NTPC(FOR BHARTIYA RAIL BIJLEE COMPANY LTD.)</p> <p>The SG with ESP package and TG package of the subject project is being executed by M/s. BHEL.</p>			
1.01.00	<p><b>LOCATION AND APPROACH</b></p> <p>Project Location : (i) Place : Nabinagar : (ii) District : Aurangabad : (iii) State : Bihar</p> <p>Latitude and Longitude of project location : North : 24 deg. 42' 30" (N) East : 84 deg. 05' 36" (E)</p> <p>Nearest Railway station : Dehri-On-Sone</p> <p>Distance of project location from the Railway station : 30 KM (Approx.)</p> <p>Nearest MajorTown : Aurangabad</p> <p>Distance of the town from the Project site : 50 KM</p> <p>Nearest CommercialAirport : Gaya</p> <p>Distance of airport from the project site : 100 KM</p> <p>Nearest Highway : National Highway-2</p> <p>Distance from nearest highway point to the site : 25 KM</p> <p>Vicinity plan : Vicinity plan of the project enclosed at Annexure-I.</p> <p>Any other information : Further to the information given in this sub-section, Bidders are advised to visit the project site and collect data on local site conditions.</p>			
<p>LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP</p>	<p>PAGE 1 OF 29</p>	


CLAUSE NO.	PROJECT INFORMATION			
1.02.00	<p><b>LAND REQUIREMENT</b></p> <p>Total area of land acquired for the project : 1700 Acres</p> <p>Any other information : Approximately 1700 acres of land has been identified near Dhundhua village for the Plant, Township and Ash Disposal Area. In principle commitment for the availability of land for Plant, Township and Ash Disposal Area has been obtained from Revenue Department, Govt. of Bihar vide letter dated 29.3.2003. Further, Central Coalfields Ltd., (CCL) vide their letter dated 29.05.03 have indicated that Central Mine Planning &amp; Design Institute Ltd (CMPDI) have confirmed that plant location along with its other allied infrastructure are not coming on coal bearing area.</p>			
1.03.00	<p><b>WATER</b></p> <p>Nearest Water Source : The project site is located near the river Sone which is the only source of water for the project. Therefore, the make up water requirement for the project is proposed to be drawn from the pondage created by Indrapuri Barrage, which is about 3 kms from the proposed site.</p> <p>Proposed water requirement for the Stage : 60 Cusec</p> <p>Proposed source / arrangement to the meet the water requirement : The project site is located near the river Sone which is the only source of water for the project. Therefore, the make up water requirement for the project is proposed to be drawn from the pondage created by Indrapuri Barrage, which is about 3 kms. from the proposed site.</p> <p>The make up water requirement for the project operating on cooling towers is about 4300 cubic m/hr with ash water recirculation system and about 5900 cubic m/hr. with once through ash water system.</p> <p>Water Resource Department, Govt. of Bihar, accorded in-principle clearance of 60 cusecs of consumptive water from upstream of Indrapuri Barrage vide their letter dated 06.03.03.</p>			
<p>LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP</p>	<p>PAGE 2 OF 29</p>	

CLAUSE NO.	PROJECT INFORMATION		
<p>1.04.00</p> <p>1.05.00</p> <p>1.06.00</p> <p>2.00.00</p> <p>3.00.00</p> <p>4.00.00</p> <p>5.00.00</p>	<p><b>COAL and WATER, Utility details:</b></p> <p>(i) Coal Quality Parameters and Fuel Oil Characteristics Source:Pachra and Pachra south blocks in North Karanpura coalfields Requirement: 5 MTPA The Coal quality parameters and Fuel Oil Characteristics are enclosed at Table-1, &amp; Table-2A &amp; 2B of this Sub-Section.</p> <p style="text-align: center;"><b>Water data</b></p> <p>(ii) Process water: Process water quality based on COC in Table-3.</p> <p>(iii) Clarified water: Clarified water quality is indicated in Table-3.</p> <p>(iv) DM water for Equipment cooling water system. DM water quality is indicated in Table-4.</p> <p><b>Steam Generator and ESP data:</b> refer Table-5</p> <p>Drawings are enclosed as per Table-6 for initial overview to the Bidder.</p> <p>NOT USED</p> <p><b>RAILWAY SIDING</b> For bringing the equipment and material to the power house through rail, railway siding is proposed to be constructed from nearest railway station.</p> <p><b>METEOROLOGICAL DATA</b> Meteorological data of the nearest observatory Dehri station is enclosed as Annexure-II to this subsection.</p> <p><b>CRITERIA FOR EARTHQUAKE RESISTANT DESIGN OF STRUCTURES AND EQUIPMENT</b></p> <p>All structures and equipment shall be designed for seismic forces adopting the site specific seismic information provided in this document and using the other provisions in accordance with IS:1893 (Part 1 to Part 4). Pending finalization of Part 5 of IS:1893, provisions of part 1 shall be read along with the relevant clauses of IS:1893:1984, for embankments.</p> <p>A site specific seismic study has been conducted for the project site. The peak ground horizontal acceleration for the project site, the site specific acceleration spectral coefficients (in units of gravity acceleration 'g') in the horizontal direction for</p>		
<p>LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>		<p>SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP</p>


CLAUSE NO.	PROJECT INFORMATION 										
	<p>the various damping values and the multiplying factor (to be used over the spectral coefficients) for evaluating the design acceleration spectra are as given at Appendix-I.</p> <p>Vertical acceleration spectral values shall be taken as 2/3rd of the corresponding horizontal values.</p> <p>The site specific design acceleration spectra shall be used in place of the response acceleration spectra, given at figure-2 in IS:1893 (Part 1) and Annex B of IS:1893 (Part 4). The site specific acceleration spectra along with multiplying factors specified in Appendix-I includes the effect of the seismic environment of the site, the importance factor related to the structures and the response reduction factor. Hence, the design spectra do not require any further consideration of the zone factor (Z), the importance factor (I) and response reduction factor (R) as used in the IS:1893 (Part 1 to Part 4).</p> <p><b>Damping in Structures</b></p> <p>The damping factor (as a percentage of critical damping) to be adopted shall not be more than as indicated below for:</p> <table border="0" data-bbox="565 953 1380 1176"> <tr> <td style="padding-left: 40px;">Steel structures</td> <td style="text-align: right;">2%</td> </tr> <tr> <td style="padding-left: 40px;">Reinforced Concrete structures</td> <td style="text-align: right;">5%</td> </tr> <tr> <td style="padding-left: 40px;">Reinforced Concrete Stacks</td> <td style="text-align: right;">3%</td> </tr> <tr> <td style="padding-left: 40px;">Steel stacks</td> <td style="text-align: right;">2%</td> </tr> </table> <p><b>Method of Analysis</b></p> <p>Since most structures in a power plant are irregular in shape and have irregular distribution of mass and stiffness, dynamic analysis for obtaining the design seismic forces shall be carried out using the response spectrum method. The number of vibration modes used in the analysis should be such that the sum total of modal masses of all modes considered is at least 90 percent of the total seismic mass and shall also meet requirements of IS:1893 (Part 1). Modal combination of the peak response quantities shall be performed as per Complete Quadratic Combination (CQC) method or by an acceptable alternative as per IS:1893 (Part 1).</p> <p>In general, seismic analysis shall be performed for the three orthogonal (two principal horizontal and one vertical) components of earthquake motion. The seismic response from the three components shall be combined as specified in IS:1893 (Part 1).</p>			Steel structures	2%	Reinforced Concrete structures	5%	Reinforced Concrete Stacks	3%	Steel stacks	2%
Steel structures	2%										
Reinforced Concrete structures	5%										
Reinforced Concrete Stacks	3%										
Steel stacks	2%										
<p style="text-align: center;">LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE</p>	<p style="text-align: center;">TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p style="text-align: center;">SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP</p>	<p style="text-align: center;">PAGE 4 OF 29</p>								


CLAUSE NO.	PROJECT INFORMATION 		
	<p>The spectral acceleration coefficient shall get restricted to the peak spectral value if the fundamental natural period of the structure falls to the left of the peak in the spectral acceleration curve.</p> <p>For buildings, if the design base shear (<math>V_B</math>) obtained from modal combination is less than the base shear (<math>\bar{V}_B</math>) computed using the approximate fundamental period (<math>T_a</math>) given in IS:1893:Part 1 and using site specific acceleration spectra with appropriate multiplying factor, the response quantities (e.g. member forces, displacements, storey forces, storey shears and base reactions) shall be enhanced in the ratio of <math>\bar{V}_B/V_B</math>. However, no reduction is permitted if <math>\bar{V}_B</math> is less than <math>V_B</math>.</p> <p>For regular buildings less than 12m in height, design seismic base shear and its distribution to different floor levels along the height of the building may be carried out as specified under clause 7.5, 7.6 &amp; 7.7 of IS:1893 (Part 1) and using site specific design acceleration spectra. The design horizontal acceleration spectrum value (<math>A_h</math>) shall be computed for the fundamental natural period as per clause 7.6 of IS:1893 (Part 1) using site specific spectral acceleration coefficients with appropriate multiplying factor given in Appendix-I.</p> <p><b>Design/Detailing for Ductility for Structures</b></p> <p>The site specific design acceleration spectra is a reduced spectra and has an in-built allowance for ductility. Structures shall be engineered and detailed in accordance with relevant Indian/International standards to achieve ductility.</p>		
<p>LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP</p>	<p>PAGE 5 OF 29</p>


CLAUSE NO.	PROJECT INFORMATION			
	<p style="text-align: right;"><b>APPENDIX – I</b></p> <p style="text-align: center;"><b><u>SITE SPECIFIC SEISMIC PARAMETERS FOR DESIGN OF STRUCTURES AND EQUIPMENT</u></b></p> <p>The various site specific seismic parameters for the project site shall be as follows:</p> <ol style="list-style-type: none"> <li>1) Peak ground horizontal acceleration : 0.16g</li> <li>2) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') to obtain the design acceleration spectra               <ol style="list-style-type: none"> <li>a) for ordinary moment resisting steel frames designed and detailed as per IS:800 : 0.04</li> <li>b) for braced steel frames designed and detailed as per IS:800 : 0.03</li> <li>c) For special moment resisting RC frames designed and detailed as per IS:456 and IS:13920 : 0.024</li> <li>d) for RCC chimney : 0.08</li> <li>e) for Liquid retaining tanks : 0.048</li> <li>f) for Steel chimney, Absorber tower : 0.06</li> <li>g) for design of structures not covered under 2 (a) to 2 (f) above and under 3 below : 0.04</li> </ol> </li> <li>3) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') for design of equipment and structures where inelastic action is not relevant or not permitted : 0.08</li> </ol> <p>Note: g = Acceleration due to gravity</p> <p>The horizontal seismic acceleration spectral coefficients are furnished in subsequent pages.</p>			
<p style="text-align: center;">LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE</p>	<p style="text-align: center;">TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p style="text-align: center;">SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP</p>	<p style="text-align: center;">PAGE 6 OF 29</p>	


CLAUSE NO.	PROJECT INFORMATION			
	<b>APPENDIX – I</b>			
	<b>HORIZONTAL SEISMIC ACCELERATION SPECTRAL COEFFICIENTS</b>			
	<b>In units of 'g' for New Nabinagar project</b>			
	<b>Time Period</b>	<b>Damping Factor (as a percentage of critical damping)</b>		
	<b>(Sec)</b>	<b>2%</b>	<b>3%</b>	<b>5%</b>
	0.000	1.000	1.000	1.000
	0.030	1.000	1.000	1.000
	0.050	1.750	1.607	1.443
	0.100	3.737	3.060	2.374
	0.104	3.904	3.174	2.443
	0.123	3.904	3.401	2.753
	0.150	3.904	3.401	2.753
	0.200	3.904	3.401	2.753
	0.250	3.904	3.401	2.753
	0.300	3.904	3.401	2.753
	0.350	3.904	3.401	2.753
	0.400	3.904	3.401	2.753
	0.450	3.904	3.401	2.753
	0.500	3.904	3.401	2.753
	0.516	3.904	3.401	2.753
	0.550	3.662	3.401	2.753
	0.600	3.357	3.142	2.753
	0.607	3.320	3.105	2.753
	0.670	3.006	2.813	2.493
	0.700	2.877	2.693	2.386
	0.750	2.685	2.513	2.227
	0.800	2.518	2.356	2.088
	0.850	2.369	2.218	1.965
	0.900	2.238	2.094	1.856
	0.950	2.120	1.984	1.758
	1.000	2.014	1.885	1.670
	1.050	1.918	1.795	1.590
	1.100	1.831	1.714	1.518
	1.150	1.751	1.639	1.452
	1.200	1.678	1.571	1.392
	1.250	1.611	1.508	1.336
<b>LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE</b>	<b>TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</b>	<b>SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP</b>	<b>PAGE 7 OF 29</b>	




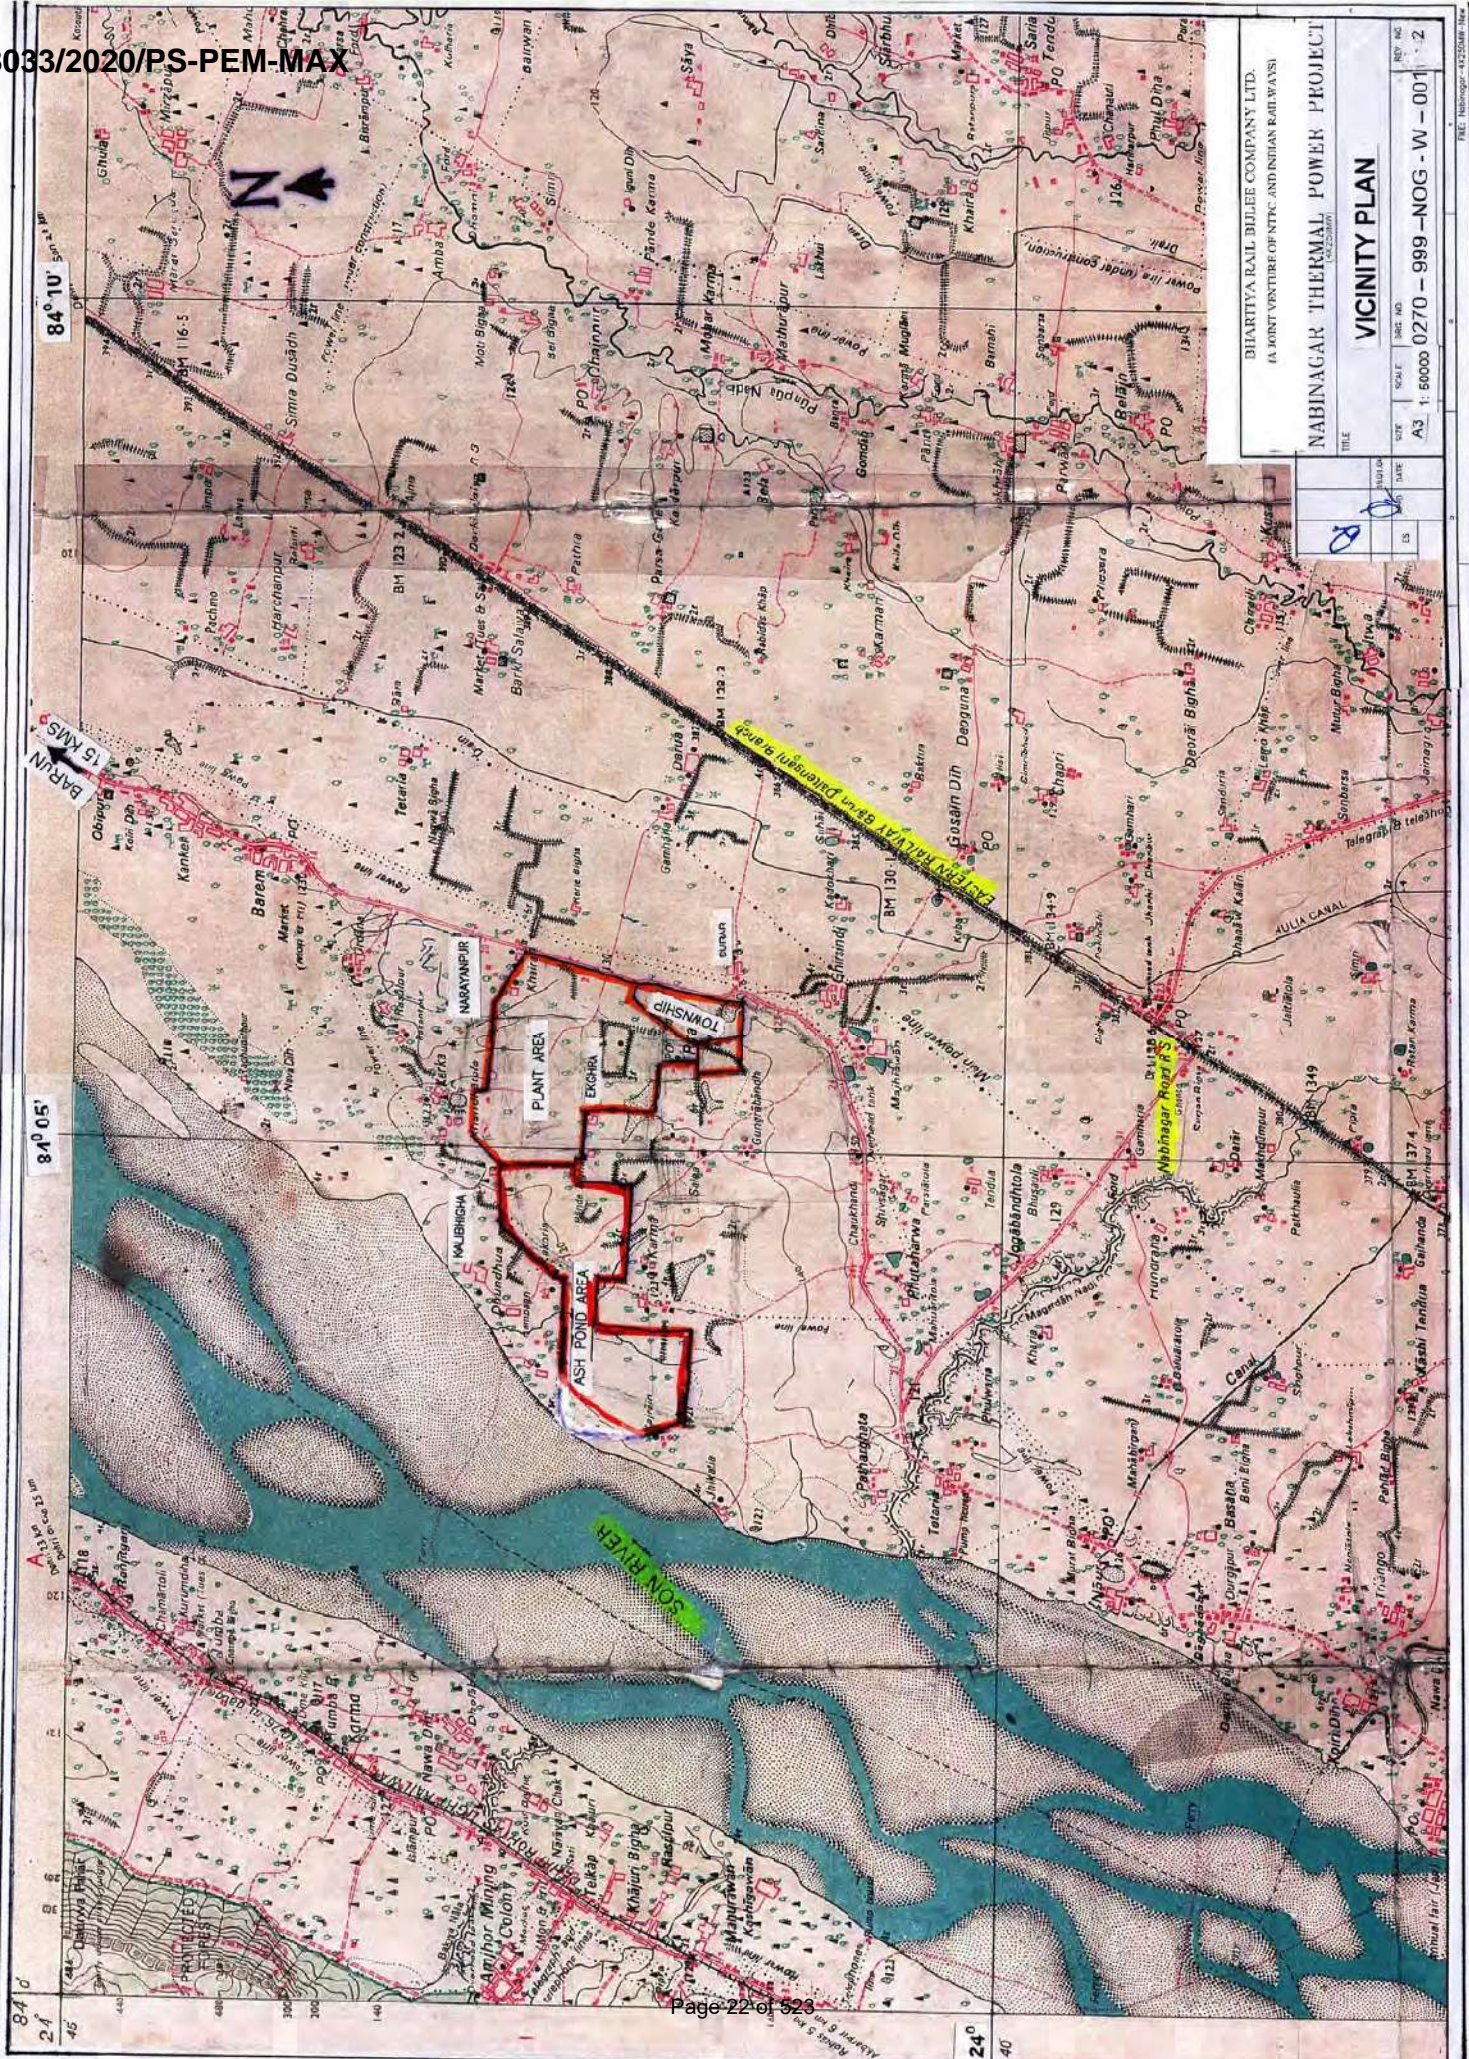
CLAUSE NO.	PROJECT INFORMATION			
	<b>APPENDIX – I</b>			
	<b>HORIZONTAL SEISMIC ACCELERATION SPECTRAL COEFFICIENTS</b>			
	<b>In units of 'g' for New Nabinagar project</b>			
	<b>Time Period</b>	<b>Damping Factor (as a percentage of critical damping)</b>		
	<b>(Sec)</b>	<b>2%</b>	<b>3%</b>	<b>5%</b>
	1.300	1.549	1.450	1.285
	1.350	1.492	1.396	1.237
	1.400	1.439	1.346	1.193
	1.450	1.389	1.300	1.152
	1.500	1.343	1.257	1.113
	1.550	1.299	1.216	1.077
	1.600	1.259	1.178	1.044
	1.650	1.221	1.142	1.012
	1.700	1.185	1.109	0.982
	1.750	1.151	1.077	0.954
	1.800	1.119	1.047	0.928
	1.850	1.089	1.019	0.903
	1.900	1.060	0.992	0.879
	1.950	1.033	0.967	0.856
	2.000	1.007	0.943	0.835
	2.050	0.982	0.920	0.815
	2.100	0.959	0.898	0.795
	2.150	0.937	0.877	0.777
	2.200	0.915	0.857	0.759
	2.250	0.895	0.838	0.742
	2.300	0.876	0.820	0.726
	2.350	0.857	0.802	0.711
	2.400	0.839	0.785	0.696
	2.450	0.822	0.769	0.682
	2.500	0.806	0.754	0.668
	2.550	0.790	0.739	0.655
	2.600	0.775	0.725	0.642
	2.650	0.760	0.711	0.630
	2.700	0.746	0.698	0.619
	2.750	0.732	0.685	0.607
	2.800	0.719	0.673	0.596
<b>LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE</b>	<b>TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</b>	<b>SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP</b>	<b>PAGE 8 OF 29</b>	

CLAUSE NO.	PROJECT INFORMATION			
	<b>APPENDIX – I</b>			
	<b>HORIZONTAL SEISMIC ACCELERATION SPECTRAL COEFFICIENTS</b>			
	<b>In units of 'g' for New Nabinagar project</b>			
	<b>Time Period</b>	<b>Damping Factor (as a percentage of critical damping)</b>		
	<b>(Sec)</b>	<b>2%</b>	<b>3%</b>	<b>5%</b>
	2.850	0.707	0.661	0.586
	2.900	0.694	0.650	0.576
	2.950	0.683	0.639	0.566
	3.000	0.671	0.628	0.557
	3.050	0.660	0.618	0.548
	3.100	0.650	0.608	0.539
	3.150	0.639	0.598	0.530
	3.200	0.629	0.589	0.522
	3.250	0.620	0.580	0.514
	3.300	0.610	0.571	0.506
	3.350	0.601	0.563	0.499
	3.400	0.592	0.554	0.491
	3.450	0.584	0.546	0.484
	3.500	0.575	0.539	0.477
	3.550	0.567	0.531	0.470
	3.600	0.559	0.524	0.464
	3.650	0.552	0.516	0.458
	3.700	0.544	0.509	0.451
	3.750	0.537	0.503	0.445
	3.800	0.530	0.496	0.439
	3.825	0.527	0.493	0.437
	3.850	0.523	0.490	0.434
	3.900	0.516	0.483	0.428
	3.950	0.510	0.477	0.423
	4.000	0.504	0.471	0.418
<b>LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE</b>	<b>TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</b>	<b>SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP</b>	<b>PAGE 9 OF 29</b>	

CLAUSE NO.	PROJECT INFORMATION 										
6.00.00	<p><b><u>CRITERIA FOR WIND RESISTANT DESIGN OF STRUCTURES AND EQUIPMENT</u></b></p> <p>All structures shall be designed for wind forces in accordance with IS:875 (Part-3) and as specified in this document. See Annexure – B for site specific information.</p> <p>Along wind forces shall generally be computed by the Peak (i.e. 3 second gust) Wind Speed method as defined in the standard.</p> <p>Along wind forces on slender and wind sensitive structures and structural elements shall also be computed, for dynamic effects, using the Gust Factor or Gust Effectiveness Factor Method as defined in the standard. The structures shall be designed for the higher of the forces obtained from Gust Factor method and the Peak Wind Speed method.</p> <p>Analysis for dynamic effects of wind must be undertaken for any structure which has a height to minimum lateral dimension ratio greater than “5” and/or if the fundamental frequency of the structure is less than 1 Hz.</p> <p>Susceptibility of structures to across-wind forces, galloping, flutter, ovaling etc. should be examined and designed/detailed accordingly following the recommendations of IS:875(Part-3) and other relevant Indian standards.</p> <p>It should be estimated if size and relative position of other structures are likely to enhance the wind loading on the structure under consideration. Enhancement factor, if necessary, shall suitably be estimated and applied to the wind loading to account for the interference effects.</p> <p><b>Damping in Structures</b></p> <p>The damping factor (as a percentage of critical damping) to be adopted shall not be more than as indicated below for:</p> <table data-bbox="423 1381 1463 1690"> <tr> <td>a) Welded steel structures</td> <td>: 1.0%</td> </tr> <tr> <td>b) Bolted steel structures</td> <td>: 2.0%</td> </tr> <tr> <td>c) Reinforced concrete structures</td> <td>: 1.6%</td> </tr> <tr> <td>d) Steel stacks</td> <td>: As per IS:6533 &amp; CICIND Model Code whichever is more critical.</td> </tr> </table>			a) Welded steel structures	: 1.0%	b) Bolted steel structures	: 2.0%	c) Reinforced concrete structures	: 1.6%	d) Steel stacks	: As per IS:6533 & CICIND Model Code whichever is more critical.
a) Welded steel structures	: 1.0%										
b) Bolted steel structures	: 2.0%										
c) Reinforced concrete structures	: 1.6%										
d) Steel stacks	: As per IS:6533 & CICIND Model Code whichever is more critical.										
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 10 OF 29								

CLAUSE NO.	PROJECT INFORMATION			
	<p style="text-align: right;"><b><u>ANNEXURE-B</u></b></p> <p><b><u>SITE SPECIFIC DESIGN PARAMETERS</u></b></p> <p>The various design parameters, as defined in IS: 875 (Part-3), to be adopted for the project site shall be as follows:</p> <p>a) The basic wind speed “V<sub>b</sub>” at ten metres above the mean ground level : 47 metres/second</p> <p>b) The risk coefficient “K<sub>1</sub>” : 1.07</p> <p>c) Category of terrain : Category-2</p> <p><b>7.00.0 FOUNDATION SYSTEM AND GEOTECHNICAL DATA</b></p> <p>7.00.01 Geotechnical data and foundation system for the respective project are enclosed at annexure-III. The corresponding bore logs are enclosed at annexure-IV.</p> <p>7.00.02 The available soil data is of vicinity of proposed structures, therefore, bidder shall carryout his own detailed soil investigation for facilities under this package and shall be as per the scheme approved by owner. The scheme for geotechnical investigation shall be as given at Clause 7.07.00 and shall be approved by owner before execution. Geotechnical investigation work shall got executed by the Contractor through the agencies as mentioned in Clause No. 7.07.03. However, no time extension shall be given on account of soil investigation carried out by the Bidder. The geotechnical investigation report shall be prepared with detailed recommendations regarding type of foundation and allowable bearing pressure for various structures/ facilities and other soil parameters. The report shall be submitted for Owner's approval prior to commencement of design of foundation.</p> <p>7.00.03 The Bidder should note that nothing extra whatsoever on account of variation between soil data collected by Owner and that found by the Bidder during geotechnical investigation by him or during execution of works, shall be payable.</p> <p>7.00.04 Tank Foundations</p> <p>a) The tanks shall rest on flexible tank pad foundation, resting on sand with concrete ring wall to retain sand. Base of the concrete ring wall shall not rest on the expansive soil, if any.</p> <p>b) Entire loose/ soft soil inside the concrete ring wall shall be removed and shall be filled with sand. Sand for filling shall be clean and well graded conforming to IS 383 with grading Zone I to III.</p> <p>c) Sand shall be spread in layers not exceeding 30cm compacted thickness over the area. Each layer shall be uniformly compacted by mechanical means like plate vibrators, small vibratory rollers, etc to achieve a relative density of not less than 80%.</p> <p>d) Other requirements of tank foundations shall be as per IS 803 and as specified elsewhere in the specifications.</p>			
<p style="text-align: center;">LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE</p>	<p style="text-align: center;">TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p style="text-align: center;">SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP</p>	<p style="text-align: center;">PAGE 11 OF 29</p>	

CLAUSE NO.	PROJECT INFORMATION																																																																													
	<p><b>Table-3</b></p> <p><b><u>DESIGN CLARIFIED WATER ANALYSIS</u></b></p> <table border="1" data-bbox="427 331 1438 1016"> <thead> <tr> <th>S.No</th> <th>Constituent</th> <th>As</th> <th>mg/l (except pH &amp; turbidity)</th> </tr> </thead> <tbody> <tr><td>1.</td><td>Calcium</td><td>CaCO<sub>3</sub></td><td>131</td></tr> <tr><td>2.</td><td>Magnesium</td><td>CaCO<sub>3</sub></td><td>52</td></tr> <tr><td>3.</td><td>Sodium + Potassium</td><td>CaCO<sub>3</sub></td><td>65</td></tr> <tr><td>4.</td><td>Total Cations</td><td>CaCO<sub>3</sub></td><td>248</td></tr> <tr><td>5.</td><td>Chloride</td><td>CaCO<sub>3</sub></td><td>20</td></tr> <tr><td>6.</td><td>Sulphate</td><td>CaCO<sub>3</sub></td><td>93</td></tr> <tr><td>7.</td><td>Nitrate</td><td>CaCO<sub>3</sub></td><td>10</td></tr> <tr><td>8.</td><td>Alkalinity</td><td>CaCO<sub>3</sub></td><td>125</td></tr> <tr><td>9.</td><td>Total Anions</td><td>CaCO<sub>3</sub></td><td>248</td></tr> <tr><td>10.</td><td>Iron(total)</td><td>Fe</td><td>0.3</td></tr> <tr><td>11.</td><td>Total Silica</td><td>SiO<sub>2</sub></td><td>22</td></tr> <tr><td>12.</td><td>pH value</td><td>---</td><td>7.0-8.2</td></tr> <tr><td>13.</td><td>Turbidity</td><td>NTU</td><td>10</td></tr> </tbody> </table> <p data-bbox="427 1052 1458 1224">Note: Clarified water is used for CW system as make up &amp; the CW system is expected to operate at about 5.0 – 5.5 Cycles of Concentration (COC) with suitable chemical treatment program using acid, scale &amp; corrosion inhibitor dosing. As CW blow down water is tapped from CW system, the water quality of CW blow down shall accordingly be arrived by the bidder.</p> <p style="text-align: right;"><b>Table-4</b></p> <p style="text-align: center;"><b>ANALYSIS OF DM WATER FOR MAIN PLANT CONDENSER</b></p> <table border="1" data-bbox="427 1381 1425 1755"> <thead> <tr> <th>Sl.No.</th> <th>Characteristics</th> <th>Value</th> </tr> </thead> <tbody> <tr><td>1.</td><td>Silica (Max.)</td><td>0.02 ppm as SiO<sub>2</sub></td></tr> <tr><td>2.</td><td>Iron as Fe</td><td>Nil</td></tr> <tr><td>3.</td><td>Total hardness</td><td>Nil</td></tr> <tr><td>4.</td><td>pH value</td><td>6.8 to 7.2</td></tr> <tr><td>5.</td><td>Conductivity</td><td>Not more than 0.1 µs/cm</td></tr> </tbody> </table>			S.No	Constituent	As	mg/l (except pH & turbidity)	1.	Calcium	CaCO <sub>3</sub>	131	2.	Magnesium	CaCO <sub>3</sub>	52	3.	Sodium + Potassium	CaCO <sub>3</sub>	65	4.	Total Cations	CaCO <sub>3</sub>	248	5.	Chloride	CaCO <sub>3</sub>	20	6.	Sulphate	CaCO <sub>3</sub>	93	7.	Nitrate	CaCO <sub>3</sub>	10	8.	Alkalinity	CaCO <sub>3</sub>	125	9.	Total Anions	CaCO <sub>3</sub>	248	10.	Iron(total)	Fe	0.3	11.	Total Silica	SiO <sub>2</sub>	22	12.	pH value	---	7.0-8.2	13.	Turbidity	NTU	10	Sl.No.	Characteristics	Value	1.	Silica (Max.)	0.02 ppm as SiO <sub>2</sub>	2.	Iron as Fe	Nil	3.	Total hardness	Nil	4.	pH value	6.8 to 7.2	5.	Conductivity	Not more than 0.1 µs/cm	
S.No	Constituent	As	mg/l (except pH & turbidity)																																																																											
1.	Calcium	CaCO <sub>3</sub>	131																																																																											
2.	Magnesium	CaCO <sub>3</sub>	52																																																																											
3.	Sodium + Potassium	CaCO <sub>3</sub>	65																																																																											
4.	Total Cations	CaCO <sub>3</sub>	248																																																																											
5.	Chloride	CaCO <sub>3</sub>	20																																																																											
6.	Sulphate	CaCO <sub>3</sub>	93																																																																											
7.	Nitrate	CaCO <sub>3</sub>	10																																																																											
8.	Alkalinity	CaCO <sub>3</sub>	125																																																																											
9.	Total Anions	CaCO <sub>3</sub>	248																																																																											
10.	Iron(total)	Fe	0.3																																																																											
11.	Total Silica	SiO <sub>2</sub>	22																																																																											
12.	pH value	---	7.0-8.2																																																																											
13.	Turbidity	NTU	10																																																																											
Sl.No.	Characteristics	Value																																																																												
1.	Silica (Max.)	0.02 ppm as SiO <sub>2</sub>																																																																												
2.	Iron as Fe	Nil																																																																												
3.	Total hardness	Nil																																																																												
4.	pH value	6.8 to 7.2																																																																												
5.	Conductivity	Not more than 0.1 µs/cm																																																																												
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 27 OF 29																																																																											



BIHARTIYA RAIL BIJLEE COMPANY LTD.  
 A JOINT VENTURE OF NTPC AND INDIAN RAILWAYS

**NABINAGAR THERMAL POWER PROJECT**

TITLE: **VICINITY PLAN**

DATE	SCALE	SHEET NO.	SHEET	NO. OF SHEETS
A3	1:50000	0270	999	NOG - W - 001

FILE: Nabinagar - 45220881.tif

जलवायवी सारणी  
CLIMATOLOGICAL TABLE

स्टेशन : देहली  
STATION : Dehli

अक्षांश 24°55' N  
देशांतर 84°11' E

समुद्री तल माथ से ऊँचाई 107 METRES

1951 से 1980 तक के प्रेक्षणों पर आधारित  
BASED ON OBSERVATIONS FROM 1951 TO 1980

वायु तापमान												वर्षा											
मही	स्टेशन का स्तंभ पवन	मध्य				धम				आर्द्रता		मेघ की मात्रा		मासिक योग	वर्षा के दिनों की संख्या	वर्षा की सबसे कम महीने का योग	वर्षा की सबसे अधिक महीने का योग	24 घंटों की सबसे अधिक वर्षा	दिनांक और वर्ष	माध्य पवन गति			
		दैनिक अधिकतम	दैनिक न्यूनतम	महीने में अधिकतम	महीने में न्यूनतम	दिनांक और वर्ष	दिनांक और वर्ष	सापेक्ष आर्द्रता	वर्षा पवन	समतल मेघ	निम्न मेघ												
AIR TEMPERATURE												RAINFALL											
MONTH	STATION LEVEL	MEAN						EXTREMES				HUMIDITY		CLOUD AMOUNT		MONTHLY TOTAL	NO. OF RAINY DAYS	TOTAL IN WETTEST MONTH WITH YEAR	TOTAL IN DRIEST MONTH WITH YEAR	HEAVIEST FALL IN 24 HOURS	DATE AND YEAR	MEAN WIND SPEED	
		DRY BULB	WET BULB	DAILY MAX	DAILY MIN	HIGHEST IN THE MONTH	LOWEST IN THE MONTH	HIGHEST	DATE AND YEAR	LOWEST	DATE AND YEAR	RELATIVE HUMIDITY	VAPOUR PRESSURE	ALL CLOUDS	LOW CLOUDS								
	एच. पी. ए. hPa	डि.से. °C	डि.से. °C	डि.से. °C	डि.से. °C	डि.से. °C	डि.से. °C	डि.से. °C	डि.से. °C	प्रतिशत %	एच. पी. ए. hPa	आकाश के अंशमत्रा Oktas of sky	मि.मि. mm	मि.मि. mm	मि.मि. mm	मि.मि. mm	कि.मी. प्र. घं. Km/hr						
जनवरी JAN	I 1004.9 1001.4	15.1 21.5	12.9 15.3	23.8	10.1	27.9	8.1	30.6	20 1958	-1.0 1977	16	74 49	12.7 12.5	1.7 1.6	9.9 1.1	17.5	1.7	94.0 1930	0.0	65.0	27 1950	3.9	
फरवरी FEB	I 1002.5 998.9	18.5 25.3	14.3 16.8	27.1	12.9	32.2	8.3	35.3	23 1964	3.0 1974	15	62 40	12.9 12.5	1.5 1.3	0.7 0.7	11.2	1.3	103.9 1907	0.0	52.6	05 1915	4.0	
मार्च MAR	I 999.3 995.1	24.5 31.5	17.2 19.0	33.2	17.7	38.5	12.7	41.5	31 1973	6.8 1976	03	48 27	13.7 12.0	1.6 1.3	0.5 0.8	11.7	1.2	88.9 1944	0.0	43.7	16 1944	5.6	
अप्रैल APR	I 995.2 990.8	30.9 36.9	20.2 21.6	38.9	23.1	42.7	17.8	44.4	23 1973	10.3 1976	04	35 22	15.2 13.3	1.3 1.3	0.3 0.4	7.2	0.7	48.3 1914	0.0	43.2	08 1914	6.6	
मई MAY	I 990.7 986.5	33.3 38.8	23.2 23.9	41.1	26.2	44.7	21.3	46.7	21 1951	12.8 1976	16	41 27	20.2 17.7	1.2 1.1	0.4 0.3	16.8	1.2	103.4 1914	0.0	96.0	31 1914	6.6	
जून JUN	I 987.0 983.5	32.2 35.5	25.8 26.1	38.5	26.7	44.0	22.7	47.2	09 1966	14.8 1976	15	61 49	28.2 26.3	3.9 4.3	2.0 2.7	109.5	6.0	505.4 1961	0.0	220.0	13 1961	6.4	
जुलाई JUL	I 987.2 984.3	29.2 31.1	26.5 27.0	33.4	25.2	37.8	22.4	42.2	01 1962	15.3 1976	15	81 73	32.5 32.5	6.4 6.3	4.8 4.9	315.2	14.5	655.8 1922	55.1 1903	202.4	01 1925	5.8	
अगस्त AUG	I 988.6 985.4	28.6 30.2	26.6 27.1	32.3	25.0	35.0	22.7	39.4	03 1972	15.8 1976	25	85 79	33.0 33.4	6.2 6.2	4.9 5.1	277.8	15.0	748.3 1948	78.6 1979	254.5	14 1910	4.9	
सितम्बर SEP	I 992.7 989.0	28.5 29.9	25.9 26.5	32.2	24.4	34.9	22.0	37.1	12 1979	14.0 1976	19	81 77	31.4 32.0	4.8 4.9	3.6 3.8	193.7	9.4	771.7 1976	25.1 1928	218.4	12 1936	4.6	
अक्तूबर OCT	I 998.8 995.2	26.6 29.3	23.1 24.2	31.9	20.9	34.4	16.7	37.1	14 1974	9.3 1976	31	73 65	25.5 26.1	1.9 1.9	1.2 1.3	48.0	3.1	240.3 1928	0.0	153.7	06 1928	3.2	
नवम्बर NOV	I 1003.2 999.7	21.3 28.0	17.9 19.6	29.2	14.6	31.9	10.7	35.1	07 1977	2.8 1975	30	68 53	17.3 18.0	1.3 1.0	0.5 0.5	7.7	0.4	105.2 1915	0.0	100.6	19 1915	2.8	
दिसम्बर DEC	I 1005.3 1001.7	16.2 22.3	13.6 16.1	25.1	10.9	28.2	7.1	31.7	01 1952	0.3 1976	22	74 49	13.7 13.1	1.3 1.2	0.4 0.4	4.9	0.6	47.7 1913	0.0	21.6	21 1940	3.1	
वार्षिक योग या माध्य ANNUAL TOTAL OR MEAN	I 996.3	25.4	20.6	32.2	19.8	45.1	5.4	47.2		-1.0		65	21.4	2.8	1.7	1038.9	55.1	1789.8	530.1	254.5		4.9	
वर्षों की सं. NUMBER OF YEARS	II 992.6	29.0	21.9									51	20.8	2.7	1.8			1061	1966				30
		30	30	30	30	30	30	36		35		30	30	30	23	28	28	78	78	78		30	







**4X250 MW BRBCL NABINAGAR TPP  
(FGD SYSTEM PACKAGE)  
HVAC SYSTEM  
TECHNICAL SPECIFICATION**

**SPECIFICATION No: PE-TS-463-(571-13000-A)-A001**

**SECTION : I**

**Sub Section : C**

**REV. 00**

**SECTION: I**

**SUB SECTION: C**

**TECHNICAL SPECIFICATIONS**



**4X250 MW BRBCL NABINAGAR TPP  
(FGD SYSTEM PACKAGE)  
HVAC SYSTEM  
SPECIFIC TECHNICAL REQUIREMENT**

**SPECIFICATION No: PE-TS-463-(571-13000-A)-A001**

**SECTION : I**

**SUB-SECTION : C 1**

**REV. 00**

**SHEET 1 OF 17**

**SECTION: I**

**SUB-SECTION: C 1**

**SPECIFIC TECHNICAL REQUIREMENT**



**4X250 MW BRBCL NABINAGAR TPP  
(FGD SYSTEM PACKAGE)  
HVAC SYSTEM  
SPECIFIC TECHNICAL REQUIREMENT**

**SPECIFICATION No: PE-TS-463-(571-13000-A)-A001**

**SECTION : I**

**SUB-SECTION : C 1**

**REV. 00**

**SHEET 2 OF 17**

### 1. FUNCTION

The purpose of the system is to provide HVAC system for different areas of 3X660 MW **NABINAGAR** TPP (FGD SYSTEM PACKAGE) under the scope of this tender.

### 2. SYSTEM DESCRIPTION

#### 2.1 AC SYSTEM

AC –Plant

AC plant, in FGD control room building is provided to cater the air conditioning requirements of the control room for FGD control room building.

The air conditioning plant shall comprise of **4 x 50%** Air cooled condensing units (D-X type) type air conditioners with AHUs of suitable capacity with **4x50%** configuration and other accessories as per the system/specification requirement. These AHU shall be located in AHU rooms located adjacent to / above the air-conditioned areas. The conditioned air from AHUs is distributed to the air-conditioned areas by galvanised sheet steel ducting and extruded Aluminium grilles / diffusers with volume control dampers and supporting frames.

Controls for the AC & Ventilation (common) shall be DCS based.

For balance offsite areas, Split Type Air Conditioners shall be provided as enumerated below:

Split type air conditioners (air cooled) shall be provided to cater to the air conditioning requirements of auxiliary areas / buildings. Local isolator / MCB shall be provided with split unit's / Cassette units.

Hand operated remote and other accessories as specified. Local Distribution Boards containing Switch / MCB shall be provided for Split Air Conditioners. Each split unit shall also be provided with suitable rating stabiliser.

Single phase electrical feeders of following ratings shall be provided for split units. Bidder to ensure the suitability as per these feeder requirements.

Capacity of Split AC	Single phase supply feeder
1.5 TR	32 Amp
2 TR	

#### 2.2 VENTILATION SYSTEM

2.2.1 The Ventilation System is provided within the FGD control room building by MODULAR UAF.

2.2.2 Battery and Battery charger room through exhaust fans and intake louvers.

Please refer to relevant clauses of customer technical specifications section C-2 for other detail of system description.

### 3. DESIGN CRITERIA

3.1 The outside design conditions considered are as follows: -

	Summer	Monsoon	Winter
DBT (°C)	45.0	38	5.0
WBT (°C)	25.0	28	2.0



**4X250 MW BRBCL NABINAGAR TPP  
(FGD SYSTEM PACKAGE)  
HVAC SYSTEM  
SPECIFIC TECHNICAL REQUIREMENT**

**SPECIFICATION No: PE-TS-463-(571-13000-A)-A001**

**SECTION : I**

**SUB-SECTION : C 1**

**REV. 00**

**SHEET 3 OF 17**

**3.2 AC system: -**

The inside design conditions for Air conditioned area to be maintained are as follows: -

- Temperature  $24^{\circ}\text{C} \pm 1^{\circ}\text{C}$  & RH  $50\% \pm 5\%$

A minimum design margin of 10% shall be considered while designing the AC Plant capacity for each area.

Following safety factor to considered while designing the AC system

- Minimum 12.5% in RSH
- Minimum 10% in RLH
- 10% margin on dehumidified CFM

For winter heating load calculation, 50% of combined light load and eqpt. / panel load as available in the room shall be considered.


**3.3 Ventilation System: -**

The inside design conditions for Ventilated area to be maintained are as follows: -

- In the areas ventilated by evaporative cooling units, the inside dry bulb temperature shall be restricted to  $3^{\circ}\text{C}$  less than the summer ambient temperature (DB).
- In dry type forced (mechanical) ventilation system, the inside temperature shall be restricted about  $3^{\circ}\text{C}$  higher than the summer ambient (outside) temperature (DB).

The ventilation philosophy in various areas shall be as under

S.No.	Area	Type of Ventilation	ACPH
1.	FGD control room building	Ventilation with modular UAF.  Motorized Fire dampers will be provided in the supply air ducting of Cable Spreader room/MCC	8
2.	General areas, like pump house, building etc.	Combination of Supply and exhaust fan	20
3.	MCC / Switchgear rooms. etc.	Supply fan & back draft dampers	30
4.	Battery rooms & other areas where gaseous fumes/ vapors are generated	Combination of intake louvers & Exhaust air/Roof extractor fans.	30

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		<b>SHEET 4 OF 17</b>	

In addition to above, mechanical ventilation for other auxiliary buildings shall also be provided.

3.4 All equipment shall be designed for continuous duty.

3.5 For other design parameters refer to section C2-A, customer specifications.

### 3. SYSTEM CAPACITY AND CONFIGURATION:

a) For AC Plant: -

4x50 % (1W + 1S, minimum **55 TR** Actual capacity) DX- type air cooled condensing unit shall be provided.

b) For Ventilation system: -

1 nos. each of minimum **1,40,000 CMH** capacity (both working) MODULAR TYPE UAF shall be provided.

### 4. LAYOUT CONSIDERATIONS:

#### a) AC PLANT

- I. Air cooled DX-type condensing units for AC Plant shall be housed at the roof of FGD control room building.
- II. The AHUs for this AC Plant would be located inside AHU room located on the roof of FGD Control Room.
- III. 1 T Capacity Chain pulley block with/without Monorail arrangement shall be provided for the AHU for maintenance purpose.

#### b) Ventilation system

- I. MODULAR UAF shall be placed at the roof of FGD control room building.
- II. MODULAR UAF shall be placed in open, exposed to ambient conditions and no masonry room shall be provided. Both pump and fan should be within the casing.
- III. The exhaust air from battery room shall be taken out through MS duct having epoxy coating, if required and the air shall be released above roof of the building.


For other design parameters refer to section C2-A, customer specifications

### 5. EQUIPMENT DETAILS:

#### 6.1 AC EQUIPMENT DETAILS

##### 6.1.1 Air cooled condensing unit

Refer to relevant clauses of section C2-A, customer specifications

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		SHEET 5 OF 17	

#### 6.1.2 AIR HANDLING UNIT (DOUBLE SKIN TYPE)

- a) Motors shall be installed inside the AHU.
- b) Accessories, valves, controls and instruments etc. shall be provided as per customer approved PID
- c) Drain piping from the AHUs up to nearest drain point.
- d) Serrated rubber pads for vibration isolation
- e) For other details please refer to relevant clauses of section C2-A, customer specifications.

#### 6.1.3 STRIP HEATER PACKAGE AND HUMIDIFICATION PACKAGE

- a) One set of electrical strip heater package of suitable capacity shall be provided in supply air duct. Heater package shall be connected with thermostat / Humidistat which will be provided in return air path inside AHU Room.

Temp element shall also be provided and the same shall be hooked with DCS system. RH and temp sensor shall be provided and the same shall be hooked with DCS system.

- b) One No. pan humidifier comprising heater, humidistat, water tank, low level switch over flow, draining, make up connection, float valves etc. for each AHU Room.

For other details please refer to relevant clause of section C2-A, customer specifications

#### 6.1.4 Thermal and acoustic Insulation

Please refer to relevant clause of section C2-A, customer specifications.

### 6.2 VENTILATION EQUIPMENT DETAILS

#### 6.2.1 MODULAR UAF

Each MODULAR UAF shall comprise of:


- a) Centrifugal fan and pump.
- b) Pump along with fan and other accessories shall be housed in sheet metal body as per Customer technical specification section C-2A
- c) Please refer to relevant clauses of Customer technical specification section C-2A for MODULAR UAF construction.

#### 6.2.2 CENTRIFUGAL FLOW FAN UNITS

- a) Please refer to relevant clauses of Customer technical specification section C-2A for centrifugal fan.

#### 6.2.3 WALL MOUNTED AXIAL FLOW FAN

- a) Adjustable damper, vibration isolators, nuts and bolts, back draft dampers etc. Shall be provided.
- b) These fans shall cater to the areas as indicated in the fan schedule of ventilation system

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	<b>SPECIFICATION No: PE-TS-463-(571-13000-A)-A001</b>	
		<b>SECTION : I</b>	
		<b>SUB-SECTION : C 1</b>	
		<b>REV. 00</b>	
		<b>SHEET 6 OF 17</b>	

- c) Please refer to relevant clauses of Customer technical specification section C-2A for detail construction of axial flow fan.

#### 6.2.4 ROOF EXTRACTOR UNIT

- a) Each roof extractor unit shall be complete with foundation bolts including screen at bottom.  
b) Please refer to relevant clauses of Customer technical specification section C-2A for detail construction of RE Unit.

#### 6.2.5 INSULATION

- a) Thermal insulation shall be provided for the duct exposed to sun / rain only.  
b) Please also refer to other relevant clauses of Customer technical specification section C-2A for detail of insulation.

#### 6.2.6 WATER PUMP SETS

Each circulating water pump set for MODULAR UAF shall comprise of the following

- a) Pump (as per the specification) of adequate capacity to match the system requirement MODULAR UAF spraying arrangement.  
b) One no. adequately sized TEFC sq. cage induction motor suitable for 415V, 3 phase, 50 Hz AC supply.  
c) One no. Pot type strainer at inlet complete with screen, drain arrangement etc.  
d) 150 mm dia. Dial Type pressure gauges one each at suction & discharge side of the pump set.  
e) One no. non-return (check) valve at discharge side of pump set.  
f) One set of base plate, coupling, coupling guard, anti-vibration mountings, foundation bolts etc.  
g) Rain protection canopy for the pumps and motors, if located at outdoor shall be provided.  
h) Please also refer to other relevant clauses of Customer technical specification section C-2A for detail construction of water pump.

### 6.3 COMMON FOR BOTH AC AND VENTILATION SYSTEM

#### 6.3.1 SHEET METAL WORK

- a) Air distribution would be done through ducting system, grilles and diffusers. All ducting shall be designed on equal friction method and fabricated as per IS: 655  
b) Supply air diffusers / grilles (Frame and Louvers of Diffuser/Grilles shall be of extruded aluminium of 1.2 mm thick section, duly powder coated) with volume control dampers for AC and Ventilation System. Return air Diffusers will have no Volume Control Damper.  
c) For other details please refer to relevant clauses of section C2-A, customer specifications

#### 6.3.2 FIRE DAMPERS

- a) Motorized fire damper shall be installed at supply and return air duct at suitable locations where duct pass through wall & floors for ease of isolation, maintenance and as well as for emergency operation. Fire damper in the supply and return air duct shall close on receiving fire signal from fire protection system and shall also be

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	<b>SPECIFICATION No: PE-TS-463-(571-13000-A)-A001</b>	
		<b>SECTION : I</b>	
		<b>SUB-SECTION : C 1</b>	
		<b>REV. 00</b>	
		<b>SHEET 7 OF 17</b>	

possible manually from remote control panel. Necessary arrangement shall be incorporated in the duct for providing duct mounted multi- sensor detectors in the return air duct for all air conditioned areas. Also respective Air Handling Units / Modular UAFs shall trip on receiving fire signal from fire protection system.

b) For fire damper refer to relevant clauses of section C2-A, customer specifications.

#### 6.3.3 PIPING VALVES ETC

a) Refer to relevant clauses of section C2-A, customer specifications

#### 6. ELECTRICAL ITEMS:

Refer to relevant clauses of section C2-A, customer specifications and section C-3, electrical portion of specifications.

#### 7. CONTROL PHILOSOPHY

A DCS based control system shall be provided for AC & Ventilation system. The DCS based control system shall cover the followings.

- AC system for FGD control room building.
- MODULAR UAF unit for FGD control room building.
- Refer to clause of section, C-4 of specification (C&I Specification for HVAC).

#### 8.1 SAFETY CONTROLS

All necessary measuring – control instruments & control system shall be provided. With following compressor & evaporator interlock in the control panel of the condensing unit.


- a) High discharge pressure cut-out (HP) as applicable
- b) Low suction pressure cut out (LP) as applicable
- c) Oil pressure cut-out (OP) as applicable
- d) Anti-freeze thermostat (AFT) as applicable
- e) Any other essential safety control as per the OEM

#### 8.2 OPERATING CONTROL

All operating control as necessary shall be provided. However following minimum control features / hardware shall be provided:-

- a) Automatic capacity control system as applicable.
- b) Automatic unloaded starting device
- c) Operating Thermostat
- d) Unloading solenoid valves (if applicable)
- e) 3 way flow control valve at the AHU's (if applicable)
- f) Operation / Sequence Interlock of the Air conditioning system shall be as under:
  - I. Condenser fan is started.
  - II. The Air Handling Unit is started.
  - III. Chilling unit is started



	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		SHEET 8 OF 17	

### 8.3 INTERFACE WITH DCS

Following hardwired signals shall be provided in the DCS for monitoring purpose for AC system

- a) Temperature & Humidity.
- b) AC Plant On / Off Status.
- c) AHU Run / Trip.
- d) General AC Plant Warning.

### 8.4 INDICATIONS PROVIDED FOR MODULAR UAF IN LOCAL CONTROL PANEL

FAN RUNNING

FAN STOP

PUMP - RUNNING

PUMP - STOP

FAN MOTOR OVERLOAD.

PUMP - MOTOR OVERLOAD.

The water sump of each modular Unitary Air Filtration Units shall be provided with a level transmitter which will initiate an alarm and will trip the pump sets, in case the water level falls below the predetermined level.

### 8. SPECIFIC REQUIREMENT

- Efficiency of centrifugal fan shall not be less than 70%. Pump selected should have the maximum available efficiency for given flow and head chosen.
- All ventilation system shall operate on 100% fresh air.
- MODULAR UAF shall have minimum 70% saturation efficiency.
- Ventilation ducts shall be provided with motorized type fire dampers at the supply duct in electrical area like MCC / Switch gear room/ cable spreader room, as well as Electrical areas which will close in case of fire.
- The fire damper shall close the air flow inside the duct on receiving fire alarm signal from FPS. Also respective fan shall trip once the fire damper is closed.
- Air Velocity through different system equipment should be maintained as the specification.
- Roof Exhausters and wall mounted Exhaust Fan motors shall be designed for a minimum 55-degree C ambient while the supply air fan motors shall be designed for a min.50-degree C.
- All fans shall be selected with non-overloading characteristics as far as practicable and the respective drive motor shall have a rating more than the limit load of the fan or at least 20% higher than the brake horse power, which is higher.
- Design margin shall be maintained as follows:



**4X250 MW BRBCL NABINAGAR TPP  
(FGD SYSTEM PACKAGE)  
HVAC SYSTEM  
SPECIFIC TECHNICAL REQUIREMENT**

**SPECIFICATION No: PE-TS-463-(571-13000-A)-A001**

**SECTION : I**

**SUB-SECTION : C 1**

**REV. 00**

**SHEET 9 OF 17**

- For Pump a) Head-10%      b) Flow-10%
- RE / wall mounted fans shall be selected so as to have motor rating and wall / slab opening as under. Feeder suitable for following ratings only shall be provided by BHEL.

1.	Roof extractor units with 15 mmwc static pressure.		
	Capacity	Motor rating	Roof / Slab opening
a.	40,000 CMH	5.5 KW	1320mm
b.	20,000 CMH	2.2 KW	1140mm
2	Axial flow supply fans with 30 mmwc static pressure.		
	Capacity	Motor rating	Wall opening
a.	10,000 CMH	2.2 KW	800mmx800mm
b.	7,500 CMH	1.5 KW	700mmx700mm
c.	6,000 CMH	1.1 KW	600mmx600mm
d.	4,000 CMH	0.75 KW	500mmx500mm
3	Axial flow supply fans with 20 mmwc static pressure.		
	Capacity	Motor rating	Wall opening
a.	10,000 CMH	1.5 KW	800mmx800mm
b.	7,500 CMH	1.1 KW	700mmx700mm
c.	6,000 CMH	1.1 KW	600mmx600mm
d.	4,000 CMH	0.75 KW	600mmx600mm
4	Axial flow exhaust fans (Bifurcated type) with 15 mmwc static pressure.		
	Capacity	Motor rating	Wall opening
a.	15,000 CMH	2.2 KW	900mmx900mm
b.	10,000 CMH	1.5 KW	800mmx800mm
c.	7,500 CMH	1.1 KW	700mmx700mm
d.	4,000 CMH	0.75 KW	600mmx600mm



**4X250 MW BRBCL NABINAGAR TPP  
(FGD SYSTEM PACKAGE)  
HVAC SYSTEM  
SPECIFIC TECHNICAL REQUIREMENT**

**SPECIFICATION No: PE-TS-463-(571-13000-A)-A001**


**SECTION : I**

**SUB-SECTION : C 1**

**REV. 00**

**SHEET 10 OF 17**

e.	2,000 CMH	0.55 KW	500mmx500mm
5	Axial flow exhaust fans with 10 mmwc static pressure.		
	Capacity	Motor rating	Wall opening
a.	15,000 CMH	1.1 KW	900mmx900mm
b.	10,000 CMH	0.75 KW	800mmx800mm
c.	7,500 CMH	0.55 KW	700mmx700mm
d.	6,000 CMH	0.55 KW	600mmx600mm
e.	4,000 CMH	0.55 KW	600mmx600mm
f.	2,000 CMH	0.37 KW	500mmx500mm
6	Exhaust fan (propeller type) with 5 mmwc static pressure.		
	Capacity	Motor rating	Wall opening
a.	1000 CMH	100 W	330 mm circular

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		SHEET 11 OF 17	

## 9. MATERIALS OF CONSTRUCTION

### 10.1 CENTRIFUGAL FAN

- Fan Casing (side plates & stiffeners): Mild Steel Sheets with spray galvanized to IS: 2062 Gr.B / IS: 1079 /Eq. The minimum thickness of casing shall be 3.00 mm.
- Impeller hub: Mild Steel
- Impeller back plate blade & shroud: Mild Steel to IS: 2062 Gr.B.
- Shaft: EN - 8 or eqv.
- Shaft sleeve: EN - 8 or eqv.
- Flexible connection at outlet/inlet: Fire resistant type plastic impregnated canvas with M.S. flange and cleats (3 mm thick).
- V Belt (matched sets): ISI marked (Reinforced rubber section to (IS: 4776)
- Bolts & nuts: Galvanized / MS (Epoxy painted).
- Vibration isolating cushy foot mountings, foundation bolts and nuts etc.
- Please refer to relevant clauses of Customer technical specification section C-2A for MOC of centrifugal fan.

### 10.2 AXIAL FAN


- Hub: As per manufacturer std. (AL- LM6)
- Neoprene rubber pads: As required.
- Supporting frame for mounting: Required.
- Protective screen at inlet: Yes (Min 14 SWG Galvanized wire knitted in 1" square mesh).
- Mounting flange on casing: At inlet and outlet.
- Painting / protecting coating – As per clause no. 8.00.00, Section C-2A
- Please refer to relevant clauses of Customer technical specification section C-2A for MOC of axial flow fan.

### 10.3 ROOF EXTRACTOR UNIT

- Please refer to relevant clauses of Customer technical specification section C-2A for MOC of RE Unit.

### 10.4 Modular Unitary Air Filtration

- Piping: MS Heavy class Galvanised to IS: 1239 Part I / IS 3589 depending on size.
- Please refer to relevant clauses of Customer technical specification section C-2A for MOC of pipe.

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		SHEET 12 OF 17	

#### 10.5 Valves:


- Valves shall have full sizes port and suitable for horizontal and as well as vertical installation.
- Valves for regulating duty shall be of globe type suitable for controlling throughout its lift.
- Gate, Globe and stop check valves shall have bonnet back seat to facilitate easy replacement of packing with the valves in service.
- All safety / relief valves shall be so constructed that the failure of any part does not obstruct the free discharge.
- Manual gear operators be provided for valves of size 200 NB and above.
- Please refer to relevant clauses of Customer technical specification section C-2A for MOC of valve.

#### 10.6 CENTRIFUGAL PUMP

- Impeller: Bronze as per Grade IS: 318 Grade 2
- Pump shaft: SS 316
- Casing: 2% Ni Cast iron to IS: 210 GR. FG-260.
- Shaft Sleeve: SS 316.
- Bolt and nuts: M.S. (Epoxy painted / Galvanised).
- Type of seal: Mechanical
- Pump motor coupling: Pin & bush type.
- Please refer to relevant clauses of Customer technical specification section C-2A for MOC of pump.


#### 10. GENERAL


- 1) Basis of design all calculations including heat load calculations for summer seasons, equipment selection criterion, layout drawings/ schemes/G.A. dwg and documents like data sheet/ technical particulars etc are subject to Customer approval during detail engineering stage.
- 2) Vendor to furnish characteristic curves for all major equipment offered indicating duty point during detailed engineering.
- 3) All drawings and documents shall be computer based.
- 4) Vendor to include the Back wash arrangement of pot strainer with gate valve, piping etc for the MODULAR UAF.
- 5) Vendor to include level gauge & level transmitter for each MODULAR UAF tank for alarm & trip of the pumps. Also include one no. Pressure transmitter for each MODULAR UAF pump.

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	<b>SPECIFICATION No: PE-TS-463-(571-13000-A)-A001</b>	
		<b>SECTION : I</b>	
		<b>SUB-SECTION : C 1</b>	
		<b>REV. 00</b>	
		<b>SHEET 13 OF 17</b>	


Temperature elements, electronic transmitters etc. are to be provided for all the cases. Acceptance of use of process actuated switches is subject to customer approval.

- 6) All commissioning spares & consumables including refrigerant till handing over of the equipment for trouble free operation shall be provided.
- 7) Quality Requirements in the Technical Specification are indicating minimum requirements for inspection and testing. Vendor shall note that quality plan is subject to Customer & BHEL-approval during detail engineering stage. Standard QP format is enclosed in the technical specification.
- 8) Indicative list of makes is enclosed as per Annexure-I however these makes shall be subject to Customer & BHEL approval during detail engineering Stage.
- 9) Inserts or any support arrangement for fixing ducting, fans, piping etc. shall not be provided by BHEL. Necessary supports may be taken from nearest structure / walls / roofs / floors etc. by Vendor.
- 10) Fixing frame works for diffusers and grilles in the scope of Vendor.
- 11) Anchor fastener shall be used by vendor for fixing duct pipes etc. wherever applicable.
- 12) Necessary supports and structures / frames etc. as required for supporting the duct / piping / equipment's etc. as lump-sum basis is in the scope of Vendor and no unit rates shall be applicable for these items. Beam between two columns, if required, for supporting the duct, shall be provided by BHEL. Vendor shall take secondary support (angle, channel, beam, bracket etc.) from main column/ beam provided by BHEL, as required for supporting the duct. Further, necessary structure required for duct support shall be in bidder's scope on lump sum basis and no unit rate for the same shall be applicable.
- 13) Drain piping within room up to the drain point to be provided by the Vendor.
- 14) Vendor to furnish schedule of power and control cables. Vendor to furnish cable termination details interconnection drawings etc. during detail engineering stage.
- 15) The tools and machine required for erection of equipment shall be arranged by Vendor.
- 16) Tools & tackles as required for regular maintenance shall be supplied by Vendor.
- 17) Instruments required for performance testing of various equipment / system of the package shall be arranged by Vendor at site.
- 18) Instrument for testing shall be calibrated by HVAC system supplier before taking up testing.
- 19) Pressure gauges shall have provision for air venting.
- 20) Matching sockets / stubs (weld type) for flow switches and other instruments shall be supplied (as per attached instrumentation installation diagram)

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		<b>SHEET 14 OF 17</b>	
<p>21) Bidders shall guarantee to maintain specified inside design conditions during summer, monsoon and winter and also even if the internal equipment load varies from 100% to 25%.</p> <p>22) Besides the system performance as above, bidder shall guarantee major technical parameters of various equipment's as per design basis / details furnished in different section of technical specification.</p> <p>23) The guarantee tests shall cover but not limited to the following rated parameters for smooth operation of air conditioning and ventilation system.</p> <ul style="list-style-type: none"> <li>➤ Performance test of the HVAC system shall be carried out at site after proper installation. The site test shall include performance testing of equipment for minimum 72 continuous hours in summer or monsoon and minimum 24 continuous hours in winter. Bidder, as may be required to carry out site tests shall arrange all instruments, tools etc.</li> <li>➤ All calibrated instruments to be used for the tests at manufacturer's works/site shall be arranged by the bidder.</li> </ul> <p>24) For group of motorized fire damper / motorised valves, single phase power supply shall be provided by BHEL in AHU room and near MODULAR UAF. Suitable transformer shall be provided by bidder (if required) to derive the power input. Further distribution through junction box / distribution board shall be in vendor scope and shall have provision for isolation of individual fire damper/ valves.</p> <p>25) Tender drawings enclosed form the part of specification and the bidder shall check the space requirements for installing the equipment as per the specification and layout requirements given in the specifications.</p> <p>26) Bidder should suitably group the signals coming from various instruments etc. &amp; the same shall terminate in local JB, from Local JB common cable to DCS / panel / MCC shall be selected. Any Electrical / C&amp;I item and accessories like junction box, glands etc. shall be included by vendor in his scope.</p> <p>27) In the event of any conflict between the requirements of two clauses of this specification documents or requirements of different codes and standards specified, the more stringent requirement as per the interpretation of the owner shall apply.</p> <p>28) Bidder to note that BHEL reserve the right for drg/doc submission through web based Document Management System. Bidder would be provided access to the DMS for drg/doc approval and adequate training for the same. Bidder to ensure proper internet connectivity at their end.</p> <p>29) Quality requirements in the Technical specification are minimum requirements for inspection and testing. Vendor to note that quality plans are subject to Customer approval during detail engineering stage. Standard QP format is enclosed in the technical specification.</p>			

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	<b>SPECIFICATION No: PE-TS-463-(571-13000-A)-A001</b>	
		<b>SECTION : I</b>	
		<b>SUB-SECTION : C 1</b>	
		<b>REV. 00</b>	
		<b>SHEET 15 OF 17</b>	
<p>30) Sealing of duct opening, grouting of foundation / foundation bolts etc. including special type of grouting like GPX2 etc. are in the scope of Air-conditioning system vendor.</p> <p>31) Flat, platform type RCC / PCC foundation shall be provided for installing DX Unit/ PUMP, AHU and FAN etc. Vendor shall fix the equipment using anchor fasteners to secure the equipment obtain parameters related to vibration and noise.</p> <p>32) Bidder to note that the P&amp;ID shows only the bare minimum requirement of valves and instruments. Any instrumentation &amp; valves as required for the completion of the system in line with technical specification shall be provided by bidder during detailed engineering without any commercial implication.</p> <p>33) Supplier to furnish drawings/ documents as per the dwg. / documents distribution as per project requirement.</p> <p>34) Each motor terminal box shall be provided with cable gland and lugs for the size and type of power and control cable of respective motor.</p> <p>35) All electrical equipment shall be suitable for the power supply fault levels and other climatic conditions indicated in project information / synopsis / specifications enclosed.</p> <p>36) The bidder's proposal shall be for equipment in accordance with the tech. Specification.</p> <p>37) The bidder shall furnish complete tech. Particulars in data sheet and schedules as specified elsewhere in the specification during detail engineering</p> <p>38) Motorized fire damper will be installed at supply air duct in electrical areas like MCC / Switchgear room / cable spreader room etc. in FGD control building. Fire damper will close on receiving fire signal from fire protection system and shall also be possible manually from remote control panel. Also modular UAF shall trip on receiving fire signal from fire protection system.</p> <p>39) All openings required in brick wall for installing the axial supply and exhaust fans, propeller fans, duct opening, louvers and damper openings etc shall be done by BHEL as per opening sizes indicated under clause number 7. Any opening requirement on account of change in size of equipment over and above the opening size indicated under clause number 7, same shall be done by vendor along with finishing of opening and painting as per finished wall. Grouting of fans along with anchor fasteners shall be done by vendor. The openings shall be finished properly. In case openings are done once the wall have been painted, repainting, to match with the existing wall paint shall also be done by the vendor. Sealing of duct opening, grouting of foundation / foundation bolts etc. including special type of grouting like GPX2 etc. are in the scope of Ventilation system vendor.</p> <p>40) Flat, platform type RCC / PCC foundation shall be provided for installing modular UAF and UAF fan / pumps etc. Vendor shall fix the equipment using proper anchor fasteners to secure the equipment and obtain parameter related to vibration and noise.</p>			



	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		<b>SHEET 16 OF 17</b>	

- 41) All codes and standards shall be as per contract specifications
- 42) Wherever air washer is mentioned (in the complete technical specification) same shall be read as modular UAF and wherever chiller/chilling unit is mentioned (in the complete technical specification) same shall be read as air cooled condensing unit.
- 43) Metallic ladder to be provided by the Vendor in the AHU Room for entering duct plenum.
- 44) Metallic stool to be provided by the vendor for operating / accessing valves provided over man height.

#### 11. EXCLUSIONS


Items of works listed below are excluded from scope of the HVAC system supplier.

- a) Construction of air handling unit room, foundations for HVAC equipment's.
- b) False ceiling, drop ceiling.
- c) Slab cut out for running ducts, pipes, cables, grilles/dampers. Underground masonry trenches and masonry risers. However minor civil work like making opening to suit / finishing of opening, sealing of duct opening, grouting of foundation bolts including special type of grouting like GPX2 etc. are in the scope of HVAC system vendor.
- d) Provision of drain traps / points,
- e) For Electrical scope, refer Electrical scope matrix sheet.

#### 12. CODES AND STANDARDS

Design, manufacture, inspection and testing of the equipment covered by the specification shall unless otherwise specified conform to the latest edition of the standards and codes including all addenda mentioned below:

- IS-659 : Safety code for air-conditioning
- IS-660 : Safety code for mechanical refrigeration
- ASHRAE-23 : Standard method of testing and rating [67 Standards] air conditioner.
- ARI-450-6 : Standards for water cooled refrigerant Condenser.
- ASME Sec. VII : Unfired pressure vessels
- IS-4503 : Shell and tube type heat exchanger.
- ASHRAE 22-72 : Method of testing for rating water cooled refrigerant condenser.
- ASHRAE-15-2007 : Safe Standard for Refrigeration System
- ASHRAE-30-1995 : Method of testing liquid chilling packages
- ANSI-8-31.5 : Refrigeration piping.
- ANSI-8-9.1 : Safety code for mechanical refrigeration.
- ARI-410 : Standard for air cooling and air heating coils.

	<b>4X250 MW BRBCL NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM SPECIFIC TECHNICAL REQUIREMENT</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		<b>SHEET 17 OF 17</b>	

AR1-210 : Standard for unitary air conditioning equipment.

IS-3588 : Specification for electrical axial flow fans.

AMCA-210 : Methods of performance test for fans.

BS-2831 : Methods of test for air filters used in AC and general ventilation.

IS-4671 : Expanded polystyrene for thermal insulation purpose.

IS-702 : Industrial bitumen

IS-1239 : Heavy class Pipes for sizes up to 150 mm dia.

IS-8188 : For Water conditioning

IS-325 : 3 phase induction motors

IS-4029 : Guide line for testing 3 phase induction motor

IS-210 : Specification grey iron casting

IS-2062 : Structural steel

AMCA - Bulletin : Standard code of testing centrifugal and axial No. 210 flow fans

IS-2825 : Code of practice for welding mild steel


IS-2676 : Dimensions for wrought aluminium and aluminium alloy sheets and strips.

ASHRAE Code : For various filter


ASHRAE-62-2004 : Ventilation rates

IS-655 : Specification for metal air ducts

Pump design and testing should correspond to the procedure mentioned in IS-1520

	<p style="text-align: center;"><b>TECHNICAL SPECIFICATION</b> <b>4X250 MW BRBCL NABINAGAR STPP (FGD SYSTEM PACKAGE)</b> <b>CHAIN PULLEY BLOCK</b></p>	
---	---	--

## Material Handling Equipments

	<b>TECHNICAL SPECIFICATION</b> <b>4X250 MW BRBCL NABINAGAR STPP (FGD SYSTEM PACKAGE)</b> <b>CHAIN PULLEY BLOCK</b>	
---	--	--

### 1.0 MANUAL HOIST (CHAIN PULLEY BLOCK)

Required number of manual hoist of adequate capacity, to meet the erection and maintenance requirements are to be provided for the various areas.

#### DESIGN CRITERIA

All necessary lifting equipment and hoists (hooks and provisions for chain blocks to be provided for repair work where loads exceed 50 kg, hoists to be provided for repair work where loads exceed 500 kg)

i.e. for 50 kg to < 500kg - hooks and provisions for chain blocks to be provided  
for 500 kg to <= 2000 kg – Chain pulley block with travelling trolley

Capacity of manual (Chain pulley block) hoists shall be decided keeping 25% margin over equipment to be handled.

For hand operated hoists, the hoists shall be suitable for operation from floor level. Hand chain shall be provided for long travel of trolley and the Hoisting mechanism.

#### MINIMUM LIFTING REQUIREMENT

S.N.	AREA DESCRIPTION	QTY(nos)	CAPACITY (T)	MINIMUM LIFT	TYPE
1					

Note:

1. Area, type, capacity mentioned are minimum requirement and shall be finalised during detail engineering without any commercial implication.
2. Travel and Lift are layout dependent and shall be finalised during detail engineering without any commercial implication
3. Additional manual hoist required during detail engineering shall be provided as per design criteria given above without any commercial implication.


### 2.0 SCOPE OF SUPPLIES

Equipment and services to be furnished by the bidder for the MANUAL HOIST with accessories as per the details given in the technical specification and data sheet A. Any equipment / accessories not specified in the specification but required to make the MANUAL HOIST complete and efficient operation shall also be under the bidder's scope of work.

Compliance with this specification shall not relieve the bidder of the responsibility of furnishing material and workmanship to meet the specified working/duty conditions.

### 3.0 Inspection and Testing

As per quality plan approved during detail engineering. Prime inspection agency shall be Consultant/ End Customer/ BHEL. Equipment supplied shall be strictly in accordance with nomenclature & technical specification. Any additional testing requirement/CHP (Customer

	<b>TECHNICAL SPECIFICATION</b> <b>4X250 MW BRBCL NABINAGAR STPP (FGD SYSTEM PACKAGE)</b> <b>CHAIN PULLEY BLOCK</b>	
---	--	--

Hold Point) at any stage of inspection deemed necessary by Consultant/ End Customer during detailed engineering shall be carried out without any commercial or technical implication.

#### **4.0 Runway beam**

Shall be supplied by civil contractor.

#### **5.0 PAINTING SPECIFICATION**

As per details specified elsewhere in technical specification/ Manufacturer's standard.

#### **6.0 PACKING**

As per details specified elsewhere in technical specification.

#### **7.0 DEMONSTRATION TEST**

Hoist along with its accessories shall be demonstrated for the rated capacity for the service conditions specified as per QAP approved during detail engineering.

Proof load test shall be carried out as per IS:3832.

The bidder shall have the full responsibility for the safe and efficient operation of the hoist with associated accessories as a single unit.

If the shop performance tests indicate the failure of any of the components to achieve the guaranteed performance, the deficiency shall be made good at bidder's cost.

Demonstration tests shall be carried out each time after the rectification /modification is carried out.

#### **8.0 MAKE OF CHAIN PULLEY BLOCK**

Make will be as per list specified in the specification. Any other make will be acceptable only if approved by the purchaser/ end client.


#### **9.0 TESTING AT SITE**

MANUAL HOIST:

As required for statutory clearance for operating at site with following minimum test i.e., overload and load test.


#### **MANUAL HOIST (CHAIN PULLEY BLOCK):**

Sl.no	DESCRIPTION	TECHNICAL PARTICULARS
1.0	<b>Type</b>	Hand operated chain pulley block (with/ without travelling trolley)



**TECHNICAL SPECIFICATION**  
**4X250 MW BRBCL NABINAGAR STPP (FGD SYSTEM PACKAGE)**  
**CHAIN PULLEY BLOCK**

2.0	<b>Scope (Qty., Capacity, Lift, Travel Length)</b>	As per specification and layout requirement
3.0	<b>Type of service</b>	As per specification & layout requirement (Indoor/ Outdoor)
4.0	<b>Design Ambient temperature</b>	50 Deg C
5.0	<b>Design standards</b>	IS: 3832
6.0	<b>Duty class</b>	Class II duty equivalent (Suitable for power plant operation)
7.0	<b>Hoisting Mechanism</b>	
7.1	Type	Hand operated gear transmission
7.2	Gears / pinion	
i)	Type	Spur / Helical
ii)	Material	Alloy steel / carbon steel / high graded cast iron
iii)	Type of bearing used	Antifriction ball bearing / Roller
7.3	Load Chain	
i)	Type	Link type
ii)	Material	As per IS:6216 grade 80
iii)	Conforms to (Std./Code):	IS:6216
7.4	Hand Chain	
i)	Type	Link type
ii)	Material	Mild steel (grade 30 pitched and polished) as per IS 2429 Part I / II
7.5	Load Hook	
i)	Type of load hook	Plain shank- Trapezoidal section with safety latch.
ii)	Load hooks conforms to:	IS: 8610 & with antifriction bearing
iii)	Type of hook suspension	Swiveling
iv)	Type of make of bearing	Thrust ball bearing of hook suspension
7.6	Sprockets	
i)	Type of bearings used	Antifriction ball bearing / Roller
7.7	Load chain wheel	
i)	Material	As per IS 3832
7.8	Hoisting effort	Shall not exceed 30 kg
8.0	<b>Trolley &amp; Bridge Drive</b>	
8.1	Trolley	
i)	Type	Geared (Manually operated)


	<b>TECHNICAL SPECIFICATION</b> <b>4X250 MW BRBCL NABINAGAR STPP (FGD SYSTEM PACKAGE)</b> <b>CHAIN PULLEY BLOCK</b>	
---	--	--

ii)	Material of frame	Rolled structural steel (IS:2062 Grade A or B)
8.2	Drive Chain	
i)	Type	Link type
ii)	Material	Steel Gr.30
8.3	Trolley Wheel	
i)	Number of pairs of wheel in each trolley/bridge	Two/four
ii)	Flange	Single flanged
iii)	Wheel material	As per IS 3832
iv)	Type of bearings need	Antifriction
8.4	Gears/ Pinions	
i)	Type	Spur / Helical
ii)	Material	Alloy/ Carbon steel
iii)	Type of bearings used	Antifriction
8.5	Hand chain wheel	Wheels shall be with flanges, suitable local brake shall be provided as per IS:3832 to arrest and sustain loads in all working positions
i)	Material	Cast steel as per IS 3832,
8.6	Trolley effort	Shall not be more than 30 kg
8.7	The velocity rates, effort on chain required to raise the safe working load and travel and speed shall be within the limit specified in IS:3832.	
9.0	<b>Method of lubrications (Bearings, Gearing &amp; Pinions, Sprockets)</b>	Grease
10.0	<b>Brakes</b>	Ratchet and pawl arrangement along with screw and friction disc type

## 12.0 DRAWING/DOCUMENT SUBMISSION

The successful bidder shall submit the drawings / documents as listed in Section –I, Sub-Section-E during detail engineering for customer’s approval /information:

38033/2020/PS-PEM-MAX

	MANUFACTURER'S NAME & ADDRESS :	<b>MANUFACTURING QUALITY PLAN</b> <b>ITEM : Chain Pulley Block</b> <b>QP No.:</b> PE-V0-457-571-13000-A-A102 <b>REV.:</b> , <b>Date.:</b> , <b>PAGE:</b> 1 OF 4	<b>PROJECT: 4X250 MW BRBCL NABINAGAR STPP</b> <b>(FGD SYSTEM PACKAGE)</b> <b>PACKAGE: CHAIN PULLEY BLOCK</b>
---	---------------------------------	--	--


Sr. No.	COMPONENT / OPERATION	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY			REMARKS
					M	C/N				M	C	N	
1.	2.	3.	4.	5.	6.		7.	8.	9.	10.			11.

1	<u>RAW MATERIAL &amp; B/OUT ITEMS:</u>												
1.1	HOOKS	CHEMICAL & MECH MARK & IDENTIFICATION INTERNAL DEFECTS PROOF LOAD TEST NDT AFTER PROOF LOAD TEST	MA MA MA MA MA	LAB ANALYSIS VISUAL UT REVIEW DPT	ONE SAMPLE PER HEAT 100% 100% 100% 100%	MATERIAL SPECIFICATION AS PER APPROVED DRAWINGS. HOOK TC FROM COMPETENT AUTHORITY ASTM A-388 (REFER NOTE I) IS 15560 NO RELEVANT INDICATION ASTM E-165	APPD. DRGS	APPD. DRGS.	MTC. TC IR TC TC	✓ ✓ ✓ ✓ ✓	P P P P P	V V V V V	V V V V V
1.2	LOAD CHAIN	- DIMENSIONS - BREAKING STR & % ELONGATION - PROOF LOAD -HEAT TREATMENT -GRADE	MA MA MA MA MA	MEASUREMENT -TENSILE TEST -TENSILE TEST REVIEW REVIEW	100% 1/LOT 100% 100% 1/BATCH	APPD. DRGS -DO- -DO- -DO-	APPD. DRGS. -DO- -DO- -DO-	IR MTC MTC HT CHRT MTC	✓ ✓ ✓ ✓ ✓ ✓	P P P P P P	V V V V V V	V V V V V V	

	LEGEND:	FOR CUSTOMER USE	
MANUFACTURER / CONTRACTOR	** M : MANUFACTURER / SUB-SUPPLIER C : BHEL / NOMINATED INSPECTION AGENCY. N : CUSTOMER/ NOMINATED INSPECTION AGENCY. INDICATE "P" PERFORM "W" WITNESS AND "V" VERIFICATION		
SUB-CONTRACTOR		REVIEWED BY	NAME & SIGN OF APPROVING AUTHORITY & SEAL
SIGNATURE			




38033/2020/PS-PEM-MAX

	MANUFACTURER'S NAME & ADDRESS :	<b>MANUFACTURING QUALITY PLAN</b> <b>ITEM : Chain Pulley Block</b> <b>QP No.:</b> PE-V0-457-571-13000-A-A102 <b>REV.:</b> , <b>Date.:</b> , <b>PAGE:</b> 2 OF 4	<b>PROJECT: 4X250 MW BRBCL NABINAGAR STPP</b> <b>(FGD SYSTEM PACKAGE)</b> <b>PACKAGE: CHAIN PULLEY BLOCK</b>
---	---------------------------------	--	--

Sr. No.	COMPONENT / OPERATION	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY			REMARKS	
					M	C/N				M	C	N		
1.	2.	3.	4.	5.	6.		7.	8.	9.	10.			11.	
1.3	RAW MATL. ( BAR /FORGING) FOR GEAR/ RATCHET PAWL / RATCHET WHEEL & PLATES FOR FABRICATION	CHEMICAL COMPOSITION MECHANICAL  INTERNAL DEFECTS	MA MA MA	Review Review UT	ONE SAMPLE PER HEAT  100%		Material specification as per approved drawings.  ASTM A-388 REFER NOTE 1	MFR'S TC IR	✓ ✓ ✓	P P P	V V V	V V V	TC or inspection report for components shall be given. For rounds $\geq 40$ mm and plates $\geq 20$ .	
1.4.	LOAD CHAIN WHEELS	- CHEMICAL & MECHANICAL PROPERTIES	MA	CHEMICAL MECHANICAL PROPERTIES	ONE SAMPLE PER LOT		APPD. DRG.	APPD. DRG.	MTC	✓	P	V	V	
1.5	BEARINGS	MAKE, TYPE, CATALOGUE NO.	MA	VISUAL	RANDOM		APP DRG / MFR'S CATALOGUE	APP DRG / MFR'S CATALOGUE	IR	✓	P	V	V	
1.6	HAND CHAIN WHEEL	CHEMICAL MECHANICAL PROPERTIES	MA	CHEMICAL MECHANICAL PROPERTIES	ONE SAMPLE PER LOT		AS PER DRAWING	AS PER DRAWING	MTC	✓	P	V	V	
1.7	HAND CHAIN	GRADE/ DIMENSION	MA	GRADE DIMENSION	100%		AS PER DRAWING	AS PER DRAWING	MTC	✓	P	V	V	

	LEGEND:	FOR CUSTOMER USE	
MANUFACTURER / CONTRACTOR	** M : MANUFACTURER / SUB-SUPPLIER C : BHEL / NOMINATED INSPECTION AGENCY. N : CUSTOMER/ NOMINATED INSPECTION AGENCY. INDICATE "P" PERFORM "W" WITNESS AND "V" VERIFICATION		
SUB-CONTRACTOR		REVIEWED BY	NAME & SIGN OF APPROVING AUTHORITY & SEAL
SIGNATURE			

38033/2020/PS-PEM-MAX


	MANUFACTURER'S NAME & ADDRESS :	<b>MANUFACTURING QUALITY PLAN</b> <b>ITEM : Chain Pulley Block</b> <b>QP No.: PE-V0-457-571-13000-A-A102</b> <b>REV.: , Date.: , PAGE: 3 OF 4</b>	<b>PROJECT: 4X250 MW BRBCL NABINAGAR STPP</b> <b>(FGD SYSTEM PACKAGE)</b> <b>PACKAGE: CHAIN PULLEY BLOCK</b>
---	---------------------------------	--	--

Sr. No.	COMPONENT / OPERATION	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY			REMARKS
					M	C/N				M	C	N	
1.	2.	3.	4.	5.	6.		7.	8.	9.	10.			11.

1.8	TROLLEY GEARS, PINION, WHEELS, AXLE	CHEMICAL & MECHANICAL	MA	LAB ANALYSIS,	100%		APPVD DRGS	APPVD DRGS	IR/TC	✓	P	V	V	
2	<b>IN PROCESS</b>													
2.1	RATCHET PAWL / RATCHET WHEEL	-HARDNESS -SURFACE CRACK	MA MA	HARDNESS DPT	100% 100%		IS:3832/ APPD DRG. ASTM E165	IS:3832/ APPD. DRG. NO DEFECT	IR IR	✓ ✓	P P	V V	V V	
2.2	GEARS AND PINIONS AFTER MACHINING	HEAT TREATMENT SURFACE HARDNESS SURFACE CRACK  DIMENSION	MA MA MA MA	HT CHART HARDNESS DPT FOR SURFACE CRACK MEASURE	100% 10% 100% 10%		IS 1875/IS 4367/IS 3832 --DO--  ASTM E 165	NO DEFECT	IR IR IR IR	✓ ✓ ✓ ✓	P P P P	V V V V	V V V V	
3.0	<b>FINAL INSPECTION</b>													
3.1	COMPLETE ASSEMBLY	OVERALL DIMENSION  ENDURANCE TYPE TEST  OPERATIONAL PROOF LOAD & LIGHT LOAD TEST	CR MA CR	MEASUREMENT TYPE TEST LOAD TEST	100 % 1 PER SIZE 100%		IS:3832 /APPD DRG IS 3832 -DO-	IS:3832 /APPD DRG IS 3832 -DO-	IR TC IR	✓ ✓ ✓	P P P	W V W	V V V	

	<b>LEGEND:</b>  ** M : MANUFACTURER / SUB-SUPPLIER C : BHEL / NOMINATED INSPECTION AGENCY. N : CUSTOMER/ NOMINATED INSPECTION AGENCY. INDICATE "P" PERFORM "W" WITNESS AND "V" VERIFICATION	<b>FOR CUSTOMER USE</b>	
MANUFACTURER / CONTRACTOR			
SUB-CONTRACTOR			
SIGNATURE		REVIEWED BY	NAME & SIGN OF APPROVING AUTHORITY & SEAL

38033/2020/PS-PEM-MAX

	MANUFACTURER'S NAME & ADDRESS :	<b>MANUFACTURING QUALITY PLAN</b> <b>ITEM : Chain Pulley Block</b> <b>QP No.:</b> PE-V0-457-571-13000-A-A102 <b>REV.:</b> , <b>Date.:</b> , <b>PAGE:</b> 4 OF 4	<b>PROJECT: 4X250 MW BRBCL NABINAGAR STPP</b> <b>(FGD SYSTEM PACKAGE)</b> <b>PACKAGE: CHAIN PULLEY BLOCK</b>
---	---------------------------------	--	--

Sr. No.	COMPONENT / OPERATION	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY			REMARKS
					M	C/N				M	C	N	
1.	2.	3.	4.	5.	6.		7.	8.	9.	10.			11.

		HEIGHT OF LIFT SWIVELING OF HOOK	MA MA	VISUAL VISUAL	100 % 100%	-DO- APPROVED DRG -DO-	-DO- APPROVED DRG -DO-	IR IR	✓ ✓ ✓	P P	W W	V V	
3.2	PAINTING	-CLEANING - SHADE & DFT OF PAINT	MA MI	VISUAL VISUAL	AT RANDOM AT RANDOM	APPROVED DRAWING/ <b>SPECIFICATI ON</b>	APPROVED DRAWING/ <b>SPECIFICATI ON</b>	IR IR		P - p	--- W ---	-- --- ---	
3.3	NAME PLATE	VERIFICATION	MA	VISUAL	100%			IR		P	V	---	
3.4	PACKING	-VERIFICATION	MI	VISUAL	100%	SPECS.	SPECS.	IR		P	---	---	
3.5	REVIEW OF QA DOCUMENTATION	VERIFICATION	MA	VISUAL	100%	APPD. QP	APPD. QP		✓	V	V	V	

CR – CRITICAL, MA – MAJOR , MI – MINOR

NOTE 1: WHEN BACK WALL ECHO ( BWE) IS SET AT 100% OF FULL SCREEN HEIGHT ( FSH) IN DEFECT FREE AREA THEN

(A) DEFECT ECHO SHALL NOT EXCEED 20% OF FSH &amp;

(B) BWE SHOULD BE MINIMUM 80% OF FSH IN ANY AREA.

NOTE 2: RECORDS IDENTIFIED WITH TICK SHALL BE ESSENTIALLY INLCUDED IN QA DOCUMENTATION.

	LEGEND:	FOR CUSTOMER USE	
MANUFACTURER / CONTRACTOR	** M : MANUFACTURER / SUB-SUPPLIER C : BHEL / NOMINATED INSPECTION AGENCY. N : CUSTOMER/ NOMINATED INSPECTION AGENCY. INDICATE "P" PERFORM "W" WITNESS AND "V" VERIFICATION		
SUB-CONTRACTOR		REVIEWED BY	NAME & SIGN OF APPROVING AUTHORITY & SEAL
SIGNATURE			



**4x250 MW NABINAGAR TPP  
(FGD SYSTEM PACKAGE)  
HVAC SYSTEM  
O&M SERVICES**

**SPECIFICATION No: PE-TS-463-(571-13000-A)-A001**


**SECTION : I**

**SUB-SECTION : C 1**

**REV. 00**

**SHEET 1 OF 5**

**OPERATION AND MAINTENANCE SERVICES FOR HVAC SYSTEM**

	<b>4x250 MW NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM O&amp;M SERVICES</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		SHEET 2 OF 5	

## 1.0 OPERATION AND MAINTENANCE SERVICES

The bidder scope also covers the Operation and Maintenance (O&M) services for Preventive and Breakdown maintenance from the date of successful commissioning of HVAC System to end customer. However, actual date of start of O&M services shall be communicated to successful bidder by BHEL site personnel.

Bidder to note that the spares and consumables required for maintenance of the equipment during this O&M period shall be in bidder's scope of supply. Bidder shall use only genuine parts as mentioned in O&M Manual. Any damage or malfunction caused by the use of unauthentic parts or unqualified personnel shall be responsibility of bidder and as a consequence of above bidder is required to replenish the unauthorised part and abridge the qualified person without any commercial implication to BHEL.

O&M Services scope also covers all regular maintenance by certified and trained service engineers and supply of genuine parts and lubricants as per the original equipment manufacturer's recommendations in a pro-active manner.

For the purpose of Operation of HVAC System, One-day shall be considered as 24 hours i.e. 3 shifts of 8 hours each. The HVAC System (along with related accessories) shall be operated on Round-the-clock basis on all the days of the year including Sundays and Public Holidays

O & M Personnel should be acquainted with local language. Governmental / Statutory approval w.r.t. O&M service as applicable shall be in bidder's scope.


Total duration of the Operation and Maintenance services by Bidder can be increased or decreased as per requirement and payment in such case shall be made on pro-rata basis.

Depending on start of O&M services, there is a possibility that some period of O&M services and Warranty period may overlap. However, it is clarified that any maintenance required or any spare of HVAC System required to be replaced during Warranty period (as part of warranty clause requirement) shall not be made part of O&M Services. Bidder may take care of this fact while working out the prices of O&M services.

Wherever AC system has been written in O&M Service Specification, the same shall be deemed as complete HVAC System.

The vendor shall deploy following minimum manpower for Operation of HVAC System.

- i. One qualified and experienced AC operator per shift on "Round the Clock" basis throughout the year for all days of the year including Sundays & Public Holidays. There must be minimum 30 minutes overlapping between two shift operators to get familiarize with the status of HVAC System. Under normal circumstances one shift shall not be more than 8 hours.
- ii. One Helper per shift on " Round the Clock" basis throughout the year for all the days of the year including Sundays and Public Holidays. The helper shall assist the HVAC System Operator in day to day operation of HVAC System and accessories and shall assist him for keeping HVAC System equipment's in neat

	<b>4x250 MW NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM O&amp;M SERVICES</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		SHEET 3 OF 5	

and tidy condition. Under normal circumstances one shift shall not be more than 8 hours

### 1.1 Responsibility of HVAC System Operator

- i. HVAC System operator shall be responsible for proper sequential operation of HVAC System (AC and Ventilation System) including operation of standby equipment in a predefined sequence and stopping the same (when necessary) as per the procedural practice. In case of any abnormality (like non availability of power supply at incomer of HVAC System), he shall immediately report the matter to BHEL site Engineer for further action. Similarly, any malfunctioning in the system shall be immediately reported by him to BHEL site Engineer for suitable corrective action irrespective of time of occurrence of malfunctioning / abnormality in the system. A log book of all such outrages shall be maintained by HVAC system operator, which shall be shared with BHEL site engineer on periodic basis.
- ii. HVAC System operator shall take hourly readings of all the parameters of HVAC System / Equipment's including reading on main electrical panel of HVAC System. Temperature & RH readings inside all AC areas shall be taken at least once in a day. All the readings shall be recorded in a logbook register.


### 1.2 Responsibility of Helper.

- i. The HVAC System helper shall assist HVAC System operator for day to day smooth operation of HVAC System, like Checking of water levels of UAF Tank, cleaning of Tanks, cleaning of strainers, cleaning of AHU filters and other filters etc. as and when required. He shall be responsible for keeping all the equipment's of HVAC System including DX Unit & AHU rooms in clean and tidy condition. He shall also carry out general cleaning of all AC equipment's including Electrical Panels (Part of AC System), AHU's etc. on regular basis.
- ii. The helper shall work under the control of HVAC System operator and shall always ensure that unusable junk materials are not allowed to be kept in HVAC System room or AHU rooms. Under such eventuality, he will report the matter to Plant Operator, who in turn will take suitable action including reporting the matter to BHEL site Engineer.

1.3 All the log book registers shall be arranged by vendor. Log book register duly paged and bounded will be maintained in good condition by vendor.

1.4 All the necessary tools and other materials, required for operation of HVAC System shall be kept by vendor under the control of HVAC System operator. Required testing instruments like refrigerant leak detector, Multi Meter (for Electrical portion of HVAC System), Sling psychrometer, Line Tester, Tool Kit, Torch etc. should also be always available with Plant Operator.

1.5 In case of any operator / helper being on leave, vendor shall immediately take advance action and provide substitution so that minimum manpower as indicated above is not reduced on any day. In case a particular shift duty A/C Operator or helper

	<b>4x250 MW NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM O&amp;M SERVICES</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		SHEET 4 OF 5	


does not turn up due to any reasons, the earlier duty person shall continue to make sure that HVAC System never remains unattended.

## 2.0 Maintenance of HVAC System

- i. Maintenance work under scope of the vendor shall broadly include but in no way limited to the following:
  - a) Preventive maintenance of the plant.
  - b) Servicing of the plant at regular interval including cleaning of AHU filters etc., Strainer, UAF Tanks etc.
  - c) Attending to complaints.
  - d) Replacement of worn out or defective components
  - e) Replacing of refrigerant gas and oil as and when required.

No consumable or any other items of HVAC system shall be arranged by Customer and no extra payment shall be made by customer in this regard.

- ii. Vendor shall be responsible at all time, during the entire period of contract for satisfactory performance of HVAC system (including accessories) with zero down time. During emergency or breakdown, vendor's Engineer along with related technicians shall be available immediately even though it may be beyond normal working hours or on public holidays till the HVAC System is restored back into normal satisfactory condition. Response time for attending breakdown complaints shall not exceed 2 hours.
- iii. Defective / worn out components shall be replaced only by genuine and original parts. OEM or its authorized dealer's invoice shall be submitted as proof of using genuine parts. All common spares required for HVAC system shall normally be kept available in the plant by the vendor. However, for critical spares, the same shall be made available in not more than 72 hours from the time of break-down requiring such spare.
- iv. Preventive Maintenance, servicing of HVAC System equipment's and accessories etc. shall be done by vendor in a planned manner in consultation with concerned customer's engineer. Preventive maintenance and service should be done as per the recommendations / guidelines of various OEMs
- v. Major servicing & over handling of equipment's like compressors, evaporators, condensers, pumps, AHU's, piping / ducting works, valves etc. shall be done by vendor once in a year.
- vi. Painting of all equipment's including base frames & accessories like piping, electrical panel boards etc. shall be done once in two years.
- vii. In case any repair/services of particular equipment of system like chiller unit is to be carried out by vendor through OEM (or their authorized dealer), all the

	<b>4x250 MW NABINAGAR TPP (FGD SYSTEM PACKAGE) HVAC SYSTEM O&amp;M SERVICES</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 1	
		REV. 00	
		SHEET 5 OF 5	

arrangements including tools, O&M spares etc. shall be the total responsibility of vendor.

- viii. Vendor shall arrange and maintain separate logbook register for services / maintenance of HVAC System. Record of work done for services/maintenance repairs etc. shall be recorded by vendor's engineer in this register. This register shall always be with updated records & shall be produced to customer's engineer on weekly basis or as & when required by him.
- ix. Vendor shall arrange and maintain sufficient stock of spares and consumable at site (HVAC room). Similarly, all necessary tools & instruments required for the purpose of servicing / maintenance / routine testing etc. shall also be arranged by vendor and should be available at site at all times.
- x. Repairs / servicing works shall normally be done by vendor at site up to maximum possible extent. However, in case any equipment or accessories is essentially required to be taken by vendor out of the plant premises for repairing / servicing, all necessary arrangements including to and fro transportation shall be the responsibility of vendor. Vendor shall also inform concerned customer's engineer for doing procedural formalities (like issue of gate pass etc.), prior to taking out the materials out of Plant premises.
- xi. In case bidder fails to supply the spares required for maintenance of the equipment, same shall be provided by BHEL at Bidders risk and cost.
- xii. Vendor shall be fully responsible for safety of his personal at all times. Vendor shall also be responsible for taking all safety precautions at all the times, especially during servicing / preventive maintenance and repairs of HVAC System equipment's etc.
- xiii. All the safety controls of AC Plant such as HP, LP, OP, Water pressure switch, inter locking etc. shall be positively checked at least once a month and same shall be recorded by vendor engineer
- xiv. Technicians & helpers engaged by the vendor shall wear uniform with nameplate for easy identification, while being within plant premises
- xv. Vendor's engineer shall be focal point for customer. He shall report to customer engineer on daily basis, for taking necessary instructions and to update the status of AC system
- xvi. If any damage to the equipment and its accessories has happened due to improper maintenance by bidder shall be recovered from the bidder.
- xvii. Bidder is to arrange all the safety gears like helmets, air plugs, safety shoes etc. during the maintenance for the O&M Staff.





**4X250 MW BRBCL NABINAGARTPP  
(FGD SYSTEM PACKAGE)  
HVAC SYSTEM  
CUSTOMER SPECIFICATIONS**


**SPECIFICATION No: PE-TS-463-(571-13000-A)-A001**

**SECTION : I**

**SUB-SECTION : C 2**

**REV. 00**


**SECTION: I  
SUB-SECTION: C 2  
CUSTOMER SPECIFICATIONS**


	<b>4X250 MW BRBCL NABINAGARTPP (FGD SYSTEM PACKAGE) HVAC SYSTEM CUSTOMER SPECIFICATIONS TECHNICAL REQUIREMENT</b>	SPECIFICATION No: PE-TS-463-(571-13000-A)-A001	
		SECTION : I	
		SUB-SECTION : C 2A	
		REV. 00	

## SECTION: I

### SUB-SECTION: C 2A


## CUSTOMER SPECIFICATIONS TECHNICAL REQUIREMENT


CLAUSE NO.	SCOPE OF SUPPLY & SERVICES			
1.00.00	<p><b>AIR CONDITIONING SYSTEM</b></p> <p>a) <b>General</b></p> <p>The scope includes Engineering, Supply, Construction, Erection, Testing and Commissioning for Complete Air conditioning system consisting of D-X units with refrigerant piping &amp; valves, Air handling units, Hi-wall split air conditioner /Cassette Air conditioners, Packaged Air Conditioners, Fresh air fans, air distribution system (ducting, filters, isolation dampers, motorized fire dampers, diffusers, grills, volume control dampers, etc.) etc., along with all electrical equipment and instrumentation as required for all the buildings which are in the scope of the bidder, as detailed out in Part-B of Section-VI.</p> <p>b) <b>Air-conditioning system for F.G.D Control Room Building</b></p> <p>Air cooled condensing units (D-X type) type air conditioners with AHU of suitable capacity with 100 % redundancy ( as per actual heat load calculation ) shall be provided .</p> <p>c) SO2 analyzer room (if required) and other air conditioned offices/areas covered under this package shall be provided with Ductable/Non ductable Split air conditioners etc. as per Design criteria specified in Chapter Salient Design Data. Non ductable Split air conditioner shall conform to minimum three (3) star (***) rating and above of latest version of Bureau of Energy Efficiency (BEE) HVAC code issued by Ministry of Power, Govt of India.</p> <p>d) Supply of Mandatory spares as specified.</p> <p>e) Any additional items required to make the system complete.</p> <p>f) For Air conditioning system, the Bidder shall provide all Instrumentation systems, accessories and associated equipment, which are included in Bidder's scope, in a fully operational condition acceptable to the Employer. The Bidder shall also provide all material, equipment and services which may not be specifically stated in the specifications but are required for completeness of the equipment/systems furnished by the Contractor and for meeting the intent and requirements of these specifications.</p> <p>h) Apart from the above, any area/building which are in the scope of the bidder and require air conditioning, the same shall be provided with air conditioning system, as detailed out in Part-B of Technical Specification.</p>			
<p>LOT 1A PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(1A)-2</p>	<p>SUB SECTION-III-A2 AIR CONDITIONING, VENTILATION SYSTEM &amp; COMPRESSED AIR SYSTEM</p>	<p>Page 1 of 4</p>	

CLAUSE NO.	SCOPE OF SUPPLY & SERVICES		
1.02.00	<p><b>Redundancies of equipments:</b></p> <p>100% standby unit shall be kept for FGD control room, SO2 analyzer room (if required) and other air conditioned offices/areas.</p>		
2.00.00	<p><b>VENTILATION SYSTEM</b></p> <p>a) <b>General</b></p> <p>The scope includes Engineering, Supply, Construction, Erection, Testing and Commissioning for Complete Ventilation system consisting of Modular type Unitary air filtration Units, Supply air fans, water pumps, exhaust air fans, louvers, filters, ducting, diffusers, piping, instrumentation etc., for all the buildings which are in the scope of the bidder, as detailed out in Part-B of Section-VI.</p> <p>b) <b>Non-A/C areas of F.G.D Control Room Building</b></p> <p><b>Minimum</b> One (1) nos. of Evaporative type Unitary Air Filtration (UAF) unit (of metallic construction- modular type) of suitable capacity with all accessories, DIDW centrifugal fan (1 x 100%), circulating water pump (1 x 100%), etc. as detailed out in technical specification shall be provided.</p> <p>c) <b>Miscellaneous areas:</b> All other areas like Limestone Grinding system building, Gypsum dewatering building, Recirculation pump &amp; Oxidation blower/compressor building etc &amp; all other non-air conditioned areas covered under this package shall be ventilated by a combination of supply/exhaust fans and fresh air in-take / back draft louvers. For ventilation of Battery rooms and Oil rooms, fans with flame proof motor shall be used. Further, toilets shall be provided with propeller type exhaust air fans.</p> <p>d) Supply of Mandatory spares as specified.</p> <p>e) Any additional items required to make the system complete.</p> <p>f) For Ventilation system, the Bidder shall provide all Instrumentation systems, accessories and associated equipment, which are included in Bidder's scope, in a fully operational condition acceptable to the Employer. The Contractor shall also provide all material, equipment and services which may not be specifically stated in the specifications but are required for completeness of the equipment/systems furnished by the Contractor and for meeting the intent and requirements of these specifications.</p>		
<p align="center">LOT 1A PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(1A)-2</p>	<p align="center">SUB SECTION-III-A2 AIR CONDITIONING, VENTILATION SYSTEM &amp; COMPRESSED AIR SYSTEM</p>	<p align="center">Page 2 of 4</p>


CLAUSE NO.	SCOPE OF SUPPLY & SERVICES			एनटीपीसी NTPC
3.00.00				
4.00.00	<p><b>General</b></p> <ul style="list-style-type: none"> <li>ii. Set of commissioning spares as may be required during erection and commissioning.</li> <li>iii. One (1) set Special tools and tackles required for maintenance of all the Mechanical, Electrical and C &amp; I equipment under the scope of bidder.</li> <li>iv. All steel / cast iron inserts, plates, bolts, nuts, sleeves, metallic-fasteners etc. to be grouted in concrete work and used to hold/ support the equipment/piping / ducting being supplied and erected under this specifications.</li> <li>v. Any additional items required to make the system complete.</li> <li>vi. Initial charge of all lubricants and grease, etc. Further, all consumables required for PG tests shall also be in Bidder's scope of supply. Grouting, dressing and final finishing of all foundations of various equipment, etc.</li> </ul>			
<p>LOT 1A PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>		<p>TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(1A)-2</p>	<p>SUB SECTION-III-A2 AIR CONDITIONING, VENTILATION SYSTEM &amp; COMPRESSED AIR SYSTEM</p>	<p>Page 3 of 4</p>


CLAUSE NO.	SCOPE OF SUPPLY & SERVICES		
	<p>vii. Repairing and making good/ sealing of cutouts / openings in floors, roofs and walls, for executing the works under this system and making them water tight as directed by the engineer.</p> <p>Corrosion protection painting for all equipment / items by Bidder as detailed in relevant clauses of technical specification.</p>		
<p>LOT 1A PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-A BID DOC. NO.:CS-0011-109(1A)-2</p>	<p>SUB SECTION-III-A2 AIR CONDITIONING, VENTILATION SYSTEM &amp; COMPRESSED AIR SYSTEM</p>	<p>Page 4 of 4</p>


CLAUSE NO.	SALIENT DESIGN DATA			
<p>7.00.00</p> <p>7.01.00</p>	<p><b>AIR CONDITIONING SYSTEM</b></p> <p><b>GENERAL REQUIREMENTS</b></p> <ol style="list-style-type: none"> <li>1. All equipments shall be located indoor unless otherwise agreed to by the Employer. The equipment and layout shall generally be in accordance with the General Layout Plant drawings.</li> <li>2. The layout of all equipment and accessories shall be developed in a way to facilitate easy accessibility and maintenance of all equipments.</li> <li>3. Each equipment shall be provided with suitable lifting arrangement, e.g. Lifting lugs, eye bolts, etc to facilitate maintenance.</li> </ol> <p><b>DESIGN PHILOSOPHY FOR AIR CONDITIONING</b></p> <ol style="list-style-type: none"> <li>1. Design ambient conditions for all air conditioning system shall be as per <b>Appendix-A</b></li> <li>2. All equipments of Air Conditioning system shall be designed for continuous duty.</li> <li>3. All air conditioned areas shall be maintained at 24 deg. C <math>\pm</math> (plus or minus) 1 deg. C and relative humidity of 50% <math>\pm</math> (plus or minus) 5%.</li> <li>4. The fresh air quantity for air-conditioned areas of FGD Control Room etc. shall be 0.45 M<sup>3</sup>/minutes/person or 1.5 air change per hour whichever is greater. Fresh air fan capacity shall be minimum 10% of the total CMH value of working indoor units.</li> <li>5. Lighting load shall be minimum 2 Watts/Sq. feet.</li> <li>6. The occupancy for general area shall be minimum one person per 10 Sq. M and for conference room the same shall be one per 3 Sq.M. In the equipment rooms etc, the occupancy may be one person per 25 Sq.M (Minimum).</li> <li>7. In Air conditioning system for FGD Control Room, return air shall be routed back to AHU room through plenum space.</li> <li>8. The supply and return air ducts shall be provided with automatic (motorised) fire dampers (of 90 minutes fire rating) at locations where ducts pass through walls &amp; floors. Operation of these dampers shall be interlocked with the fire alarm system and shall also be possible to operate manually from</li> </ol>			
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-V SALIENT DESIGN DATA &amp; SIZING</p>	<p>PAGE 11 OF 26</p>	


CLAUSE NO.	SALIENT DESIGN DATA			
	<p>the remote control panel. Required electrical contacts in control panel of A/C plant and further wiring upto fire alarm panels shall be done by Bidder.</p> <p>9. Soft water make up (if required) for complete air conditioning system shall be provided by the bidder in-line with terminal point specified in technical specification.</p> <p>10. Coil face area of Air Handling units shall be designed considering a face velocity of not more than 2.5 m/sec.</p> <p>11. Air distribution system shall be sized to have a constant frictional drop along its length and velocity through ducts shall not exceed 7.6 m/sec.</p> <p>12. Requirement of Underdeck Insulation (for A/C area) Underdeck insulation of 50 mm nominal thickness of glass wool (32 Kg/cu.m) or rock wool (48 Kg/cu.m) shall be provided if</p> <ul style="list-style-type: none"> <li>i) Non A/C area is located just above the A/C area. In this case, underdeck insulation shall be provided underneath of the ceiling of A/C area.</li> <li>ii) Non A/C area is located just below the A/C area. In this case, underdeck insulation shall be provided underneath of the ceiling of Non A/C area.</li> <li>iii) Underneath the ceiling of AHU room located below the A/C area or exposed to Atmosphere.</li> </ul> <p>13. AHU's shall be provided with two stage of filtration i.e. pre and fine filter. All fresh air supply shall also be filtered using pre and fine filter.</p> <p>14. A minimum design margin of ten (10) % shall be considered in design of A/C Plant Capacity for each area.</p> <p>15. For areas, where A/C load is of the order of 25-60 TR, Direct Expansion (D-X) type Condensing unit (with AHU) shall be provided depending on the availability of space/ layout etc. For areas, where A/C load is of the order of 15-25TR, ductable split/package A/C shall be provided. Smaller areas which are away from the D-X type Condensing unit /central chilling units which may require air conditioning upto 15 TR rating shall be served with Hi-wall Split/Cassette air conditioner units as per requirement.</p> <p>16. Insulation for supply and return air ducts: Supply and return ducts shall be insulated. All types of Insulation used for HVAC application shall be CFC/HCFC free.</p>			
7.02.00	<b>REDUNDANCY OF EQUIPMENTS</b>			
7.02.01	<p>Redundancy of various A/C system equipments shall be as follows:</p> <p><b>a) FGD Control Room Building</b></p> <ul style="list-style-type: none"> <li>i) Air Cooled condensing units Air conditioners: 4 Nos. (2W+2S)</li> <li>ii) AHU (with VVFD): 4 Nos. (2W+2S)</li> </ul>			
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-V SALAIENT DESIGN DATA &amp; SIZING</p>	<p>PAGE 12 OF 26</p>	



CLAUSE NO.	SALIENT DESIGN DATA												
7.03.00	<p>b) 100% standby shall be provided for area served by Cassette / Hi-wall Split /Ductable split AC/Package type air conditioners for all other control rooms covered in the scope of this package.</p> <p>c) Fresh air fans shall be 1 x 100 % Capacity for each AHU room.</p> <p><b>DESIGN PHILOSOPHY – Ventilation System</b></p> <p>1. Air changes per hour in evaporative/ mechanically ventilated areas shall be as follows:</p> <table border="0" data-bbox="423 562 1274 821"> <tr> <td>i) For all evaporative cooled areas</td> <td>-</td> <td>8</td> </tr> <tr> <td>ii) General areas</td> <td>-</td> <td>20</td> </tr> <tr> <td>iii) MCC / Switchgear rooms and Battery rooms&amp; other areas where gaseous fumes/ vapours are generated</td> <td>-</td> <td>30</td> </tr> </table> <p>2. However in areas producing lot of heat, temperature shall be the criteria as follows:-</p> <p>a) Inside temperature shall be minimum 3 deg.C below the design ambient temperature during summer for evaporative cooled areas.</p> <p>b) Inside Temperature shall be maximum 3 deg.C above the design ambient temperature during summer for mechanically ventilated areas.</p> <p><b>Note :</b> Dry bulb temperature during summer = 45 Deg C.</p> <p>The criteria which gives higher number of air changes/higher quantity of air of either of condition (Cl. 1 or 2) flow shall be selected.</p> <p>3. All ventilation systems shall operate on 100% fresh air. All mechanically ventilated areas shall be positively ventilated by means of supply air fans fitted with filters and exhaust fans for ventilation of heat generating areas combination of supply air fans with exhaust air fans shall be provided. MCC / switchgear and cable gallery areas shall be provided with gravity operated back draft dampers in association with supply air fans in order to maintain positive pressure. Battery rooms and other fumes/odour generating areas shall be negatively ventilated by means of exhaust air fans / roof exhausters and intake louvers. All other areas like pump house, Blower/compressor house (if any), etc shall be positively ventilated by a combination of supply air fan and exhaust air fan. Supply air fan catering for electrical areas (MCC &amp; Switchgear rooms) shall be provided with pre-filters and fine filters and for other areas shall be provided with pre-filter only. For Positive ventilation CFM of exhaust air shall be 60% of CFM required for supply air. Similarly for</p>			i) For all evaporative cooled areas	-	8	ii) General areas	-	20	iii) MCC / Switchgear rooms and Battery rooms& other areas where gaseous fumes/ vapours are generated	-	30	
i) For all evaporative cooled areas	-	8											
ii) General areas	-	20											
iii) MCC / Switchgear rooms and Battery rooms& other areas where gaseous fumes/ vapours are generated	-	30											
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p>SUB-SECTION-V SALAIENT DESIGN DATA &amp; SIZING</p>	<p>PAGE 13 OF 26</p>										

CLAUSE NO.	SALIENT DESIGN DATA			
	<p>negatively ventilated area, CFM of supply shall be 60% of total CFM exhaust.</p> <p>4. All the equipments of Ventilation system shall be designed for continuous duty.</p> <p>5. The supply air ducts of evaporative type ventilation system entering into switchgear room, cable galleries etc. shall be provided with automatic (motorised) fire dampers (of 90 minutes fire rating). Operation of these dampers shall be interlocked with the fire alarm system and shall also be possible to operate manually from the remote control panel. Required electrical contacts in control panel of A/C plant and further wiring upto fire alarm panels shall be done by Bidder.</p> <p>6. Circulating water Capacity for Air washer units shall be minimum 0.7 Cu.M/hr per 1000 Cu.M /hr of air flow. Velocity through piping shall be limited to 2.0 m/sec and for gravity flow the same shall be limited to 1.5 m/sec. Air distribution system shall be sized to have a constant frictional drop along its length and air velocity through ducts shall not exceed 12.5 m/sec.</p> <p>7. For pumps, continuous motor rating (at 50°C ambient) shall be atleast 10% above the maximum load demand of the pump in the entire operating range. For fans, compressors and blowers continuous motor rating (at 50°C ambient) shall be atleast 10% above the maximum load demand at the design duty point.</p> <p>8. Supply air fans, exhaust air fans &amp; ventilations of each area shall be provided with local starter panels.</p>			
<p align="center">LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</p>	<p align="center">SUB-SECTION-V SALIENT DESIGN DATA &amp; SIZING</p>	<p align="center">PAGE 14 OF 26</p>	

CLAUSE NO.	SALIENT DESIGN DATA			
<b>Appendix-A</b> Outside Design Ambient condition to be considered for Air Conditioning system and ventilation System for various project/station are as under.				
Location	Season	Dry Bulb Temp. (Deg. C)	Wet Bulb Temp. (Deg. C)	
Kudgi Stg-I (3x800)	Summer	42.0	21.6	
	Monsoon	32.6	26.6	
	Winter	16.2	12.4	
LARA Stg-I (2x800)	Summer	44.0	25.5	
	Monsoon	31.0	27.7	
	Winter	12.2	6.6	
Gadarwara Stg-I (2x800)	Summer	44.0	25.5	
	Monsoon	31.0	27.0	
	Winter	12.2	6.6	
Darlipalli Stg-I (2x800)	Summer	43.0	27.0	
	Monsoon	34.0	28.0	
	Winter	11.0	5.0	
Mouda Stg-II (2x660)	Summer	43.5	25.5	
	Monsoon	38.0	27.5	
	Winter	15.0	10.0	
Solapur	Summer	43.5	25.5	
<b>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</b>	<b>TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2</b>	<b>SUB-SECTION-V SALIENT DESIGN DATA &amp; SIZING</b>	<b>PAGE 15 OF 26</b>	

CLAUSE NO.	SALIENT DESIGN DATA			
	STg-I (2x660)	Monsoon	38.0	27.5
		Winter	15.0	10.0
	Tanda-II STG-II (2x660)	Summer	44.0	23.5
Monsoon		34.0	28.5	
Winter		8.0	7.0	
Nabinagar JV STG-I (2x660)	Summer	45.0	25.0	
	Monsoon	34.0	28.0	
	Winter	5.0	2.0	
Meja JV STG-I (2x660)	Summer	44.0	23.5	
	Monsoon	34.0	28.5	
	Winter	8.0	7.0	
Barh Stg-I (3x660)	Summer	43.0	27.5	
	Monsoon	38.0	29.5	
	Winter	7.0	5.8	
Nabinagar JV (RLY) Stg-I (4x250)	Summer	45.0	25.0	
	Monsoon	38.0	28.0	
	Winter	5.0	2.0	
Rihand STG-II&III (2x500)	Summer	43.9	25.6	
	Monsoon	35	28.9	
<b>LOT-IA PROJECTS</b> <b>FLUE GAS DESULPHURISATION (FGD)</b> <b>SYSTEM PACKAGE</b>	<b>TECHNICAL SPECIFICATION</b> <b>SECTION-VI, PART-A</b> <b>BID DOCUMENT NO.: CS-0011-109(1A)-2</b>	<b>SUB-SECTION-V</b> <b>SALIENT DESIGN</b> <b>DATA &amp; SIZING</b>	<b>PAGE 16 OF 26</b>	




**SUB-SECTION-I-M2**


**AIR CONDITIONING & VENTILATION SYSTEM**

**LOT-IA PROJECTS  
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE**


**TECHNICAL SPECIFICATION  
SECTION-VI  
BID DOCUMENT NO.: CS-0011-109(1A)-2**


CLAUSE NO.	TECHNICAL REQUIREMENTS		
1.00.00	<b>GENERAL</b>		
1.01.00	<p>This section of specification covers details of system specifications, detailing the areas to be air conditioned, basis of design, brief description of the system, equipment and services to be furnished by bidder.</p> <p>The Design, Engineering, Supply, Construction, Erection, and Testing &amp; Commissioning of all the equipments &amp; works listed here shall be on the basis of single point responsibility in bidder's scope of work for satisfactory completion of the system in all respect.</p>		
2.00.00	<b>AREAS TO BE AIR CONDITIONED</b>		
2.01.00	<p>The areas to be air-conditioned shall be as follows:</p> <p>a) Air cooled condensing units (D-X type) type air conditioners with AHU of suitable capacity with 100 % redundancy ( as per actual heat load calculation ) shall be provided for each FGD Control room building</p> <p>b) Cassette and Hi-wall Air-conditioners for Other auxiliary control room /control room buildings not listed above but covered in the scope of Bidder.</p>		
3.00.00	<b>AREAS TO BE VENTILATED</b>		
3.01.00	<p>(i) Unitary Air Filtration (UAF) units of min. capacity as mentioned in BOQ shall be provided for Non-Air Conditioned areas of FGD control building (e.g. Switchgear Rooms, Cable galleries etc.)</p> <p>(ii) Mechanical Ventilation (using Roof extractors/ Supply and/or Exhaust fans) shall be provided for various other areas/buildings in the scope of bidder as under:</p> <p>a) Grinding system building</p> <p>b) Gypsum dewatering building</p> <p>c) Recirculation pump &amp; Oxidation blower/compressor building.</p> <p>(iii) Toilets etc in above building (i) &amp; (ii). Any other area not listed above but covered in the scope of Bidder.</p> <p>iv) For other miscellaneous areas/ buildings not listed above but covered in the scope of Bidder, mechanical type ventilation system using Supply and/or exhaust air fans/ roof exhausters shall be provided.</p>		
3.02.00	All non-air conditioned areas covered under this package shall be ventilated by a combination of supply/exhaust fans and fresh air in-take / back draft louvers as detailed below:		
<p align="center">LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</p>	<p align="center">SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</p>	<p align="center">Page 1 of 26</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS															
	<table border="1"> <thead> <tr> <th data-bbox="477 205 558 275">S.No</th> <th data-bbox="558 205 964 275">Area</th> <th data-bbox="964 205 1414 275">Type of Ventilation system</th> </tr> </thead> <tbody> <tr> <td data-bbox="477 275 558 380">(i)</td> <td data-bbox="558 275 964 380">General area like pump house, buildings etc</td> <td data-bbox="964 275 1414 380">Combination of Supply air fan &amp; Exhaust air fans</td> </tr> <tr> <td data-bbox="477 380 558 485">(ii)</td> <td data-bbox="558 380 964 485">MCCs and Switchgear room etc</td> <td data-bbox="964 380 1414 485">Supply air fan &amp; Back draft dampers</td> </tr> <tr> <td data-bbox="477 485 558 621">(iii)</td> <td data-bbox="558 485 964 621">Battery rooms &amp; Oil rooms and fumes/odor generates</td> <td data-bbox="964 485 1414 621">Combination of Supply air fan &amp; Exhaust air fans. Motors shall be flame proof.</td> </tr> <tr> <td data-bbox="477 621 558 695">(iv)</td> <td data-bbox="558 621 964 695">Toilet/pantry etc</td> <td data-bbox="964 621 1414 695">Propeller type exhaust air fan</td> </tr> </tbody> </table>	S.No	Area	Type of Ventilation system	(i)	General area like pump house, buildings etc	Combination of Supply air fan & Exhaust air fans	(ii)	MCCs and Switchgear room etc	Supply air fan & Back draft dampers	(iii)	Battery rooms & Oil rooms and fumes/odor generates	Combination of Supply air fan & Exhaust air fans. Motors shall be flame proof.	(iv)	Toilet/pantry etc	Propeller type exhaust air fan
S.No	Area	Type of Ventilation system														
(i)	General area like pump house, buildings etc	Combination of Supply air fan & Exhaust air fans														
(ii)	MCCs and Switchgear room etc	Supply air fan & Back draft dampers														
(iii)	Battery rooms & Oil rooms and fumes/odor generates	Combination of Supply air fan & Exhaust air fans. Motors shall be flame proof.														
(iv)	Toilet/pantry etc	Propeller type exhaust air fan														
4.00.00	<b>EQUIPMENT DESCRIPTION – AIR CONDITIONING SYSTEM</b>															
4.01.00	<p data-bbox="391 789 894 821"><b>Condensing Unit (Air-Cooled D-X type)</b></p> <p data-bbox="391 852 602 884">Condensing unit</p> <p data-bbox="391 915 1016 947">Type : Air cooled scroll type</p> <p data-bbox="391 978 1398 1041">Vibration isolators : Steel spring / Neoprene rubber cushy foot type with isolation efficiency not less than 85%.</p> <p data-bbox="391 1073 553 1104">Compressor</p> <p data-bbox="391 1136 1398 1230">Type : The Compressor shall be scroll, serviceable, either hermetic type or semi-hermetic type with automatic capacity control (minimum 3 steps).</p> <p data-bbox="391 1262 1211 1293">Type of drive : Motor driven, direct or through V-belt.</p> <p data-bbox="391 1325 1398 1388">Refrigerant : The refrigerant shall be R-134a/ R-410A/R-407C or any other environment friendly refrigerant.</p> <p data-bbox="391 1419 1398 1619">Accessories : High/Low pressure cutouts, oil pressure switches, relief valves, pressure gauges at each stage, lube oil and control oil pressure gauges, suction &amp; discharge stop valves, Muffler, Crank case heaters, oil filters, magnetic oil separators, temperature indicators for lube oil/heaters, oil level indicators, safety thermostat for crank case heater, vibration isolators, etc.</p> <p data-bbox="391 1650 1398 1734">Motor Rating : 10% more than the power required by the compressor at 50 deg C design ambient temperature.</p>															
<p data-bbox="228 1881 634 1955">LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p data-bbox="691 1860 1000 1944">TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</p>	<p data-bbox="1040 1881 1243 1944">SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</p>	<p data-bbox="1308 1881 1382 1923">Page 2 of 26</p>													


CLAUSE NO.	TECHNICAL REQUIREMENTS 		
	Capacity : Minimum capacity shall be suitable for the identified/selected at evaporating temperature and condensing temperature and shall be indicated.		
4.02.00	<b>Air Handling Unit (AHU)</b>		
4.02.01	Each AHU shall consist of casing, fan impeller section, cooling coil section, damper section, steel frame with anti vibration mountings (AVMs) having minimum 85% vibration dampening efficiency and flame retardant, water proof neoprene impregnated flexible connection on fan discharge. Isolation dampers at the suction and discharge of each AHU shall be provided, in case return air duct is directly connected to AHU. However, in case AHU room is used for return air, isolation dampers are required to be provided only at AHU discharge of each AHU. Pre-filter at the suction and fine (micro-vee type) and absolute (HEPA type) filters (wherever applicable) at the discharge of each individual AHU, and heater section in the common discharge of AHUs shall be provided.		
4.02.02	The casing of AHUs shall be of double skin construction. Double skin sandwich panels (inside and outside) shall be fabricated using minimum 0.63 mm (24g) galvanized steel sheet (thickness of galvanization as per manufacturer's standard) , with 25mm thick polyurethane foam insulation of minimum 38 Kg/Cum density in between. Suitable reinforcements shall be provided to give structural strength to prevent any deformation/buckling.		
4.02.03	Sloping condensate drain pan shall be made of minimum 1.2 mm thick Stainless Sheet Steel. It shall be isolated from bottom floor panel through 25mm thick heavy duty treated for Fire (TF) quality expanded polystyrene or polyurethane foam. Drain pan shall extend beyond the coil.		
4.02.04	Cooling coil (min. 4 row deep) shall be made of seamless copper tubes with aluminium fins firmly bonded to copper tubes and shall be provided with suitable drains and vents connections.		
4.02.05	All filter plenum shall be provided with a walking platform inside the plenum chamber for filter cleaning purpose. Inspection door shall be provided at the plenum chamber and a removable type ladder shall be attached to plenum.		
4.02.06	<b>Centrifugal fan for AHU</b> <ul style="list-style-type: none"> <li>a) Fan Type : Double Width Double Inlet (DWDI) Centrifugal Type</li> <li>b) Fan impeller : Backward curved blades</li> <li>c) Casing material : GI /Mild steel with minimum thickness of 3 mm.</li> <li>d) Impeller material : Carbon steel</li> <li>e) Shaft : EN 8 Steel</li> </ul>		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 3 of 26





CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p>f) Fan bearings : Self aligning type, permanently lubricated, heavy duty with a design life of 10,000 operating hours.</p> <p>g) Critical speed : First critical speed of rotating assembly shall be at least 25% above the operating speed.</p> <p>h) Drive : Motor driven with removable belt guard. Motor driven with removable belt guard. Motor rating (at 50 deg.C ambient) shall be atleast fifteen percent (15%) above the maximum load demand of drives at the design duty point.</p> <p>i) Fans : For AHUs of capacity 50,000 CMH and above, Bidder may offer two (2) Nos. centrifugal fans of equal capacity for each AHU provided all such AHUs are accommodated within the space identified by the Employer.</p>		
4.02.07	<p><b>Mixing Box:</b></p> <p>Mixing box shall be complete with fresh and return air dampers. Mixing box shall be provided whenever the return air is ducted back to the AHU. Further, wherever return air is led back directly to AHU room, no mixing box is required.</p>		
4.02.08	<p><b>Pan Humidifier:</b></p> <p>Pan humidifier shall be made of 22 gauge SS 304 tank, duly insulated with 25 mm thick resin bonded fiber glass insulation (min. 24 Kg/m<sup>3</sup> density) with 0.5 mm GSS cladding. The humidifier shall be complete with stainless steel immersion heaters, safety thermostat, float valve with stainless steel ball, sight glass, overflow and drain connections, steam outlet nozzle and float switch. Step controller shall be provided for switching on / off heater banks as per system requirement.</p>		
4.03.00	<p><b>HI-WALL SPLIT/CASSETTE AIR-CONDITIONERS</b></p>		
4.03.01	<p>Hi-wall Split/cassette air conditioners shall in general consist of the following:</p> <p>i) Casing</p> <p>ii) Hermetically sealed rotary/scroll Compressor</p> <p>iii) Condenser and condenser cooling fan</p> <p>iv) Evaporator along with fan</p> <p>v) Cooling coil</p> <p>vi) Filters</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</p>	<p>SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</p>	<p>Page 4 of 26</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS		
4.03.02	<p>vii) Piping, valves, refrigerant strainer, etc.</p> <p>viii) Controls, instruments, control panel/starter panels.</p> <p>ix) Vibration isolator pads, etc as required.</p> <p>x) Refrigerant as per manufacturer practice.</p> <p>Indoor unit of Ceiling Mounted Cassette Type Unit (Multi Flow Type):</p> <p>The housing of the unit shall be powder coated galvanized steel. All the indoor units regardless of their difference in capacity should have same decorative panel size for harmonious aesthetic point of view.</p> <p>Unit shall have four way supply air grills on sides and return air grill in center.</p> <p>Each unit shall have high lift drain pump and very low operating sound.</p>		
4.04.00	<b>SPLIT/PACKAGED AIR CONDITIONERS</b>		
4.04.01	<p>Split/package air conditioners shall in general consist of following:</p> <ol style="list-style-type: none"> <li>I. Casing</li> <li>II. Compressor</li> <li>III. Condenser</li> <li>IV. Evaporator and condenser cooling fan</li> <li>V. Cooling Coil</li> <li>VI. Filters</li> <li>VII. Piping, Valves, refrigerant strainer etc.</li> <li>VIII. Control, instruments, control panel/starter panels.</li> <li>IX. Vibration isolator pads, ducting (if applicable) etc as required.</li> </ol>		
5.00.00	<b>EQUIPMENT DESCRIPTION - VENTILATION SYSTEM</b>		
5.01.00	<b>Unitary Air Filtration</b>		
5.01.01	<p>Each modular unitary air filtration shall consist of Casing, Tanks, Fans, Distribution plates, Moisture eliminator and water repellent type nylon filter with frame and support, Header and standpipe with support, Spray and flooding type nozzle. Screen type suction strainer, Pumps, Necessary controls &amp; Instrumentation, and all other required accessories.</p>		
5.01.02	<p>The housing/ casing of air washer unit shall be double skin construction. Double skin panels shall be made of 22G galvanized sheet on outer side and 20G galvanized sheet inside with 25mm thick polyurethane foam insulation of minimum 38 kg/cub. Mtr. Density in between. Frame work for section shall be joined together with soft</p>		
<b>LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</b>	<b>TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</b>	<b>SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</b>	<b>Page 5 of 26</b>

CLAUSE NO.	TECHNICAL REQUIREMENTS 		
	<p>rubber gasket in between to make the joints air tight. The entire fan section shall be mounted on rolled formed GSS channel frame work.</p>		
5.01.03	<p>The unitary air filtration tank shall be fabricated from MS plate of minimum 6 mm thick and inside and outside surface of the tank shall be spray galvanized (<b>minimum 60 microns DFT</b>). Minimum depth of the tank shall be 600 mm. Tank construction shall be such that the suction screen can be replaced while the unit is operating. Tank shall be provided with overflow, drain with valve, float valve makeup connection with a gate valve backup, quick fill connection with globe valve etc. The overflow pipe shall be connected to drain pipe after isolating valve on drain pipe.</p>		
5.01.04	<p>The distribution plate shall be fabricated out of 18G galvanized steel sheets &amp; galvanized steel angle supports with minimum 50% free area.</p>		
5.01.05	<p>Unitary air filtration shall be one-bank construction. All header and stand pipes shall be galvanized. Cat walks of suitable width shall be provided for maintenance of nozzle, filter etc.</p>		
5.01.06	<p>The spray nozzles shall be of brass or bronze with chrome plating and shall be self cleaning type. The nozzle shall be designed to produce fine atomised spray and shall be properly spaced to give a uniform coverage of the air washer section. The pressure drop through the nozzle should be in the range of 1.4 to 2.4 Kg/cm<sup>2</sup>.</p>		
5.01.07	<p>The eliminator plates shall be of 24G thick GS sheets class 275 or from 100% virgin PVC of minimum finished thickness of 2 mm. The eliminator section made of GSS shall have minimum six bends. The PVC eliminators shall be UV stabilised using Titanium di-oxide and shall withstand the weathering test as per IS:4892 for 500 hrs. Type test report of the compound testing carried out in any reputed laboratory shall be submitted for approval. All supports, tie rods and space bar shall be of either galvanized steel or PVC construction and shall be complete with suitable drip tray and drain pipe.</p>		
5.01.08	<p>Air tight inspection doors of suitable size shall be provided for suction chamber. Spray chamber and fan suction for easy accessibility and maintenance and a water marine light be provided for each unitary air filtration.</p>		
5.01.09	<p>Suitable number of brass screen shall be provided in the air washer tank to arrest the dirt entering the circulating water pump suction. Suitable GI grid shall be used inside the screen for reinforcement.</p>		
5.01.10	<p>The specification for centrifugal fans shall generally be as indicated below. However, the fan shall be of DIDW type for UAF unit.</p>		
5.01.11	<p>Saturation efficiency of Unitary Air Filtration units shall be minimum 60%.</p>		
5.02.00	<p><b>Centrifugal Fan</b></p>		
5.02.01	<p>The casing shall be of welded construction fabricated with heavy gauge galvanized sheet steel or MS sheet with spray galvanization (<b>minimum 60 micron DFT</b>). The minimum thickness of casing shall be 3 mm. It shall be rigidly reinforced and supported by structural angles. The seams shall be permanently sealed air-tight. Split casings shall be provided on larger sizes of fans. Casing drain with valves shall be provided wherever required.</p> <p>The impeller shall have die-formed backward-curved blades tie welded to the rim and back plate to have a non overloading characteristic of the fan. Rim shall be spun to have a smooth contour. If required intermediate stiffening rings shall be</p>		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 6 of 26

CLAUSE NO.	TECHNICAL REQUIREMENTS 		
	<p>provided. Shaft sleeves shall be furnished wherever required. The impeller, pulley and shaft sleeves shall be secured to the shaft by key and/or nuts.</p>		
5.02.02	<p>The bearing shall be self aligning, heavy duty ball, roller or sleeve bearing. They shall be adequately supported. They shall be easily accessible and lubricated properly from outside.</p>		
5.02.03	<p>Inlet guard shall be spun to have a smooth contour. Inlet screen, if provided, shall be of galvanised wire mesh of 25 mm square.</p>		
5.02.04	<p>Base plate with necessary number of spring type vibration isolators or ribbed neoprene rubber pad or cushy foot mounting shall be provided. The vibration isolators should have a minimum of 70% efficiency.</p>		
5.02.05	<p>The first critical speed of the rotating assembly shall be at least 25% above the opening speed.</p>		
5.02.06	<p>The fans shall be provided with V-belts and sheaves. All belts shall be sized for 150% rated HP. All V-belt shall be equipped with removable belt guards that do not impede the air flow to the fan inlet. There shall be a minimum of two belts per drive. Motor rating (at 50 deg.C ambient) shall be atleast fifteen percent (15%) above the maximum load demand of drives at the design duty point.</p>		
5.03.0	<p><b>Roof Ventilators (If applicable)</b></p>		
5.03.01	<p>The roof extractors shall be "COWL" type.</p>		
5.03.02	<p>Impeller shall be of axial flow type, cast Aluminium in one piece and dynamically balanced. Casing shall be heavy gauge sheet steel construction of 3 mm thick for impeller upto 750 mm diameter and 5 mm for fans with impeller of diameter 750 and above. In casing, access door with locking arrangement be provided.</p>		
5.03.03	<p>The cowl shall be designed for weather protection of the fan also inside of the roof on which the extractor is installed. Galvanised bird screen of 15 mm Square be provided with the cowl. All accessories, steel supports as required will be provided.</p>		
5.03.04	<p>The speed of the fan be limited as per limitation given above for axial fans.</p>		
5.03.05	<p>All accessories rain protection exhaust hood, transformation piece, vibration isolators, steel supports vibration isolators, bird screen, etc. as required shall be provided.</p>		
5.03.06	<p>The vibration level for fans shall be as per ISO: 14694.</p>		
5.04.00	<p><b>Centrifugal Pumps</b></p> <p>a) Type : Horizontal Centrifugal, Axially or radial split type casing pump or end suction, top discharge horizontal centrifugal pump</p> <p>b) Impeller : Closed type</p> <p>c) Material of Construction</p> <p>i) Casing : 2% Ni Cast Iron : IS:210 Gr. FG-260</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</p>	<p>SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</p>	<p>Page 7 of 26</p>


CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<ul style="list-style-type: none"> <li>ii) Impeller : Bronze IS:318 Gr-2</li> <li>iii) Wearing rings : Bronze</li> <li>iv) Shaft : SS 316</li> <li>v) Shaft sleeve : SS 316</li> <li>vi) Lantern ring : Brass / Bronze</li> <li>vii) Packing : Asbestos free</li> <li>viii) Base Plate : Carbon steel as per IS:2062</li> <li>ix) Speed : Maximum 1500 rpm</li> <li>x) Other requirements : To refer to <b>Annexure-I</b> titled "Horizontal Pumps" of this sub section.</li> </ul>		
<b>5.05.0</b>	<b>Axial Fans</b>		
5.05.01	These fans shall have fixed / variable pitch cast aluminum blades of aerofoil design.		
5.05.02	The fan casing shall be of heavy gauge sheet steel construction.		
5.05.03	Necessary rain protection cowl, inlet and outlet cones, bird protection screen, adjustable damper, vibration isolators, back draft dampers etc. shall be provided.		
5.05.04	The speed of the fan shall not exceed 960 rpm for fan with impeller diameter above 450 mm and 1400 rpm for fan with impeller diameter 450 mm or less. However for fans having static pressure of 30 mm WC or above the speed of the fan shall not exceed 1440 rpm for fan with impeller diameter of above 450 mm and 2800 rpm for fan with impeller diameter of 450 mm or less. The first critical speed of rotating assembly shall be atleast 25% above the operating speed.		
5.05.05	All other accessories like supporting structure etc. as required shall be provided.		
5.05.06	Fans of capacity 1000 m <sup>3</sup> /hr & lower shall be of propeller exhaust type.		
<b>6.00.00</b>	<b>BALANCE EQUIPMENT SPECIFICATION</b>		
6.01.00	<b>Material of Construction for Piping &amp; Fittings</b>		
	<ul style="list-style-type: none"> <li>a) Piping for Chilled and Condenser water lines : Heavy grade-IS:1239 or Equivalent upto150 NB and IS:3589 or Equivalent for pipes beyond 200 NB with thickness as indicated in <b>Annexure-II</b></li> <li>b) Refrigerant piping : Seamless steel tubes conforming heavy grade IS:1239 or copper tubes as per IS:2501 (copper material as per IS:191 hard copper grade).</li> <li>c) Drain piping : Same as (a) above &amp; galvanized as per IS:4736.</li> </ul>		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 8 of 26


CLAUSE NO.	TECHNICAL REQUIREMENTS 		
	<p>d) Fittings : 1) The steel fittings shall conform to ASTM A234 Gr. WPB and dimensional standard to ANSI B 16.9/ANSI B16.11 / equivalent for sizes 65 NB and above.</p> <p>2) For sizes 50 NB and below, the material shall conform to ASTM A-105.</p> <p>3) All steel flanges shall be of slip on type and shall conform to ANSI B 16.5</p> <p>4) For pipe sizes above 350 NB, fabricated fittings from sheets of adequate thickness may be used. The bend radius in case of mitre bends shall be minimum 1.5 times the nominal pipe diameter and angle between two adjacent sections shall not be more than 22.5 deg and shall be as per BS:2633/BS:534.</p> <p>5) Fittings, flanges and pipe joints of refrigerant piping shall conform to ANSI B31.5</p>		
6.02.00	<b>VALVES</b>		
6.02.01	Valves shall have full sizes port and suitable for horizontal and as well as vertical installation.		
6.02.02	Valves for regulating duty shall be of globe type suitable for controlling throughout its lift.		
6.02.03	All safety /relief valves shall be so constructed that the failure of any part does not obstruct the free discharge.		
6.02.04	Valves shall be furnished with back seating arrangement for repacking while working under full working pressure.		
6.02.05	Manual gear operators be provided for valves of size 200 NB and above.		
6.02.06	All valves shall be supplied with companion flanges, nut, bolts & washers, etc.		
6.02.07	The refrigerant line valves shall have steel or brass body with TEFLON gland packing. The construction of disc shall be either globe or angle type. The valve seat shall have white metal lining or equivalent.		
6.02.08	Gate valves shall be of Cast Iron body (confirming to IS:210 Gr FG 220/equivalent) for sizes 65 NB and above conforming to fIS :14846. Gun Metal construction for sizes less than 65NB shall be as per IS:778. Butterfly valves shall conform to latest revision of BS:5155 or equivalent standard of required class/rating.		
6.03.00	<b>AIR FILTERS</b>		
6.03.01	<p><b>Pre Filter</b></p> <p>1) Type : Flange / Cassette</p> <p>2) Pre-filter shall contain washable non-woven synthetic fiber or High density Polyethylene (HDPE) media having 18G GSS / 16G Al alloy frame. The filter media shall be supported with HDPE mesh on air inlet side &amp; Aluminium</p>		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 9 of 26


CLAUSE NO.	TECHNICAL REQUIREMENTS 		
6.03.02	<p>expanded metal on exit side or G.I. wire mesh on both sides.</p> <p>3) <b>Other requirements : (as applicable)</b></p> <p>a) Suitable aluminium spacers be provided for uniform air flow;</p> <p>b) Casing shall be provided with neoprene sponge rubber sealing.</p> <p>c) Capable of being cleaned by water flushing.</p> <p>d) Density of filter medium shall increase in the direction of air flow in case of metallic filter.</p> <p>e) Filter media shall be fire retardant and resistant to moisture, fungi, bacteria &amp; frost.</p> <p>4) <b>Efficiency :</b></p> <p>Average arrestance of 65 - 80 % when tested in accordance with BS:6540/ASHRAE – 52 – 76 / EN-779.</p> <p>5) Minimum thickness : 50 mm</p> <p>6) Face Velocity : Not more than 2.5 m/sec.</p> <p>7) Pressure drop : Initial pressure drop - Not to exceed 5.0 mm WC at rated flow. Final pressure drop - Upto 7.5 mm WC.</p> <p>8) Location : a) At the suction of each AHUs : b) At the suction of each Fresh air fan</p> <p><b>Fine Filters (Microvee type)</b></p> <p>1) Type : Flange / Cassette</p> <p>2) Fine filter shall contain washable non-woven synthetic fibre or High density Polyethylene (HDPE) media having 18G GSS / 16G Al alloy frame. The filter media shall be supported with HDPE mesh on air inlet side &amp; Aluminium expanded metal on exit side or G.I. wire mesh on both sides.</p> <p>3) Other requirements : a) A neoprene sponge rubber sealing shall be provided on either face of the filter frame. b) Capable of being cleaned by air or water flushing. c) Filter media shall be fire retardant and resistant to moisture, fungi, bacteria &amp; frost.</p>		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 10 of 26


CLAUSE NO.	TECHNICAL REQUIREMENTS																		
	<div style="text-align: right; border: 1px solid black; padding: 2px; width: fit-content; margin: 0 auto;"><b>एनडीपीसी NTPC</b></div> <p>4) Efficiency : Average arrestance &gt; 90% when tested in accordance with BS:6540/ASHRAE-52-76 / EN-779.</p> <p>5) Minimum thickness : 150 mm or 300 mm.</p> <p>6) Face Velocity : Not more than 1.2 m/sec for 150 mm and not more than 2.4 m/sec. for 300 mm.</p> <p>7) Pressure drop : Initial pressure drop - Not to exceed 10 mm WC at rated flow ; Final pressure drop-Up to 25 mm WC.</p> <p>8) Location : i) At the discharge of each individual AHU. ii) At the discharge of each Fresh air fan.</p>																		
6.04.00	<b>LOW PRESSURE AIR DISTRIBUTION SYSTEM</b>																		
6.04.01	Material of air distribution system shall be through galvanized steel sheet (Conforming to Class 275 of IS :277) or Aluminium alloy (grade 19000 / SIC or 3100 / NS3 of IS:737). GI Sheets should be galvanized and galvanizing shall be of 275 gms/sq.m. (total coating on both sides) both for site fabricated and factory fabricated ducts.																		
6.04.02	<p><b>Thickness of rectangular ducts shall be as follows:</b></p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="text-align: left;">Larger Dimension of duct (mm)</th> <th style="text-align: center;">Thickness of GI sheet(mm)</th> <th style="text-align: center;">Thickness of Aluminium sheet (mm)</th> </tr> </thead> <tbody> <tr> <td>up to 750 mm</td> <td style="text-align: center;">0.63 (24 G)</td> <td style="text-align: center;">0.80</td> </tr> <tr> <td>751 to 1500</td> <td style="text-align: center;">0.80 (22 G)</td> <td style="text-align: center;">1.00</td> </tr> <tr> <td>1501 to 2250</td> <td style="text-align: center;">1.00 (20 G)</td> <td style="text-align: center;">1.50</td> </tr> <tr> <td>2251 &amp; above</td> <td style="text-align: center;">1.25 (18 G)</td> <td style="text-align: center;">1.80</td> </tr> </tbody> </table>	Larger Dimension of duct (mm)	Thickness of GI sheet(mm)	Thickness of Aluminium sheet (mm)	up to 750 mm	0.63 (24 G)	0.80	751 to 1500	0.80 (22 G)	1.00	1501 to 2250	1.00 (20 G)	1.50	2251 & above	1.25 (18 G)	1.80			
Larger Dimension of duct (mm)	Thickness of GI sheet(mm)	Thickness of Aluminium sheet (mm)																	
up to 750 mm	0.63 (24 G)	0.80																	
751 to 1500	0.80 (22 G)	1.00																	
1501 to 2250	1.00 (20 G)	1.50																	
2251 & above	1.25 (18 G)	1.80																	
6.04.03	<p><b>Thickness of round ducts shall be as follows:</b></p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="text-align: left;">Diameter of Round duct (mm)</th> <th style="text-align: center;">Thickness of GI sheet(mm)</th> <th style="text-align: center;">Thickness of Aluminium sheet (mm)</th> </tr> </thead> <tbody> <tr> <td>150 to 500</td> <td style="text-align: center;">0.63</td> <td style="text-align: center;">0.80</td> </tr> <tr> <td>501 to 750</td> <td style="text-align: center;">0.80</td> <td style="text-align: center;">1.00</td> </tr> <tr> <td>751 to 1000</td> <td style="text-align: center;">0.80</td> <td style="text-align: center;">1.00</td> </tr> <tr> <td>1001 to 1250</td> <td style="text-align: center;">1.00</td> <td style="text-align: center;">1.50</td> </tr> <tr> <td>1251 &amp; above</td> <td style="text-align: center;">1.25</td> <td style="text-align: center;">1.80</td> </tr> </tbody> </table>	Diameter of Round duct (mm)	Thickness of GI sheet(mm)	Thickness of Aluminium sheet (mm)	150 to 500	0.63	0.80	501 to 750	0.80	1.00	751 to 1000	0.80	1.00	1001 to 1250	1.00	1.50	1251 & above	1.25	1.80
Diameter of Round duct (mm)	Thickness of GI sheet(mm)	Thickness of Aluminium sheet (mm)																	
150 to 500	0.63	0.80																	
501 to 750	0.80	1.00																	
751 to 1000	0.80	1.00																	
1001 to 1250	1.00	1.50																	
1251 & above	1.25	1.80																	
<b>LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</b>	<b>TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</b>	<b>SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</b>	<b>Page 11 of 26</b>																




CLAUSE NO.	TECHNICAL REQUIREMENTS		
6.04.04	<p><b>Duct Fabrication and Supports:</b></p> <p>a) Duct fabrication shall be as per the latest relevant BIS/SMACNA standard.</p> <p>b) Ducts for A/C system may be <b>site fabricated or factory fabricated</b>.</p> <p>c) The ducts routed inside the buildings with larger side greater than 2250 mm shall be supported by 16mm MS rods and 50x50x3 mm MS double Angles while those below 2250 mm shall be supported by 10mm MS Rods and 40x40x3 MS angles. The duct supports shall be at a distance of not more than 2000 mm for A/C system. The MS rods for these ducts routed inside the building shall be hung from the existing floor beams/wall beams/roof beams/columns with provision of necessary auxiliary or special steel members or by hooks or can be provided by dash fasteners fixed to the ceiling slab. No supports shall be taken from horizontal/vertical bracings of the structures. All items of duct support including MS rods, MS angles and double angles, auxiliary or special steel members, hooks, dash fasteners coach screws and all other supporting material required shall be provided by the bidder. Where ever ducts are running outside the building and or at locations where it is not possible to support the ducts from ceiling/floor due to non-availability of the same, the base steel frame/truss work and other auxiliary steel members, hooks, rods, etc. for supporting the duct work shall also be provided by the Bidder.</p> <p>d) Where the sheet metal duct connects to the intake or discharge of fan units a flexible connection of fire retarding, at least 150 mm width shall be provided of closely woven, rubber impregnated double layer asbestos/canvas or neoprene coated fibre glass.</p> <p>e) All curves, bends, off-sets and other transformations shall be made for easy and noiseless flow of air. The throat of every branch duct shall be sized to have the same velocity as in the main duct to which the branch duct is connected.</p> <p>f) Wherever duct passes through a wall, the opening between masonry and duct work shall be neatly caulked or sealed to prevent movement of air from one space to the adjoining space.</p> <p>g) Wherever pipe hangers or rods pass through the ducts, light and streamline easement around the same shall be provided to maintain smooth flow of air.</p> <p>h) Access doors shall be provided in the duct work or casing on the both sides of the equipment to be serviced. All access doors shall be of adequate size and shall be lined with substantial felt edging to prevent air leakage. Access doors shall be of built up construction, structurally strong and each shall have at least two hinges. Access doors shall have two rust proof window sash of approved type. All doors shall be set so as to flush with insulation or plaster finish on the duct.</p>		
6.04.05	<p>Splitters and dampers shall be provided for equipment/area isolation and for proportional volume control of system. The same shall be minimum 16 gauge GS</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</p>	<p>SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</p>	<p>Page 12 of 26</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS 															
6.04.06	<p>sheet of quadrant type with suitable locking device, mounted outside of duct in accessible position.</p> <p><b>Factory fabricated ducts :</b></p> <p>i) All ducting shall be fabricated of LFQ (Lock Forming Quality) grade prime G.I.</p> <p>ii) Unless otherwise specified here, the construction, erection, testing and performance of the ducting system shall conform to the SMACNA-1995 standards ("HVAC Duct Construction Standards-Metal and Flexible-Second Edition-1995" SMACNA)</p> <p>iii) All ductwork including straight sections, tapers, elbows, branches, show pieces, collars, terminal boxes and other transformation pieces must be factory fabricated by utilizing the machines and processes as specified in SMACNA or by equivalent technology. In equivalent method, the fabrication shall be done by utilizing the following machines and process to provide the requisite quality of ducts and speed of supply:</p> <p>a) Coil lines to ensure location of longitudinal seams at corners/folded edges only to obtain the required duct rigidity and low leakage characteristics. No longitudinal seams permitted along any face side of the duct.</p> <p>b) All ducts, transformation pieces and fittings to be made on CNC profile cutters for required accuracy of dimensions, location and dimensions of notches at the folding lines.</p> <p>c) All edges to be machine treated using lock formers, flangers and roll-bending for turning up edges.</p> <p>d) Sealant dispensing equipment should be used for applying built-in sealant in Pittsburgh lock where sealing of longitudinal joints are specified. Sealing of longitudinal joint is compulsory for the ducts over 2" w.g. static pressure</p> <p>iv) All transverse connectors shall be 4-bolt slip-on flange system with built-in sealant, if any. To avoid any leakage additional sealant shall be used.</p> <p>v) Factory fabricated ducts shall have the thickness of the sheet as follows:</p> <table border="1" data-bbox="459 1325 1170 1524"> <thead> <tr> <th>Sl.No.</th> <th>Size of Duct</th> <th>Sheet Thickness</th> </tr> </thead> <tbody> <tr> <td>i)</td> <td>upto 750 mm</td> <td>0.63 mm</td> </tr> <tr> <td>ii)</td> <td>751 mm to 1500 mm</td> <td>0.80 mm</td> </tr> <tr> <td>iii)</td> <td>1501 mm to 2250 mm</td> <td>1.00 mm</td> </tr> <tr> <td>iv)</td> <td>2251 mm and above</td> <td>1.25 mm</td> </tr> </tbody> </table>	Sl.No.	Size of Duct	Sheet Thickness	i)	upto 750 mm	0.63 mm	ii)	751 mm to 1500 mm	0.80 mm	iii)	1501 mm to 2250 mm	1.00 mm	iv)	2251 mm and above	1.25 mm
Sl.No.	Size of Duct	Sheet Thickness														
i)	upto 750 mm	0.63 mm														
ii)	751 mm to 1500 mm	0.80 mm														
iii)	1501 mm to 2250 mm	1.00 mm														
iv)	2251 mm and above	1.25 mm														
6.05.00	<p><b>Diffusers, Grills &amp; Dampers :</b></p>															
6.05.01	Supply air diffusers/grills with factory fitted volume control dampers be provided for all air-conditioned areas.															
6.05.02	Return air diffusers of air-conditioned areas shall be without volume control dampers.															
6.05.03	The diffusers/grills shall be of extruded Aluminum of minimum 1.2 mm thick with powder coating. The colour of power coating shall be as per the interior décor.															
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 13 of 26													


CLAUSE NO.	TECHNICAL REQUIREMENTS 		
6.05.04	Supply air grills shall be of double deflection type and return air grills shall be of single deflection type.		
6.05.05	All volume control (VC) damper shall be operated by a key from the front of the grills/diffusers and shall be of GI sheet.		
6.05.06	The thickness of VC dampers shall be of minimum 20 gauge and thickness of louvers shall be of minimum 22 gauge.		
6.05.07	Suitable vanes shall be provided in the duct collar to have uniform and proper air distribution. Bank of Baffles wherever required shall also be provided.		
6.05.08	Fire dampers shall be motor operated type and shall have fire rating of minimum 90 minutes.		
6.05.09	All plenum chambers of connections to fans, dampers etc shall be constructed in 18 gauge GS sheet and supported on MS angle frames.		
6.05.10	All ducting surfaces coming in contact with corrosive fumes or gases shall be painted with three coats of epoxy paint over a coat of suitable primer.		
6.06.0	<b>Thermal and Acoustic Insulation</b>		
6.06.01	<p><b>A) <u>Application with Glass Wool / Rockwool</u></b></p> <p>(i) All surfaces to be insulated both thermally and acoustically shall be thoroughly cleaned, dried and an adhesive (CPRX compound of Shalimar Tar Products / Loid bond 83 or Equivalent) be applied @ 1.5 Kg /Sqm on the surface.</p> <p>(ii) Insulation material (either expanded polystyrene foam or Glass Wool/ Glass fiber / Rockwool) shall be struck to the surface. All the joints shall be sealed with bitumen.</p> <p>(iii) Insulation mass to be covered with 500 gauge polythene sheet with 50 mm overlaps and sealing all joints on hot side or alternatively aluminum foil can be used which can come as lamination over insulation.</p> <p>(iv) Insulation Finish of types specified under shall be provided thereafter..</p> <p><b>B) <u>Application with Nitrile Rubber</u></b></p> <p>(i) All surfaces to be insulated shall be properly cleaned.</p> <p>(ii) A suitable adhesive such as SR 998 or equivalent shall be applied over the surfaces to be insulated and insulation material surfaces.</p> <p>(iii) Insulating material shall than be pasted onto the surfaces in a manner to avoid stretching and any air entrapment within.</p> <p>(iv) Two layers of Glass Cloth with a suitable adhesive as SR 998 or equivalent shall be then applied over the insulating material to avoid surface weathering.</p> <p><b>C) <u>Application with Polyurethane Foam &amp; Polyisocyanurate Foam</u></b></p> <p>i) All surfaces to be insulated shall be cleaned.</p>		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 14 of 26

CLAUSE NO.	TECHNICAL REQUIREMENTS					
6.06.02	ii) A suitable adhesive such as CPRX or Loid Bond 83 or equivalent shall be applied over the surface to be insulated and insulation material surfaces. iii) Insulating material with aluminum foil lamination shall then be pasted onto the surface in a manner to avoid stretching and any air entrapment within. iv) Two layers of Glass Cloth with a suitable adhesive as Loid Bond 130 shall be then applied over the insulating material, to avoid surface weathering. v) Insulation Finish of types specified under shall be provided thereafter. <b>Type of Insulation &amp; Finish</b>					
	<b>Sl. No.</b>	<b>Surface</b>	<b>Insulation Material</b>	<b>Insulation Form</b>	<b>Thick (mm)</b>	<b>Finish (mm)</b>
1.	Supply & return air duct of AC System	Resin bonded glass wool or	Roll /Slab	50	F-3	
		Closed Cell Elastomeric Nitrile Rubber	sheet	19	As per manufacturer std.	
		or Polyisocyanurate Foam	Slab	30	F-3	
2.	Refrigerant (Suction and liquid lines)	Closed Cell Elastomeric Nitrile Rubber	tube	19	As per manufacturer std.	
		or Rigid Polyurethane Foam	Pipe Section	50	F-1 (a)	
3.	AHU drain pipe	Closed Cell Elastomeric Nitrile Rubber	tube	19	As per manufacturer std.	
		or Rigid Polyurethane Foam	Pipe Section	50	F-1 (a)	
4.	AHU condensate pan (insulation if required)	Mineral wool or resin bonded glass wool	Slab	25	As per manufacturer std.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2		SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 15 of 26	


CLAUSE NO.	TECHNICAL REQUIREMENTS					<b>एनडीपीसी NTPC</b>
Sl. No.	Surface	Insulation Material	Insulation Form	Thick (mm)	Finish (mm)	
5.	Chilled water piping, valves & specialties	Resin bonded Mineral wool or resin bonded glass wool	Pipe section	75	F-1/F-3	
		or Rigid Polyurethane Foam	Pipe Section	50	F-3	
6.	Chiller (insulation if required)	----- As per manufacturer std.-----				
7.	Chilled water pumps	Resin bonded Rockwool wool or resin bonded glass wool	Slab	75	F-1/ F-3	
		or Rigid Polyurethane Foam	Slab	50	F-3	
8.	Expansion tank with associated piping	Resin bonded Rockwool wool or resin bonded glass wool	Slab/ Pipe section	75	F-1/ F-3	
		or Rigid Polyurethane Foam	Slab	50	F-3	
9.	Acoustic insulation of duct	Resin bonded Glass wool	Slab	25	As per specifications	
10.	Exposed air duct	Resin bonded Glass wool/Rockwool	Roll/Slab	50	F-4	
		or Polyisocyanurate Foam	Slab	50	F-4(a)	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2		SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 16 of 26	


CLAUSE NO.	TECHNICAL REQUIREMENTS			
6.06.03	<b>Specification for insulation shall be as follows: -</b>			
	<b>Insulation Material</b>	<b>Code</b>	<b>Thermal conductivity (w/m/°C)</b>	<b>Density Kg/m<sup>3</sup></b>
	Resin bonded glass wool	IS:8183	0.049 at 50°C  0.043 at 50°C	i) 24 (For Glass wool) ii) 48 (For Rockwool) iii) 48(For acoustic insulation)
	Mineral wool pipe section. Min.Gr.2	IS:9842	0.043 at 50°C	144
	Closed Cell Elastomeric Nitrile Rubber		0.036 at 20°C	40 – 60
	Polyurethane Foam	IS12436	0.03 at 50 °C	34 ± 2
	Polyisocyanurate Foam		0.03 at 50 °C	34 ± 2
	Note : Insulation used for HVAC application shall be CFC/HCFC free			
6.06.04	<b>The specification for various finishes shall be as follows</b>			
	<p>a) <b>Finish F-1 ( with Resin Bonded Glass Wool/Resin Bonded Mineral Wool)</b></p> <p><u>Step-1</u> Wrapping of Poly-Bonded Hessain (PBH – to act as vapour seal) on outer surface of insulation with 50 mm overlap stitching and sealing of overlap with synthetic adhesive like CPRX or Equivalent compound.</p> <p><u>Step-2</u> The surface then shall be wrapped with 19 mm mesh 24 SWG GI wire netting, butting all the joints and laced down with 22 SWG lacing wire.</p> <p><u>Step-3</u> Sand cement (4:1) plaster shall be applied in two layers totalling to 12.5 mm thick, the second layer being brought to a smooth finish. A water proofing compound shall be added to the cement before its application.</p>			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 17 of 26	


CLAUSE NO.	TECHNICAL REQUIREMENTS			एनडीपीसी NTPC
6.06.05	aa)	<b>Finish F-1(a) (With Polyurethane Foam &amp; Polyisocyanurate Foam)</b> Wrapping of two layers of 7 mil 10 x 10 mesh glass cloth dipped in suitable adhesive such as SR 998 or Loid Bond 130 equivalent		
	b)	<b>Finish F-2</b> <u>Step-1</u> Insulation shall be covered with 500g polythene with 50mm overlap and sealing of overlap with synthetic adhesive like CPRX/ Loid Bond 83 or Equivalent compound.		
		<u>Step-2</u> Same as Step-2 of Finish F-1 above.		
		<u>Step-3</u> Same as Step-3 of Finish F-1 above.		
	c)	<b>Finish F-3</b> <u>Step-1</u> Same as Step-1 of Finish F-2 above		
		<u>Step-2</u> The polythene shall be covered with 26 gauge Aluminium sheet and locking of joints with self-locking screws at a pitch of minimum 100 mm.		
	d)	<b>Finish F-4</b> <u>Step-1</u> Same as Step-1 of Finish F-1 above. <u>Step-2</u> Same as Step-2 of Finish F-1 above. <u>Step-3</u> Same as Step-3 of Finish F-1 above. <u>Step-4</u> Application of 3 mm thick coat of suitable water proofing compound and wrapped with fibre glass RP tissue followed by final coat of 3 mm thick water proofing compound over the RP tissue. <u>Step-5</u> After the above treatment, 22G Aluminium sheet cladding, properly stiched at all joints shall be provided over the external surface.		
	dd)	<b>Finish F-4(a) (With FR Closed Cell Chemically Cross Linked Polyethylene)</b> Application of aluminium sheet 22G cladding to be provided over the XLPE insulating material. Cladding sheet is held in position with SDST screws @ 150 mm C/c over tongue-in-groove joints applied with a felt for sealing joint against water ingress. All sheet joints to be done in a manner to shed water.		
	For all inspection covers and hatches on equipment, pump casing, valve bodies and flanges (100 mm and above), insulation shall be applied so as to facilitate removal without minimum damage to the insulation by encasing the insulation in 24 gauge GI box or 22 gauge Aluminium sheet metal boxes which are bolted together around the equipment. However continuity of the vapour seal between the static and removable portions of the insulation is to be maintained.			
	LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 18 of 26


CLAUSE NO.	TECHNICAL REQUIREMENTS		
6.06.06	<p><b>ACOUSTIC INSULATION</b></p> <p>a) All ducts up to a distance of 5 meters from AHU shall be acoustically lined from inside with 25 mm thick resin bonded glass wool of 48 Kg/Cu.M. density and 30 gauge perforated aluminium sheet having 5 mm dia perforation at 8 to 10 mm centre-to-centre distance. Insulation shall be fixed on wooden frame of 600 x 600 mm dimension.</p> <p>b) Fibre glass tissue sheet shall be applied over the outer surface of insulation before applying perforated aluminium sheet. Application of acoustic insulation shall be inline with the requirements specified above.</p>		
7.00.00	<p><b>PLANT CONTROL</b></p>		
7.01.00	<p>Brief scheme of controlling the operation is described below. Detailed description of the control system for safe and efficient operation of the plant shall be elaborated, got approved from employer. The descriptions in the sub-sections of the control &amp; instrument sections shall also be referred to.</p>		
7.02.00	<p><b>Control Scheme for Air-Conditioning System</b></p>		
7.02.01	<p>Contractor shall provide microprocessor/PLC/GIU based control system for control and monitoring of air conditioning and ventilation system as per manufacturer's standard practice. Control and monitoring of air conditioning and ventilation system from FGD <del>and ZLD</del> (as provided) control system is also acceptable.</p>		
7.03.00	<p><b>Air Handling Unit</b></p> <p>a) Humidity sensor and gysterstat located in the return air duct shall actuate the PAN humidifier to obtain the desired degree of humidification.</p> <p>b) Humidity and temp. sensor shall be provided and interlocked in steps with winter heater / re-heater / strip heaters for monsoon and winter re-heating or heating as the case may be.</p> <p>c) Heater banks shall be interlocked with the running of AHU, temperature of return air, humidity of return air and safety thermostat (airstat - located in front of the each heater in the supply air duct)</p> <p>d) AHU shall be started either locally or from the main control room of AC system by means of Remote / Manual selection facility.</p> <p>e) The closure of fire dampers, automatic tripping of AHU fans and fresh air fans shall be interlocked with Fire Detection System.</p>		
7.05.00	<p><b>Cassette /Hi-wall Split Air Conditioners</b></p> <p>Control and interlocks for these type of units shall be as per manufacturer's standard practice.</p>		
7.06.00	<p><b>Miscellaneous Control Requirements</b></p> <p>a) The fans (both supply and exhaust fans) associated with mechanical ventilation system shall be operated locally.</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</p>	<p>SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</p>	<p>Page 19 of 26</p>





CLAUSE NO.	TECHNICAL REQUIREMENTS 		
	b) Relative humidity and temperature measurement of all control rooms and all major air-conditioned areas shall made be available in FGD and ZLD (as provided) control system		
8.00.00	<b>PAINTING:</b>		
8.01.00	All the Equipments shall be protected against external corrosion by providing suitable painting.		
8.02.00	The surfaces of stainless steel, Galvanized steel, Gunmetal, brass, bronze and non-metallic components shall not be applied with any painting. The Contractor shall clean the external surfaces and internal surfaces before Erection by wire brushing and air blowing. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by brushing, shot blasting, etc. as per the agreed procedure.		
8.03.00	For all the steel surfaces (external) exposed to atmosphere (outdoor installation), one(1) coat of red oxide primer of thickness 30 to 35 microns followed up with three (3) coats of synthetic enamel paint, with 25 microns as thickness of each coat, shall be applied.		
8.04.00	For all the steel surfaces inside the building (indoor installation), One (1) Coat of red oxide primer of thickness 30 to 35 microns followed up with two (2) coats synthetic enamel paint, with 25 microns as thickness of each coat shall be applied.		
8.05.00	For centrifugal fans - Casing shall have hot dip/ spray galvanization ( <b>minimum</b> 60 micron DFT).		
8.06.00	However, for all parts coming in contact with acid fumes (in Battery rooms), a coat of epoxy resin based zinc phosphate primer of minimum thickness 30 to 35 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide of minimum thickness of 25 microns shall be applied and a top coat consisting of one coat of epoxy paint of approved shade and colour with glossy finish of minimum thickness of 25 microns.		
9.00.00	<b>CODES &amp; STANDARDS</b>		
9.01.00	The design, manufacture and performance of equipment shall comply with all currently applicable statues, regulations and safety codes in the locality where the equipments are to be installed. Nothing in this specification shall be considered to relieve the bidder of this responsibility.		
9.02.00	Unless otherwise specified, equipment shall conform to the latest applicable Indian or IEC standard. Equipment complying with other authoritative standards such as British, USA, ASHRAE etc. will also be considered if it ensures performance equivalent or superior to Indian Standard.		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 20 of 26

CLAUSE NO.	<div style="text-align: right;"></div> <b>TECHNICAL REQUIREMENTS</b>		
	<p style="text-align: right;"><b>Annexure –I</b></p> <p style="text-align: center;"><b>GENERAL SPECIFICATION FOR HORIZONTAL PUMPS</b></p> <p>1) <b>SCOPE</b> This specification covers the design, material, construction features, manufacture, inspection, testing the performance at the Vendor's/Sub-Vendor's Works and delivery to site of Horizontal Centrifugal Pumps.</p> <p>2) <b>CODES AND STANDARDS</b> The design, material, construction, manufacture inspection and performance testing of Horizontal Centrifugal Pumps shall comply with all currently applicable statutes, regulations and safety codes in the locality where the Equipment will be installed. Nothing in these specifications shall be construed to relieve the Vendor of this responsibility. The Equipment supplied shall comply with the latest applicable Indian Standards listed below. Other National Standards are acceptable, if they are established to be equal or superior to the Indian Standards.</p> <p>3) List of Applicable Standards. IS : 1520 : Horizontal Centrifugal Pumps for clear cold fresh water IS : 5120 : Technical requirements of roto dynamic special purpose pumps API : 610 : Centrifugal pumps for general refinery service. IS : 5639 : Pumps Handling Chemicals &amp; corrosion liquids IS : 5659 : Pumps for process water HIS : Hydraulic Institute Standards, USA ASTM-1-165-65 Standards Methods for Liquid Penetration Inspection. In case of any contradiction with aforesaid standards and the stipulations as per the technical specifications as specified hereinafter the stipulations of the technical specifications shall prevail.</p> <p>4) <b>DESIGN REQUIREMENTS</b></p> <p>a) The Pump shall be capable of developing the required total head at rated capacity for continuous operation. Also the pumps shall be capable of being operated to give satisfactory performance at any point on the HQ characteristics curve. The operating range of the pump shall be 40% to 120% of the duty point unless otherwise mentioned elsewhere. The maximum efficiency of pump shall preferably be within <math>\pm 10\%</math> of the rated design flow as indicated in data sheets.</p> <p>b) The total head capacity curve shall be continuously rising from the operating point towards shut-off without any zone of instability and with a minimum shut-off head of about 15% more than the design head.</p>		
<p style="text-align: center;">LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p style="text-align: center;">TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</p>	<p style="text-align: center;">SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</p>	<p style="text-align: center;">Page 21 of 26</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS 									
	<p style="text-align: right;"><b>Annexure –I</b></p> <p>c) Pumps of a particular category shall be identical and shall be suitable for parallel operation with equal load division. The head Vs capacity and BHP Vs capacity characteristics should match to ensure even load sharing and trouble free operation throughout the range. Components of identical pumps shall be interchangeable.</p> <p>d) Pumps shall run smoothly without undue noise and vibration. Peak to peak vibration limits shall be restricted to the following values during operation:</p> <table border="1" data-bbox="383 537 1162 663"> <thead> <tr> <th>Speed</th> <th>Antifriction Bearing</th> <th>Sleeve Bearing</th> </tr> </thead> <tbody> <tr> <td>1500 rpm and below</td> <td>75.0 micron</td> <td>75.0 micron</td> </tr> <tr> <td>3000 rpm</td> <td>50.0 micron</td> <td>65.0 micron</td> </tr> </tbody> </table> <p>The noise level shall not exceed 85 dBA overall sound pressure level reference 0.0002 microbar (the standard pressure reference for air sound measurement) at a distance of 1 M from the equipment surface.</p> <p>e) The pumps shall be capable of starting with discharge valve fully open and close condition. Motors shall be selected to suit to the above requirements. Continuous Motor rating (at 50 deg.C ambient) shall be atleast ten percent (10%) above the maximum load demand of the pump in the entire operating range to take care of the system frequency variation and no case less than the maximum power requirement at any condition of the entire characteristic curve of the pump.</p> <p>f) The kW rating of the drive unit shall be based on continuously driving the connected equipment for the conditions specified. However, in cases where parallel operation of the pumps are specified, the actual motor rating is to be selected by the Bidder considering overloading of the pumps in the event of tripping of operating pump(s).</p> <p>g) Pumps shall be so designed that pump impellers and other accessories of the pumps are not damaged due to flow reversal.</p> <p>h) The Contractor under this specification shall assume full responsibility in the operation of pump and motor as a unit.</p> <p>5) <b>DESIGN CONSTRUCTION</b></p> <p>a) Design and construction of various components of the pumps shall conform to the following general specifications. For material of construction of the components, data sheets shall be referred to.</p>	Speed	Antifriction Bearing	Sleeve Bearing	1500 rpm and below	75.0 micron	75.0 micron	3000 rpm	50.0 micron	65.0 micron
Speed	Antifriction Bearing	Sleeve Bearing								
1500 rpm and below	75.0 micron	75.0 micron								
3000 rpm	50.0 micron	65.0 micron								
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 22 of 26							


CLAUSE NO.	TECHNICAL REQUIREMENTS		
<b>Annexure –I</b>			
b)	<p><b>Pump Casing</b></p> <p>Pump casing shall have axially or radially split type construction as specified. The casing shall be designed to withstand the maximum shut-off pressure developed by the pump at the pumping temperature.</p> <p>Pump casing shall be provided with a vent connection and piping with fittings &amp; valves. Casing drain as required shall be provided complete with drain valves, piping and plugs. It shall be provided with a connection for suction and discharge pressure gauge as standard feature. It shall be structurally sound to provide housing for the pump assembly and shall be designed hydraulically to minimum radial load at part load operation.</p>		
c)	<p><b>Impeller</b></p> <p>Impeller shall be closed, semi-closed or open type as specified elsewhere and designed in conformance with the detailed analysis of the liquid being handled.</p> <p>The impeller shall be secured to the shaft, and shall be retained against circumferential movement by keying, pinning or lock rings. On pumps with overhung shaft, impellers shall be secured to the shaft by a lockout or cap screw which tightness in the direction of normal rotation.</p>		
d)	<p><b>Impeller/Casing Wearing Rings</b></p> <p>Replaceable type wearing rings shall be provided at suitable locations of pumps. Suitable method of locking the wearing ring shall be used. Wearing rings shall be provided in pump casing and/or impeller as per manufacturer's standard practice.</p>		
e)	<p><b>Shaft</b></p> <p>The critical speed shall be well away from the operating speed and in no case less than 130% of the rated speed.</p> <p>The shaft shall be ground and polished to final dimensions and shall be adequately sized to withstand all stresses from rotor weight, hydraulic loads, vibration and torques coming in during operation.</p>		
f)	<p><b>Shaft Sleeves</b></p> <p>Renewable type fine finished shaft sleeves shall be provided at the stuffing boxes/mechanical seals. Length of the shaft sleeves must extend beyond the outer faces of gland packing of seal end plates so as to distinguish between the leakage between shaft and shaft sleeve and that past the seals/gland.</p> <p>Shaft sleeves shall be fastened to the shaft to prevent any leakage or loosening. Shaft and shaft sleeve assembly should ensure concentric rotation.</p>		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2	SUB SECTION-I-M2 AIR CONDITIONING & VENTILATION SYSTEM	Page 23 of 26

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p style="text-align: right;"><b>Annexure –I</b></p> <p><b>g) Bearings</b>  Heavy duty bearings, adequately designed for the type of service specified in the enclosed pump data sheet and for long, trouble free operation shall be furnished.  The bearings offered shall be capable of taking both the radial and axial thrust coming into play during operation. In case, sleeve bearings are offered additional thrust bearings shall be provided. Antifriction bearings of standard type, if provided, shall be selected for a minimum life 20,000 hrs. of continuous operation at maximum axial and radial loads and rated speed.  Proper lubricating arrangement for the bearings shall be provided. The design shall be such that the bearing lubricating element does not contaminate the liquid pumped. Where there is a possibility of liquid entering the bearings suitable arrangement in the form of deflectors or any other suitable arrangement must be provided ahead of bearings assembly.  Bearings shall be easily accessible without disturbing the pump assembly. A drain plug shall be provided at the bottom of each bearings housing.</p> <p><b>h) Stuffing Boxes</b>  Stuffing box design should permit replacement of packing without removing any part other than the gland.  Stuffing boxes of packed ring construction type shall be provided wherever specified. Packed ring stuffing boxes shall be properly lubricated and sealed as per service requirements and manufacturer's standards. If external gland sealing is required, it shall be done from the pump discharge. The Bidder shall provide the necessary piping valves, fittings etc. for the gland sealing connection.</p> <p><b>i) Mechanical Seals</b>  Wherever specified in pump data sheet, mechanical seals shall be provided. Unless otherwise recommended by the tenderer, mechanical seals shall be of single type with either sliding gasket or bellows between the axially moving face and shaft sleeves or any other suitable type. The sealing faces should be highly lapped surfaces of materials known for their low frictional coefficient and resistance to corrosion against the liquid being pumped.</p> <p><b>j)</b> The pump supplier shall coordinate with the seal maker in establishing the seal chamber of circulation rate for maintaining a stable film at the seal face. The seal piping system shall form an integral part of the pump assembly. For the seals under vacuum service, the seal design must ensure sealing against atmospheric pressure even when the pumps are not operating. Necessary provision for seal water supply along with complete piping fittings and valves as required shall form integral part of pump supply.</p> <p><b>k) Pump Shaft Motor Shaft Coupling</b>  The pump and motor shafts shall be connected with an adequately sized flexible coupling of proven design with a spacer to facilitate dismantling of the pump without disturbing the motor. Necessary coupling guards shall also be provided.</p>		
<p style="text-align: center;">LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p style="text-align: center;">TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</p>	<p style="text-align: center;">SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</p>	<p style="text-align: center;">Page 24 of 26</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS		
	<p style="text-align: right;"><b>Annexure –I</b></p> <p><b>l) Base Plate</b> A common base plate mounting both for the pump and motor shall be furnished. The base plate shall be fabricated steel and of rigid construction, suitably ribbed and reinforced. Base plate and pump supports shall be so constructed and the piping unit so mounted as to minimize misalignment caused by mechanical forces such as normal piping strain, internal differential thermal expansion and hydraulic piping thrust. Suitable drain troughs and drip lip shall be provided.</p> <p><b>m) Assembly and Dismantling</b> Assembly and dismantling of each pump with drive motor shall be possible without disturbing the grouting base plate or alignment.</p> <p><b>n) Drive Motor (Prime Mover)</b> The kW rating of the drive shall be based on continuously driving the connected equipment for the conditions specified. However, in cases where parallel operation of the pumps are specified, the actual motor rating is to be selected by the Bidder considering overloading of the pumps in the event of tripping of operating pump(s).</p>		
<p style="text-align: center;">LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p style="text-align: center;">TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</p>	<p style="text-align: center;">SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</p>	<p style="text-align: center;">Page 25 of 26</p>

CLAUSE NO.	TECHNICAL REQUIREMENTS																													
	<p style="text-align: center;"><b>ANNEXURE-II</b></p> <p><b>PIPING THICKNESS:</b> Pipes for sizes 200 NB &amp; above shall confirm to IS: 3589 Grade 410. The thickness as mentioned below are the minimum specified nominal thickness as per IS: 3589. Tolerance as code shall be applicable.</p> <table border="1" data-bbox="436 459 1265 1024"> <thead> <tr> <th>Nominal pipe Size (mm)</th> <th>Outside Diameter (mm)</th> <th>Wall Thickness (mm)</th> </tr> </thead> <tbody> <tr> <td>200 NB</td> <td>219.1</td> <td>4.5</td> </tr> <tr> <td>250 NB</td> <td>273</td> <td>5</td> </tr> <tr> <td>300 NB</td> <td>323.9</td> <td>5.6</td> </tr> <tr> <td>350 NB</td> <td>355.6</td> <td>5.6</td> </tr> <tr> <td>400 NB</td> <td>406.4</td> <td>6.3</td> </tr> <tr> <td>450 NB</td> <td>457</td> <td>6.3</td> </tr> <tr> <td>500 NB</td> <td>508</td> <td>6.3</td> </tr> <tr> <td>600 NB</td> <td>610</td> <td>6.3</td> </tr> </tbody> </table>			Nominal pipe Size (mm)	Outside Diameter (mm)	Wall Thickness (mm)	200 NB	219.1	4.5	250 NB	273	5	300 NB	323.9	5.6	350 NB	355.6	5.6	400 NB	406.4	6.3	450 NB	457	6.3	500 NB	508	6.3	600 NB	610	6.3
Nominal pipe Size (mm)	Outside Diameter (mm)	Wall Thickness (mm)																												
200 NB	219.1	4.5																												
250 NB	273	5																												
300 NB	323.9	5.6																												
350 NB	355.6	5.6																												
400 NB	406.4	6.3																												
450 NB	457	6.3																												
500 NB	508	6.3																												
600 NB	610	6.3																												
<p style="text-align: center;">LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE</p>	<p style="text-align: center;">TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO:CS-0011-109(1A)-2</p>	<p style="text-align: center;">SUB SECTION-I-M2 AIR CONDITIONING &amp; VENTILATION SYSTEM</p>	<p style="text-align: center;">Page 26 of 26</p>																											



	<b>4X250 MW BRBCL NABINAGAR (FGD SYSTEM PACKAGE) HVAC SYSTEM PROJECT SPECIFIC GENERAL REQUIREMENTS</b>	<b>SPECIFICATION No: PE-TS-463-(571-13000-A)-A001</b>	
		<b>SECTION : I</b>	
		<b>SUB-SECTION : C 2B</b>	
		<b>REV. 00</b>	

## SECTION: I

### SUB-SECTION: C 2B

## CUSTOMER SPECIFICATIONS PROJECT SPECIFIC GENERAL REQUIREMENTS





**PART - C**  
**GENERAL TECHNICAL REQUIREMENTS**

LOT-IA PROJECTS  
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION  
SECTION-VI, PART-C  
BID DOC NO: CS-0011-109(1A)-2



**GENERAL TECHNICAL REQUIREMENTS**

**PART - C**

**CONTENTS**

<b>Clause No.</b>	<b>Description</b>	<b>Page No.</b>
1.00.00	Introduction	1
2.00.00	Brand Name	1
3.00.00	Base Offer & Alternate Proposals	1
4.00.00	Completeness of Facilities	1
5.00.00	Codes & Standards	2
6.00.00	Equipment Functional Guarantee	4
7.00.00	Design of Facilities/ Maintenance & Availability Considerations	5
8.00.00	Documents, Data and Drawings to be furnished by Contractor	5
9.00.00	Technical Co-ordination Meeting	21
10.00.00	Design Improvements	22
11.00.00	Equipment Bases	22
12.00.00	Protective Guards	22
13.00.00	Lubricants, Servo fluids and Chemicals	22
14.00.00	Lubrication	23
15.00.00	Material of Construction	23
16.00.00	Rating Plates, Name Plates & Labels	23
17.00.00	Tools and Tackles	24
18.00.00	Welding	25

LOT-IA PROJECTS  
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION  
SECTION-VI, PART-C  
BID DOC NO: CS-0011-109(1A)-2




Clause No.	Description	Page No.
19.00.00	Colour Code for All equipments/Pipings/PlpeServices	25
20.00.00	Protection and Preserveative shop Coating	25
21.00.00	Quality Assurance Programme	26
22.00.00	General Requirements - Quality Assurance	27
23.00.00	Quality Assurance Documents	32
24.00.00	Project Manager's Supervision	34
25.00.00	Inspection, Testing and Inspection Certificates	35
26.00.00	Pre-commissioning and Commissioning Facilities	38
27.00.00	Taking over	41
28.00.00	Training of Employer's Personnel	41
29.00.00	Safety Aspects during Construction and Erection	42
30.00.00	Noise Level	42
31.00.00	Packaging and Transportation	42
32.00.00	Electrical Equipments/Enclosures	43
33.00.00	Instrumentation and Control	43
34.00.00	Electrical Noise Control	44
35.00.00	Surge protection for solid state equipment	44
36.00.00	Instrument Air System	44
37.00.00	Tapping Points for Measurements	45
38.00.00	System Documentation	45
39.00.00	Maintenance Manuals of Electronic Modules	45


<b>LOT-IA PROJECTS</b> <b>FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</b>	<b>TECHNICAL SPECIFICATION</b> <b>SECTION-VI, PART-C</b> <b>BID DOC NO: CS-0011-109(1A)-2</b>
---	---





Clause No.	Description	Page No.
	Annexure - I	76
	Annexure - II	77
	Annexure - III	78
	Annexure - IV	79
	Annexure - V	80
	Annexure - VI	81
	Annexure - VII	83

<b>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</b>	<b>TECHNICAL SPECIFICATION SECTION-VI, PART-C BID DOC NO: CS-0011-109(1A)-2</b>
---	---


CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
1.00.00	<p><b>INTRODUCTION</b></p> <p>This part covers technical requirements which will form an integral part of the Contract. The following provisions shall supplement all the detailed technical specifications and requirements brought out in Section-VI, the Technical Specification and the Technical Data Sheets.</p>			
2.00.00	<p><b>BRAND NAME</b></p> <p>Whenever a material or article is specified or described by the name of a particular brand, manufacturer or vendor, the specific item mentioned shall be understood to be indicative of the function and quality desired, and not restrictive; other manufacturer's products may be considered provided sufficient information is furnished to enable the Employer to determine that the products proposed are equivalent to those named.</p>			
3.00.00	<p><b>BASE OFFER &amp; ALTERNATE PROPOSALS</b></p> <p>The Bidder's proposal shall be based upon the use of equipment and material complying fully with the requirements specified herein. It is recognised that the Contractor may have standardized on the use of certain components, materials, processes or procedures different than those specified herein. Alternate proposals offering similar equipment based on the manufacturer's standard practice will also be considered, provided the base offer is in line with technical specifications and such proposals meet the specified design standards and performance requirement and are acceptable to the Employer. Sufficient amount of information for justifying such proposals shall be furnished to Employer alongwith the bid to enable the Employer to determine the acceptability of these proposals.</p>			
4.00.00	<p><b>COMPLETENESS OF FACILITIES</b></p>			
4.01.00	<p>Bidders may note that this is a contract inclusive of the scope as indicated elsewhere in the specification. Each of the plant shall be engineered and designed in accordance with the specification requirement. All engineering and associated services are required to ensure a completely engineered plant shall be provided.</p>			
4.02.00	<p>All equipments furnished by the Contractor shall be complete in every respect, with all mountings, fittings, fixtures and standard accessories normally provided with such equipment and/or those needed for erection, completion and safe operation of the equipment and for the safety of the operating personnel, as required by applicable codes, though they may not have been specifically detailed in the respective specifications, unless included in the list of exclusions.</p> <p>All same standard components/ parts of same equipment provided, shall be interchangeable with one another.</p>			
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p>GENERAL TECHNICAL REQUIREMENTS</p>	<p>PAGE 1 OF 83</p>	


CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
4.03.00	For the C&I systems, the Contractor shall be required to provide regular information about future upgrades and migration paths to the Employer.		
5.00.00	<b>RULES, REGULATIONS, CODES &amp; STANDARDS</b>		
5.01.00	<p>In addition to the codes and standards specifically mentioned in the relevant technical specifications for the equipment / plant / system, all equipment parts, systems and works covered under this specification shall comply with all currently applicable statutory regulations and safety codes of the Republic of India, NTPC rules/codes of practices as well as of the locality where they will be installed, including the following:</p> <ul style="list-style-type: none"> <li>a) Indian Electricity Act</li> <li>b) Indian Electricity Rules</li> <li>c) Indian Explosives Act</li> <li>d) Indian Factories Act and State Factories Act</li> <li>e) Indian Boiler Regulations (IBR)</li> <li>f) Regulations of the Central Pollution Control Board, India</li> <li>g) Regulations of the Ministry of Environment &amp; Forest (MoEF), Government of India</li> <li>h) Pollution Control Regulations of Department of Environment, Government of India</li> <li>i) State Pollution Control Board.</li> <li>(j.) Rules for Electrical installation by Tariff Advisory Committee (TAC).</li> <li>(k.) Building and other construction workers (Regulation of Employment and Conditions of services) Act, 1996</li> <li>(l.) Building and other construction workers (Regulation of Employment and Conditions of services) Central Rules, 1998</li> <li>(m.) Explosive Rules, 1983</li> <li>(n.) Petroleum Act, 1984</li> <li>(o.) Petroleum Rules, 1976,</li> </ul>		
<p align="center">LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p align="center">GENERAL TECHNICAL REQUIREMENTS</p>	<p align="center">PAGE 2 OF 83</p>


CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
5.02.00	<p>(p.) Gas Cylinder Rules, 1981</p> <p>(q.) Static and Mobile Pressure Vessels (Unified) Rules, 1981</p> <p>(r.) Workmen's Compensation Act, 1923</p> <p>(s.) Workmen's Compensation Rules, 1924</p> <p>(t.) NTPC Safety Rules for Construction and Erection</p> <p>(u.) NTPC Safety Policy</p> <p>(v.) Any other statutory codes / standards / regulations, as may be applicable.</p> <p>Unless covered otherwise in the specifications, the latest editions (as applicable as on date of bid opening), of the codes and standards given below shall also apply:</p> <p>a) Bureau of Indian standards (BIS)</p> <p>b) Japanese Industrial Standards (JIS)</p> <p>c) American National Standards Institute (ANSI)</p> <p>d) American Society of Testing and Materials (ASTM)</p> <p>e) American Society of Mechanical Engineers (ASME)</p> <p>f) American Petroleum Institute (API)</p> <p>g) Standards of the Hydraulic Institute, U.S.A.</p> <p>h) International Organisation for Standardisation (ISO)</p> <p>i) Tubular Exchanger Manufacturer's Association (TEMA)</p> <p>j) American Welding Society (AWS)</p> <p>k) National Electrical Manufacturers Association (NEMA)</p> <p>l) National Fire Protection Association (NFPA)</p> <p>m) International Electro-Technical Commission (IEC)/European Norm (EN)</p> <p>n) Expansion Joint Manufacturers Association (EJMA)</p> <p>o) Heat Exchange Institute (HEI)</p>	
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p>GENERAL TECHNICAL REQUIREMENTS</p> <p>PAGE 3 OF 83</p>


CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
5.03.00	<p>p) IEEE standard</p> <p>q) JEC standard</p> <p>Other International/ National standards such as DIN, JIS, VDI, EN, BS, GOST etc. shall also be accepted for only material codes and manufacturing standards, subject to the Employer's approval, for which the Bidder shall furnish, adequate information to justify that these standards are equivalent or superior to the standards mentioned above. In all such cases the Bidder shall furnish specifically the variations and deviations from the standards mentioned elsewhere in the specification together with the complete word to word translation of the standard that is normally not published in English.</p>		
5.04.00	Not used.		
5.05.00	In the event of any conflict between the codes and standards referred to in the above clauses and the requirement of this specification, the requirement of Technical Specification shall govern.		
5.06.00	Two (2) English language copies of all national and international codes and/or standards used in the design of the plant, equipment, civil, structural and architectural works shall be provided by the Contractor to the Employer within two calendar months from the date of the Notification of Award.		
5.07.00	In case of any change in codes, standards & regulations between the date of bid opening and the date when vendors proceed with fabrication, the Employer shall have the option to incorporate the changed requirements or to retain the original standard. It shall be the responsibility of the Contractor to bring to the notice of the Employer such changes and advise Employer of the resulting effect.		
5.08.00	A detailed list of standards apart from those mentioned in the respective detailed specifications in other parts of Section-VI to which all equipment/systems/civil works should conform as indicated in this Part C and elsewhere in the specification.		
6.00.00	<b>EQUIPMENT FUNCTIONAL GUARANTEE</b>		
6.01.00	The functional guarantees of the equipment under the scope of the Contract is given in Section-VI Part - A of Technical Specifications. These guarantees shall supplement the general functional guarantee provisions covered under Defect liabilities Section-IV, General Conditions of Contract.		
6.02.00	Liquidated damages for shortfall in meeting functional guarantee(s) during the performance and guarantee tests shall be assessed and recovered from the Contractor as specified elsewhere in this specification.		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 4 OF 83





CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
7.00.00	<b>DESIGN OF FACILITIES/ MAINTENANCE &amp; AVAILABILITY CONSIDERATIONS</b>	
7.01.00	<b>DESIGN OF FACILITIES</b>	
	<p>All the design procedures, systems and components proposed shall have already been adequately developed and shall have demonstrated good reliability under similar conditions elsewhere.</p> <p>The Contractor shall be responsible for the selection and design of appropriate equipments to provide the best co-ordinated performance of the entire system. The basic requirements are detailed out in various clauses of the Technical Specifications. The design of various components, assemblies and subassemblies shall be done so that it facilitates easy field assembly and dismantling. All the rotating components shall be so selected that the natural frequency of the complete unit is not critical or close to the operating range of the unit.</p>	
7.02.00	<p><b>MAINTENANCE AND AVILABILITY CONSIDERATIONS</b></p> <p>Equipment/works offered shall be designed for high availability, low maintenance and ease of maintenance. The Bidder shall specifically state the design features incorporated to achieve high degree of reliability/ availability and ease of maintenance. The Bidder shall also furnish details of availability records in the reference plants stated in his experience list.</p> <p>Bidder shall state in his offer the various maintenance intervals, spare parts and man-hour requirement during such operation. The intervals for each type of maintenance namely inspection of the furnace, inspection of the entire hot gas path and the minor and major overhauls shall be specified in terms of fired hours , clearly defining the spare parts and man-hour requirement for each stage.</p> <p>Lifting devices i.e. hoists and chain pulley jacks ,etc. shall be provided by the contractor for handling of any equipment or any of its part having weight in excess of 500 Kgs during erection and maintenance activities.</p> <p>Lifting devices like lifting tackles, slings, etc. to be connected to hook of the hoist / crane shall be provided by the contractor for lifting the equipment and accessories covered under the specification.</p>	
8.00.00	<b>DOCUMENTS, DATA AND DRAWINGS TO BE FURNISHED BY CONTRACTOR</b>	
8.01.00	<p>Bidders may note that this is a contract inclusive of the scope as indicated elsewhere in the specification. Each of the plant and equipment shall be fully integrated, engineered and designed to perform in accordance with the technical specification. All engineering and technical services required to ensure a completely</p>	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS
PAGE 5 OF 83		


CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
8.02.00	<p>engineered plant shall be provided in respect of mechanical, electrical, control &amp; instrumentation, civil &amp; structural works as per the scope.</p> <p>Each main and auxiliary equipment/item of the plant including instruments shall be assigned a unique tag number. The assignment of tag numbers shall be in accordance with KKS system. In all drawings/documents/data sheet etc. KKS tag number of the equipment/item/instrument etc. shall be indicated.</p> <p>The Contractor shall furnish engineering data /drawings in accordance with the schedule of information as specified in Technical Data Sheets and Technical Specification.</p> <p>A comprehensive engg and quality coordination procedure shall be finalized with the successful bidder covering salient features as described in this section of specifications.</p> <p>The number of copies/prints/CD-ROMs/manuals to be furnished for various types of document is given in <b>Annexure-VI</b> to this Part-C, Section-VI of the Technical Specification.</p>		
8.03.00	<p>The documentation that shall be provided by the Contractor is indicated in the various sections of specification. This documentation shall include but not be limited to the following:</p>		
8.03.01	<p><b>A) BASIC ENGINEERING DOCUMENTATION</b></p> <p>Prior to commencement of the detailed engineering work, the Contractor shall furnish a Plant Definition Manual within 12 weeks from the date of the Notification of Award. This manual shall contain the following as a minimum:</p> <ul style="list-style-type: none"> <li>i) System description of all the mechanical, electrical, control &amp; instrumentation &amp; civil systems.</li> <li>ii) Technology scan for each system / sub-system &amp; equipment.</li> <li>iii) Selection of appropriate technology / schemes for various systems/ subsystems including techno-economic studies between various options.</li> <li>iv) Optimisation studies including thermal cycle optimisation.</li> <li>v) Sizing criteria of all the systems, sub-systems/ equipments/ structures/ equipment foundations alongwith all calculations justifying and identifying the sizing and the design margins.</li> <li>vi) Schemes and Process &amp; Instrumentation diagrams for the various systems/ sub-system with functional write-ups.</li> </ul>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p>GENERAL TECHNICAL REQUIREMENTS</p>	<p>PAGE 6 OF 83</p>


CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	<p>vii) Operation Philosophy and the control philosophy of the equipments/system covered under the scope.</p> <p>ix) General Layout plan of the FGD System incorporating all facilities in Bidder's as well as those in the Employer's scope. This drawing shall also be furnished in the form of CD-ROMs to the Employer for engineering of areas not included in bidder's scope.</p> <p>x) Basic layouts and cross sections of the main plant building (various floor elevations), boiler, fuel oil area and other areas included in the scope of the bidder.</p> <p>xi) Documentation in respect of Quality Assurance System as listed out elsewhere in this specification.</p> <p>The successful bidder shall furnish within three (3) weeks from the date of Notification of Award, a list of contents of the Plant Definition Manual (PDMs) including techno-economic studies, which shall then be mutually discussed &amp; finalised with the Employer.</p> <p><b>B) DETAILED ENGINEERING DOCUMENTS</b></p> <p>i) General layout plan of the FGD System.</p> <p>ii) Layouts, general arrangements, elevations and cross-sections drawings for all the equipment and facilities of the plant.</p> <p>iii) Flow diagram, process and instrumentation diagrams along with write up and system description.</p> <p>iv) Performance curves for Absorber</p> <p>v) Piping isometric, composite layout and fabrication drawings.</p> <p>vi) Piping engineering diagrams, pipe and fittings schedules, valve schedules, hanger and support schedules, insulation schedules.</p> <p>vii) Technical data sheets for all bought out and manufactured items. Contractor shall use the Employer's specifications as a base for placement of orders on their sub vendors.</p> <p>viii) Detailed design calculations for components, system, piping etc., wherever applicable including sizing calculations for all auxiliaries like mills, fans etc- as per criteria specified elsewhere in specification.</p> <p>ix) Absorber sizing calculations. Absorber performance data.</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p>GENERAL TECHNICAL REQUIREMENTS</p>	<p>PAGE 7 OF 83</p>

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	<ul style="list-style-type: none"> <li>x) Mass Balance Diagram</li> <li>xi) Characteristic Curves/ Performance Correction Curves.</li> <li>xii) Comprehensive list of all terminal points which interface with Employer's facilities, giving details of location, terminal pressure, temperature, fluid handled &amp; end connection details, forces, moments etc.</li> <li>xiii) Power supply single line diagram, block logics, control schematics, electrical schematics, etc.</li> <li>xiv) Protection system diagrams and relay settings.</li> <li>xv) Cables schedules and interconnection diagrams.</li> <li>xvii) Cable routing plan.</li> <li>xviii) Instrument schedule, measuring point list, I/O list, Interconnection &amp; wiring diagram, functional write-ups, and installation drawings for field mounted instruments, logic diagrams, control schematics, wiring and tubing diagrams of panels and enclosures etc. Drawings for open loop and close loop controls (both hardware and software). Motor list and valve schedule including type of actuator etc.</li> <li>xix) Alarm and annunciation/ Sequence of Event (SOE) list and alarms &amp; trip set points.</li> <li>xx) Sequence and protection interlock schemes.</li> <li>xxi) Type test reports, insulation co-ordination study report</li> <li>xxii) Control system configuration diagrams and card circuit diagrams and maintenance details.</li> <li>xxiii) Detailed Control system manuals.</li> <li>xxiv) Detailed flow chart for digital control system.</li> <li>xv) Mimic diagram layout, Assignment for other application engg. drawings and documents.</li> <li>xxvi) Civil and Structural works drawings and documents for all structures, facilities, architectural works, foundations underground and overground works and super-structural works as included in the</li> </ul>		
<p align="center">LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p align="center">TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p align="center">GENERAL TECHNICAL REQUIREMENTS</p>	<p align="center">PAGE 8 OF 83</p>


CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
8.03.02	<p>scope of the bidder civil calculation sheets including structural analysis and design alongwith output results.</p> <p>xxvii) Underground facilities, levelling, sanitary, land scaping drawings.</p> <p>xxviii) Geotechnical investigation and site survey reports (if and as applicable).</p> <p>xxix) Model study reports wherever applicable.</p> <p>xxx) Functional &amp; guarantee test procedures and test reports.</p> <p>xxxi) Documentation in respect of Quality Assurance System, and Documentation in respect of Commissioning, as listed out elsewhere in this specification.</p> <p>xxxii) Maintenance schedule for Absorber &amp; auxiliaries clearly indicating interval, duration if shutdown required, manhours required and tools &amp; tackles required for maintenance.</p> <p>The Contractor's while submitting the above documents/ drawings for approval/ reference as the case may be, shall mark on each copy of submission the reference letter alongwith the date vide which the submissions are made.</p> <p><b>INSTRUCTION MANUALS</b></p> <p>The Contractor shall make first submission of instruction manual for all the equipments covered under the Contract as per agreed engineering information schedule. The Instruction manuals shall contain full details required for erection, commissioning, operation and maintenance of each equipment. The manual shall be specifically compiled for this project. After finalisation and approval of the Employer the Instruction Manuals shall be submitted as indicated in <b>Annexure-IV</b>. The Contract shall not be considered to be completed for purposes of taking over until the final Instructions manuals have been supplied to the Employer. The Instruction Manuals shall comprise of the following.</p> <p><b>A) ERECTION MANUALS</b></p> <p>The erection manuals shall be submitted atleast three (3) months prior to the commencement of erection activities of particular equipment/system. The erection manual should contain the following as a minimum.</p> <p>a) Erection strategy.</p> <p>b) Sequence of erection.</p>		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 9 OF 83


CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	<p>c) Erection instructions.</p> <p>d) Critical checks and permissible deviation/tolerances.</p> <p>e) List of tool, tackles, heavy equipments like cranes, dozers, etc.</p> <p>f) Bill of Materials</p> <p>g) Procedure for erection and General Safety procedures to followed during erection/installation.</p> <p>h) Procedure for initial checking after erection.</p> <p>i) Procedure for testing and acceptance norms.</p> <p>j) Procedure / Check list for pre-commissioning activities.</p> <p>k) Procedure / Check list for commissioning of the system.</p> <p>l) Safety precautions to be followed in electrical supply distribution during erection.</p> <p><b>B) OPERATION &amp; MAINTENANCE MANUALS</b></p> <p>a) The manual shall be a two rim PVC bound stiff sided binder able to withstand constant usage or where a thicker type is required it shall have locking steel pins, the size of the manual shall not be larger than international size A3. The cover shall be printed with the Project Name, Services covered and Volume / Book number Each section of the manual shall be divided by a stiff divider of the same size as the holder. The dividers shall clearly state the section number and title. All written instructions within the manual not provided by the manufacturers shall be typewritten with a margin on the left hand side.</p> <p>b) The arrangement and contents of O &amp; M manuals shall be as follows:</p> <p>1) <u>Chapter 1 - Plant Description</u>: To contain the following sections specific to the equipment/system supplied</p> <p>(a) Description of operating principle of equipment / system with schematic drawing / layouts.</p>	
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p>GENERAL TECHNICAL REQUIREMENTS</p> <p>PAGE 10 OF 83</p>


CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	<p>(b) Functional description of associated accessories / controls. Control interlock protection write up.</p> <p>(c) Integrated operation of the equipment alongwith the intended system. (This is to be given by the supplier of the Main equipment by taking into account the operating instruction given by the associated suppliers).</p> <p>(d) Exploded view of the main equipment, associated accessories and auxiliaries with description. Schematic drawing of the equipment alongwith its accessories and auxiliaries.</p> <p>(e) Design data against which the plant performance will be compared.</p> <p>(f) Master list of equipments, Technical specification of the equipment/ system and approved data sheets.</p> <p>(g) Identification system adopted for the various components, (it will be of a simple process linked tagging system).</p> <p>(h) Master list of drawings (as built drawing - Drawings to be enclosed in a separate volume).</p> <p>2) <u>Chapter 2.0 - Plant Operation:</u> To contain the following sections specific to the equipment supplied</p> <p>(a) Protection logics provided for the equipment alongwith brief philosophy behind the logic, Drawings etc.</p> <p>(b) Limiting values of all protection settings.</p> <p>(c) Various settings of annunciation/interlocks provided.</p> <p>(d) Startup and shut down procedure for equipment alongwith the associated systems in step mode.</p> <p>(e) Do's and Don'ts related to operation of the equipment.</p> <p>(f) Safety precautions to be take during normal operation. Emergency instruction on total power failure condition/lubrication failure/any other conditions.</p> <p>(g) Parameters to be monitored with normal value and limiting values.</p> <p>(h) Equipment isolating procedures.</p>	
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p>GENERAL TECHNICAL REQUIREMENTS</p> <p>PAGE 11 OF 83</p>


CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	<p>(i) Trouble shooting with causes and remedial measures.</p> <p>(j) Routine testing procedure to ascertain healthiness of the safety devices alongwith schedule of testing.</p> <p>(k) Routine Operational Checks, Recommended Logs and Records</p> <p>(l) Change over schedule if more than one auxiliary for the same purpose is given.</p> <p>(m) Preservation procedure on long shut down.</p> <p>(n) System/plant commissioning procedure.</p> <p>3) <u>Chapter 3.0 - Plant Maintenance-</u> To contain the following sections specific to the equipment supplied.</p> <p>(a) Exploded view of each of the equipments. Drawings alongwith bill of materials including name, code no. &amp; population.</p> <p>(b) Exploded view of the spare parts and critical components with dimensional drawings (In case of Electronic cards, the circuit diagram to be given) and spare parts catalogue for each equipment.</p> <p>(c) List of Special T/ P required for Overhauling /Trouble shooting including special testing equipment required for calibration etc.</p> <p>(d) Stepwise dismantling and assembly procedure clearly specifying the tools to be used, checks to be made, records to be maintained etc. Clearance to be maintained etc.</p> <p>(e) Preventive Maintenance schedules linked with running hours/calendar period alongwith checks to be carried out.</p> <p>(f) Overhauling schedules linked with running hours/calendar period alongwith checks to be done.</p> <p>(g) Long term maintenance schedules</p> <p>(h) Consumables list alongwith the estimated quantity required during normal running and during maintenance like Preventive Maintenance and Overhauling.</p> <p>(i) List of lubricants with their Indian equivalent, Lubrication Schedule including charts showing lubrication checking, testing and replacement procedure to be carried daily, weekly, monthly &amp; at</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p>GENERAL TECHNICAL REQUIREMENTS</p>	<p>PAGE 12 OF 83</p>



CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
8.03.03	<p>longer intervals to ensure trouble free operation and quantity required for complete replacement.</p> <p>(j) Tolerance for fitment of various components.</p> <p>(k) Details of sub vendors with their part no. in case of bought out items.</p> <p>(l) List of spare parts with their Part No, total population, life expediency &amp; their interchangeability with already supplied spares to NTPC.</p> <p>(m) List of mandatory and recommended spare list along with manufacturing drawings, material specification &amp; quality plan for fast moving consumable spares.</p> <p>(n) Lead time required for ordering of spares from the equipment supplier, instructions for storage and preservation of spares.</p> <p>(o) General information on the equipment such as modification carried out in the equipment from its inception, equipment population in the country / foreign country and list of utilities where similar equipments have been supplied.</p> <p>After finalization and approval of the Employer, the O &amp; M Manuals shall be submitted as indicated in Annexure-VI. The Contract shall not be considered to be completed for purposes of taking over until the final Instructions manuals (both erection and O &amp; M manuals have been supplied to the Employer.</p> <p>If after the commissioning and initial operation of the plant, the instruction manuals (Erection and /or O &amp;M manuals) require modifications/additions/ changes, the same shall be incorporated and the updated final instruction manuals shall be submitted by the Contractor to the Employer for records and number of copies shall be as mentioned in Annexure-VI.</p>	
8.03.03	<b>PLANT HANDBOOK AND PROJECT COMPLETION REPORT</b>	
8.03.03.01	<p><b>PLANT HANDBOOK</b></p> <p>The Contractor shall submit to the Employer a preliminary plant hand book preferably in A-4 size sheets which shall contain the design and performance data of various plants, equipments and systems covering the complete project including</p> <p>i) Design and performance data.</p> <p>ii) Process &amp; Instrumentation diagrams.</p> <p>iii) Single line diagrams.</p>	
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p>GENERAL TECHNICAL REQUIREMENTS</p> <p>PAGE 13 OF 83</p>

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	iv) Sequence & Protection Interlock Schemes. v) Alarm and trip values. vi) Performance Curves. vii) General layout plan and layout of main plant building and auxiliary buildings viii) Important Do's & Don't's  The plant handbook shall be submitted within twelve (12) months from the date of award of contract. After the incorporation of Employer's comments, the final plant handbook complete in all respects shall be submitted three (3) months before start-up and commissioning activities.		
8.03.03.02	<b>PROJECT COMPLETION REPORT</b>  The Contractor shall submit a Project Completion Report at the time of handing over the plant.		
8.03.04	<b>DRAWINGS</b>  a) i) All the FGD plant layouts shall be made in computerised 3D modelling system. The Employer reserves the right to review the 3D model at different stages during the progress of engineering. The layout drawings submitted for Employer's review shall be fully dimensioned and extracted from 3D model after interference check.  ii) All documents submitted by the Contractor for Employer's review shall be in electronic form (soft copies) along with the desired number of hard copies as per <b>Annexure-VI</b> of Part-C. The soft copies shall be uploaded by the vendors in C-folders, a Web-based system of NTPC ERP, for which a username and password will be allotted to the new vendor by NTPC.  Similarly, the vendor can download the drawings/documents, approved/ commented by NTPC, through above site.  The soft copies of identified drawings/documents shall be in pdf format, whereas the attachments/reply to the submitted document(s) can be in .doc, .xls, .pdf, .dwg or .std formats.  iii) Final copies of the approved drawings along with requisite number of hard copies shall be submitted as per <b>Annexure-VI</b> of Part-C.  iv) Contractor shall prepare the model of all the facilities located in FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE (including all		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 14 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	<p>facilities), and any other facility in an integrated &amp; intelligent 3D software solution using rule-based, data centric 3D Design software with equipment drawings, data sheets, intelligent P&amp;ID correlated with intelligent 3D Model, BOQ, schematics and logic diagrams etc. attached to the respective equipment / systems in the aforesaid 3D model. Contractor shall make a presentation on 3D model every 3 months from LOA to enable NTPC to review the progress of engineering. After the completion of engineering the corresponding complete 3D review model shall be handed over to the employer for its reference.</p> <p>Contractor shall provide 3D model (which shall include visual interference check, walk-through animation, video simulation for major equipment placement and removal, visual effect, photo realism etc), which is extracted from intelligent 3D model, for employer's review as &amp; when desired by employer. However, all piping layouts, equipment layouts, floor plans, ducting layout (Air/flue gas, A/C, Ventilation etc.), General Arrangement drawings of major buildings, structural arrangement drawings and RCC layout drawings shall necessarily be extracted from the aforesaid 3D model and submitted for employer's review along with the 3D review model to enable NTPC to review and approve these drawings.</p> <p>b) All documents/text information shall be in latest version of MS Office / MS Excel / PDF FORMAT as applicable.</p> <p>c) All drawings submitted by the Contractor including those submitted at the time of bid shall be in sufficient detail indicating the type, size, arrangement, weight of each component for packing and shipment, the external connection, fixing arrangement required, the dimensions required for installation and interconnections with other equipments and materials, clearance and spaces required between various portions of equipment and any other information specifically requested in the drawing schedules.</p> <p>d) Each drawing submitted by the Contractor (including those of subvendors) shall bear a title block at the right hand bottom corner with clear mention of the name of the Employer, the system designation, the specifications title, the specification number, the name of the Project, drawing number and revisions. If standard catalogue pages are submitted the applicable items shall be indicated therein. All titles, notings, markings and writings on the drawing shall be in English. All the dimensions should be in metric units.</p> <p>e) The drawings submitted by the Contractor (or their subvendors) shall bear Employer's drawing number in addition to contractor's (their sub-vendor's) own drawing number. Employer's drawing numbering system shall be made available to the successful bidder so as to enable him to assign Employer's drawing numbers to the drawings to be submitted by him during the course of execution of the Contract.</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p>GENERAL TECHNICAL REQUIREMENTS</p>	<p>PAGE 15 OF 83</p>

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	<p>The Contractor shall also furnish a "Master Drawing List" which shall be a comprehensive list of all drawings/ documents/ calculations envisaged to be furnished by him during the detailed engineering to the Employer. Such list should clearly indicate the purpose of submission of these drawings i.e. "FOR APPROVAL" or "FOR INFORMATION ONLY".</p> <p>Similarly, all the drawings/ documents submitted by the Contractor during detailed engineering stage shall be marked "FOR APPROVAL" or "FOR INFORMATION" prior to submission. Further, space shall be identified on each drawing for Approval stamp and electronic signature.</p> <p>f) The furnishing of detailed engineering data and drawings by the Contractor shall be in accordance with the time schedule for the project. The review of these documents/ data/ drawings by the Employer will cover only general conformance of the data/ drawings/ documents to the specifications and contract, interfaces with the equipments provided by others and external connections &amp; dimensions which might affect plant layout. The review by the Employer should not be construed to be a thorough review of all dimensions, quantities and details of the equipments, materials, any devices or items indicated or the accuracy of the information submitted. The review and/ or approval by the Employer/ Project Manager shall not relieve the Contractor of any of his responsibilities and liabilities under this contract.</p> <p>g) After the approval of the drawings, further work by the Contractor shall be in strict accordance with these approved drawings and no deviation shall be permitted without the written approval of the Employer.</p> <p>h) All manufacturing, fabrication and execution of work in connection with the equipment / system, prior to the approval of the drawings, shall be at the Contractor's risk. The Contractor is expected not to make any changes in the design of the equipment /system, once they are approved by the Employer. However, if some changes are necessitated in the design of the equipment/system at a later date, the Contractor may do so, but such changes shall promptly be brought to the notice of the Employer indicating the reasons for the change and get the revised drawing approved again in strict conformance to the provisions of the Technical Specification.</p> <p>i) Drawings shall include all installations and detailed piping layout drawings. Layout drawings for all piping of 65 mm and larger diameter shall be submitted for review/ approval of Employer prior to erection. Small diameter pipes shall however be routed as per site conditions in consultation with site authority/ representative of Employer based on requirements of such piping indicated in approved/ finalised Flow Scheme/ Process &amp; Instrumentation Diagrams and/or the requirements cropping up for draining &amp; venting of larger diameter piping or otherwise after their erection as per actual physical condition for the entire scope of work of this package.</p>		
<p>LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2</p>	<p>GENERAL TECHNICAL REQUIREMENTS</p>	<p>PAGE 16 OF 83</p>